

ZEBULON ANIMAL HOSPITAL CONSTRUCTION DRAWINGS

PROJECT ID: 1130505

1620 N. ARENDELL AVE.
ZEBULON, NC

OCTOBER 2, 2023
REVISED: NOVEMBER 20, 2023
REVISED: JANUARY 5, 2024
REVISED: FEBRUARY 1, 2024
REVISED: MARCH 4, 2024

CONTACT INFORMATION

APPLICANT
ZAH REALTY, LLC
325 NASH STREET E
WILSON, NC 27893
CONTACT: BRIAN WOOD
PHONE: 252.237.1375
EMAIL: BRIANWOOD@THEVETSPETS.COM

OWNER
JULIA M. HICKS
PO BOX 576
ZEBULON, NC 27597
PHONE: 919.931.6752
EMAIL: DALLAS@DALLASPEARCREALTY.COM

LANDSCAPE ARCHITECT
SITE COLLABORATIVE, INC.
1620 HILLSBOROUGH ST, SUITE 100
RALEIGH, NC 27605
CONTACT: GRAHAM H. SMITH
PHONE: 919.805.3586
EMAIL: GRAHAM@SITECOLLABORATIVE.COM

ARCHITECT
CLINE DESIGN ASSOCIATES
125 N. HARRINGTON ST
RALEIGH, NC 27603
CONTACT: KELLY SYNNOTT
PHONE: 919.833.6413
EMAIL: KELLYS@CLINEDESIGNASSOC.COM

CIVIL ENGINEER
BARTLETT ENGINEERING & SURVEYING, PC
1906 NASH STREET NORTH
WILSON, NC 27893
CONTACT: ROBERT BARTLETT
PHONE: 252.399.0704
EMAIL: ROBERT@BARTLETTENG.COM

ATTENTION CONTRACTORS

The *Construction Contractor* responsible for the extension of water, sewer, and/or reuse, as approved in these plans, is responsible for contacting the **Public Utilities Department** at (919) 996-4540 at least *twenty four hours* prior to beginning any of their construction.

Failure to notify both *City Departments* in advance of beginning construction, will result in the issuance of *monetary fines*, and require reinstallation of any water or sewer facilities not inspected as a result of this notification failure.

Failure to call for *Inspection*, *Install a Downstream Plug*, have *Permitted Plans* on the *Jobsite*, or any other *Violation of City of Raleigh Standards* will result in a *Fine and Possible Exclusion* from future work in the *City of Raleigh*.



VICINITY MAP



NTS

HEAVY COMMERCIAL (HC) DISTRICT DIMENSIONAL STANDARDS FOR NON-RESIDENTIAL DEVELOPMENT

STANDARD	REQUIRED	PROVIDED
MINIMUM LOT AREA (SQUARE FEET)	6,000	48,650
MINIMUM LOT WIDTH (LINEAR FEET)	50	193
MINIMUM STREET SETBACK (FEET)	30	30
MINIMUM SIDE SETBACK (FEET)	0, 5 IF PROVIDED	
MINIMUM REAR SETBACK (FEET)	0 IF ABUTTED BY AN ALLEY; OTHERWISE 25	25
MAXIMUM BUILDING HEIGHT (FEET)	50; HEIGHT MAY INCREASE BY 2 FEET FOR EACH ADDITIONAL FOOT OF SETBACK UP TO 100 FEET IN HEIGHT	26'-2"
MINIMUM SPACING BETWEEN PRINCIPAL BUILDINGS ON THE SAME LOT (FEET)	25	N/A

UTILITY ALLOCATION POLICY COMPLIANCE

BASE POINTS:
SINGLE USE OFFICE - 30 POINTS

BONUS POINTS:
CATEGORY 1 - NON-CONFORMITY ABATEMENT AND PUBLIC INFRASTRUCTURE IMPROVEMENTS (0)

CATEGORY 2 - GREEN DEVELOPMENT STANDARDS/BUILDING AND SITE DESIGN (10)

- SECTION 2B - PARKING
- EV CHARGING STATION (TWO PORT) - 5 POINTS (SEE SHEET L200)
- SECTION 2C - STORMWATER SCMS (MAX 10)
- BIORETENTION - 5 POINTS. (SEE SHEET L300)

CATEGORY 3 - OUTDOOR ENHANCEMENT (12)

- SECTION 3A - OUTDOOR ENHANCEMENT (MAX 12)
- PLANTING POLLINATOR GARDEN - 3 POINTS (SEE SHEET L400)
- INSTALLATION OF NATIVE SHADE TREE SPECIES - 9 POINTS (SEE SHEET L400)

CATEGORY 4 - AMENITIES (8)

- SECTION 4G - ADDITIONAL URBAN OPEN SPACE ENHANCEMENTS (WITHIN NON-RESIDENTIAL ZONING DISTRICTS) - MAX 10 POINTS
- FOUNTAIN (DECORATIVE) - 2 POINTS (SEE SHEET L200)
- CANOPY INCLUDING FIXED PERMANENT SEATING - 2 POINTS (SEE SHEET L200)
- DRINKING FOUNTAIN WITH PET FOUNTAIN - 2 POINTS (SEE SHEET L200)
- LITTLE FREE LIBRARY - 1 POINT (SEE SHEET L200)
- ALL WEATHER BULLETIN BOARD - 1 POINT (SEE SHEET L200)

CATEGORY 5 - AFFORDABLE HOUSING - MAX 10 POINTS (0)

CATEGORY 6 - OTHER - MAX 5 POINTS (0)

POINT SUMMARY:


BASE	30 POINTS
CATEGORY 1	0 POINTS
CATEGORY 2	10 POINTS
CATEGORY 3	12 POINTS
CATEGORY 4	8 POINTS
CATEGORY 5	0 POINTS
CATEGORY 6	0 POINTS
TOTAL	60 POINTS

SHEET INDEX

L000	COVER
L001	ZONING CONDITIONS AND TOWN OF ZEBULON STANDARD NOTES
L100	EXISTING CONDITIONS & DEMOLITION PLAN
L200	LAYOUT AND HARDSCAPE PLAN
L201	HARDSCAPE LEGEND
L202	HARDSCAPE DETAILS
L203	HARDSCAPE DETAILS
L204	HARDSCAPE DETAILS
L205	HARDSCAPE DETAILS
L300	GRADING PLAN
L400	PLANTING PLAN
L401	PLANT SCHEDULE AND NOTES
L402	PLANTING DETAILS
OV1	OVERALL PLAN
UP1	EXISTING CONDITIONS & PROPOSED UTILITY PLAN
NCDOT-1	R.O.W. DEMO PLAN
NCDOT-2	MILL OVERLAY
NCDOT-3	STRIPING PLAN
ST1	DRIVEWAY STEM PROFILES
SW1	STORMWATER PLAN
SW2	BIORETENTION CELL PLANS
SE1	SEDIMENTATION AND EROSION CONTROL PLAN (PHASE 1)
SE2	SEDIMENTATION AND EROSION CONTROL PLAN (PHASE 2)
DT1	SITE DETAILS
DT2	SEDIMENTATION AND EROSION CONTROL DETAILS
DT3	SEDIMENTATION AND EROSION CONTROL DETAILS NCG01
DT4	NCDOT DETAILS
DT5	NCDOT DETAILS
DT6	NCDOT DETAILS
DT7	NCDOT DETAILS
DT8	SEDIMENTATION AND EROSION CONTROL DETAILS

SITE DATA SUMMARY

EXISTING DATA	
PROJECT NAME	ZEBULON ANIMAL HOSPITAL
STREET ADDRESS	1620 N. ARENDELL AVENUE, ZEBULON, NC
ZONING	R2
PIN	1796922199
REAL ID NUMBER	0030585
DEED BOOK / DEED PAGE	DB 2050, PG 630
LAND USE	SINGLE FAMILY RESIDENTIAL
LOT AREA	1.12 AC (48,650 SF)
PROPOSED DATA	
ZONING	HEAVY COMMERCIAL CONDITIONAL (HC-C)
PROPOSED USE	VETERINARY CLINIC
RW DEDICATION	N/A
NET LOT AREA	1.12 AC (48,650 SF)
OPEN SPACE SET-ASIDE REQUIRED	1,459.50 SF (3% OF SITE)
OPEN SPACE SET-ASIDE PROVIDED	4,400 SF (9.04% OF SITE)
PARKING SUMMARY	
PARKING REQUIRED (4 PER DOCTOR)	12 OR 16 SPACES (3 OR 4 DOCTORS)
PARKING PROVIDED	30 SPACES (INCLUDING 1 STD, 1 VAN ACCESSIBLE ADA SPACE)
LOT COVERAGE	
EXISTING LOT COVERAGE	4,010 SF (0.09 AC) (8.24%)
LOT COVERAGE PROPOSED	24,939 SF (0.57 AC) (51%)
LOT COVERAGE ALLOWED	80% OF LOT AREA
CALCULATED LOT COVERAGE ALLOWED	0.8 X 48,650 SF = 38,920 SF (0.89 AC)
NET CHANGE IN LOT COVERAGE	+ 20,929 SF (0.48 AC)

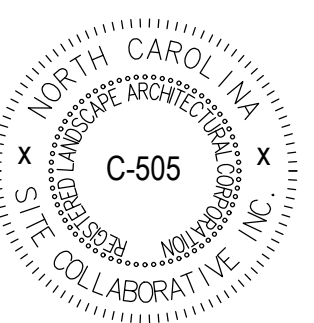

REUSE OF DOCUMENT
This document is the property of Site Collaborative Inc. The ideas and design incorporated on this document is an instrument of professional service and shall not be used for any other project without written authorization of Site Collaborative Inc.

ZEBULON ANIMAL HOSPITAL
ZAH REALTY, LLC
1620 N. ARENDELL AVE., ZEBULON, NC

PROJECT NUMBER:
22091

PROJECT PHASE:
CONSTRUCTION DRAWINGS

DATE: 10.02.2023

REVISED: 11.20.2023
REVISED: 1.5.2024
REVISED: 2.1.2024
3.4.2024 PER NCDOT
REVISED: 3.15.2024
REVISED: 6.4.2024

SHEET TITLE:

COVER

SHEET NUMBER:

L000

ZONING CONDITIONS

- Use of the property shall be limited to Veterinary Clinic. Such use will comply with section 4.3.5.RR of the Town Zebulon Unified Development Ordinance, except that outdoor exercise area may be located closer than 200 feet from a lot in a residential zone, provided that it is enclosed by a six-foot tall opaque fence as shown on sheet L400 Planting Plan of the Zebulon Animal Hospital Conditional Zoning Plan Dated June 1, 2023.
- In order to accommodate the shallow lot width, the 40-wide buffers required along the residentially zoned properties have been reduced; however, in these locations a six-foot tall opaque fence and enhanced landscaping will be provided as shown on Sheet L400 Planting Plan Zebulon Animal Hospital Conditional Zoning Plan Dated June 1, 2023. Except as noted in Condition Three (3).

TOWN OF ZEBULON STANDARD CONSTRUCTION NOTES

- ALL ROADWAY AND GREENWAY INFRASTRUCTURE CONSTRUCTION SHALL CONFORM TO THE TOWN OF ZEBULON STANDARDS AND SPECIFICATIONS.
- CONTRACTOR IS RESPONSIBLE FOR SUBMITTING A TRAFFIC CONTROL PLAN TO THE TOWN OF ZEBULON CONSTRUCTION INSPECTOR FOR APPROVAL. THE GOAL IS NOT TO RESTRICT TRAFFIC DURING PEAK BUSINESS HOURS OF 6:00 AM AND UNTIL 8:00 AM AND 4:30 TO 6:30 PM MONDAY THROUGH FRIDAY.
- ALL TRAFFIC CONTROL SHALL COMPLY WITH THE LATEST EDITION OF THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES.
- ALL FLAGGING OPERATIONS WITHIN THE TOZ ROW REQUIRE QUALIFIED AND TRAINED WORK ZONE FLAGGERS. THE CONTRACTOR SHALL PROVIDE ALL BARRICADES, SIGNS, ETC., TO PROTECT AND SECURE THE CONSTRUCTION AREA, EQUIPMENT, AND MATERIALS FROM THE PUBLIC.
- ALL EXISTING ROADWAYS, DRIVEWAYS, CURB AND GUTTER, SIDEWALK, SIGNAGE OR DRAINAGE STRUCTURES THAT ARE DAMAGED DURING THE CONSTRUCTION SHALL BE REPAIRED TO ORIGINAL CONDITION. THE CONTRACTOR SHALL KEEP THE ROADWAY CLEAN OF DIRT AND DEBRIS AT ALL TIMES THROUGHOUT THE DURATION OF THE PROJECT. EXCAVATION MATERIAL SHALL NOT BE PLACED ON THE ROADWAY AT ANY TIME. EXCAVATIONS SHALL NOT BE LEFT OPEN OR UNSAFE DURING OVERNIGHT HOURS.
- AT THE END OF EACH WORKING DAY, EQUIPMENT SHALL BE PARKED A MINIMUM OF 15' FROM THE BACK OF THE CURB TO ENSURE SAFETY OF THE VEHICLE TRAFFIC.
- IT SHALL BE THE RESPONSIBILITY OF THE CONTRACTOR TO DETERMINE THE LOCATION OF OTHER UTILITIES WITHIN THE PROJECT SCOPE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR NOTIFYING OTHER UTILITIES OWNERS AND PROVIDE PROTECTION AND SAFEGUARDS TO PREVENT DAMAGE OF INTERRUPTION TO EXISTING FACILITIES AND TO MAINTAIN ACCESSIBILITY TO EXISTING UTILITIES.
- CONTRACTOR SHALL CONTRACT JASON BROWN AT 919-795-5640 WITH THE TOWN OF ZEBULON TO SCHEDULE A PRE-CONSTRUCTION MEETING PRIOR TO BEGINNING CONSTRUCTION. CONTRACTOR SHALL PROVIDE A MINIMUM OF 72 HOURS OF NOTICE TO THE TOWN PRIOR TO BEGINNING CONSTRUCTION.
- ALL ROADWAY, GREENWAY, SIDEWALK AND STORM DRAINAGE IMPROVEMENTS IN ROW OR DEDICATED PUBLIC EASEMENTS WILL BE REQUIRED TO BE DEDICATED TO THE TOWN OF ZEBULON AT COMPLETION OF THE PROJECT.
- AS-BUILT SITE PLANS FOR ROADWAY, GREENWAY AND UTILITY WORK MUST BE SUBMITTED AND APPROVED PRIOR TO FINAL ACCEPTANCE. CONTRACTOR IS RESPONSIBLE FOR MAINTAINING REDLINE LINE DRAWINGS.
- DEVELOPER/OWNER IS RESPONSIBLE FOR CONTRACTING WITH THIRD PARTY NCDOT CERTIFIED TESTING FIRM. TOWN OF ZEBULON MUST APPROVE THE FIRM IN ADVANCE. MATERIAL TESTING IS REQUIRED FOR ALL ROADWAY AND GREENWAY TRAIL WORK. FINAL REPORTING AND SEALED CERTIFICATION IS REQUIRED AT COMPLETION OF THE PROJECT BY THE GEO-TECHNICAL ENGINEER. TESTING IS REQUIRED FOR SUBGRADE, ROADWAY/GREENWAY STONE, AND ASPHALT, CURB, AND GUTTER PER TOWN OF ZEBULON SPECS.
- AT THE COMPLETION OF THE PROJECT, THE DEVELOPER SHALL PROVIDE THE TOWN A ONE-YEAR WARRANTY ON ALL IMPROVEMENTS DEDICATED TO THE TOWN OF ZEBULON.

**TOWN OF ZEBULON STANDARD CONSTRUCTION NOTES:
CONCRETE**

- ALL DEDICATED CONCRETE SIDEWALK REQUIRES CONCRETE TESTING FOR THE FOLLOWING REQUIREMENTS - SECTION 2.1.1
- 4" CONCRETE SLUMP
- TEMPERATURE - 50 AND 90 DEGREES
- AIR MIXTURE RANGE 3.5% TO 6.5%
- STRUCTURAL STRENGTH BREAK TEST - 7, 14, 28 DAYS @ 3000 PSI @ 28 DAYS
- SAMPLES EVERY 1000 LF OF CURB AND GUTTER TO ENSURE QUALITY
- MAX WATER -CEMENT RATIO BY WEIGHT: 0.594
- MINIMUM CEMENT CONTENT (LBS/CY): 602
- CONCRETE SIDEWALK TESTING IS NOT REQUIRED, UNLESS CONSTRUCTION INSPECTOR DETERMINES THAT THE QUALITY IS INFERIOR AND DOES NOT MEET INDUSTRY STANDARDS. CONTRACTOR MUST MAINTAIN A 4-INCH SLUMP FOR ALL SIDEWALK WORK. AIR TEMPERATURES AT PLACEMENT MUST BE 40 DEGREES AND RISING. SURFACE TEMPERATURES SHALL BE 50 DEGREES OR GREATER. (SECTION 2.2.2 E)

**TOWN OF ZEBULON STANDARD CONSTRUCTION NOTES:
STORM DRAINAGE INFRASTRUCTURE**



- ALL STORMWATER SYSTEM DRAINAGE WILL BE OWNED AND MAINTAINED BY THE PROPERTY OWNER LESS THE AREA IS IN A PUBLIC DEDICATED DRAINAGE EASEMENT

**TOWN OF ZEBULON STANDARD CONSTRUCTION NOTES:
ROADWAY/GREENWAY SUBGRADE, ROADWAY ABC AND ASPHALT**

- ROADWAY/GREENWAY SUB-GRADE: THE BASE SOIL ELEVATION DETERMINED BY APPROVED ENGINEERED DRAWINGS PRIOR TO PLACEMENT OF ROADWAY ABC AND ASPHALT.
- ROADWAY/GREENWAY STONE GRADE: THE APPROVED COMPACTED ROADWAY SUB-GRADE PLUS THE COMPACTED STONE GRADE PRIOR TO PLACEMENT OF ASPHALT.
- IN ALL CASES, THE ROADWAY/GREENWAY SUB-GRADE MUST PASS A PROOF-ROLL TEST BEFORE PLACEMENT OF STONE. THE DEVELOPER/OWNER/CONTRACTOR SHOULD PROVIDE THIRD PARTY NCDOT CERTIFIED GEOTECHNICAL FIRM TO PERFORM DENSITY TESTING OF SUB-GRADE EVERY 300 FEET AND ROADWAY/GREENWAY ABC EVERY 150 FEET VIA A NUCLEAR GAUGE. THE TOWN OF ZEBULON CONSTRUCTION INSPECTOR WILL SELECT VARIOUS LOCATIONS OF THE DENSITY TESTING. IT IS RECOMMENDED THAT TESTING BE PERFORMED AT FILL LOCATIONS OR UTILITY CUTS. A TOWN OF ZEBULON CONSTRUCTION INSPECTOR MUST BE PRESENT DURING ALL TESTING. ALL TEST RESULTS SHALL BE SUBMITTED TO AND APPROVED BY THE TOWN OF ZEBULON PUBLIC WORKS DIRECTOR BEFORE ROADWAY STONE IS INSTALLED.
- PROOF ROLL STANDARD- A FULLY LOADED DUMP TRUCK/MOTOR GRADER THAT HAS A MINIMUM GROSS WEIGHT OF AT LEAST 40,000 POUNDS (20 TONS) UNDER THE OBSERVATION OF THE TOWN OF ZEBULON REPRESENTATIVE. NO OTHER METHOD WILL BE ACCEPTED. ALL AREAS OF THE ROADWAY/GREENWAY SUB-GRADE OR ROADWAY STONE SHALL BE COVERED BY THE WHEELS OF THE PROOF-ROLLER OPERATING AT WALKING SPEED (TWO TO THREE MILES PER HOUR) OR 225 TO 300 FEET PER MINUTE.
- IT IS THE CONTRACTOR RESPONSIBILITY TO PROTECT ALL STRUCTURAL FACILITIES ON THE PROJECT SUCH AS BRIDGES, BOX CULVERTS, PIPE CULVERTS, AND UTILITIES FROM DAMAGE FROM PROOF ROLLING EQUIPMENT.
- PROOF ROLLS ARE REQUIRED AT THE ROADWAY/GREENWAY SUB-GRADE CONSTRUCTION PHASE AND ROADWAY/GREENWAY STONE CONSTRUCTION PHASE
- ANY AND ALL AREAS, WHICH RUT OR PUMP EXCESSIVELY UNDER THE WHEELS OF THE PROOF-ROLLER SHALL BE REPAIRED BY THE DEVELOPER/CONTRACTOR BEFORE ROADWAY STONE OR ASPHALT IS INSTALLED
- PROOF ROLL AREAS AGAIN FOLLOWING THE COMPLETION OF THE NECESSARY CORRECTIONS. ALL COST ASSOCIATED WITH THE PROOF ROLLING PROCESS IS THE RESPONSIBILITY OF DEVELOPER/OWNER OR CONTRACTOR
- THE TOWN SHALL NOT BE RESPONSIBLE FOR ENSURING PROPER GRADES AND ALIGNMENT OF ROADWAY/GREENWAY AND CURB AND GUTTER. IF THE ALIGNMENT AND GRADES ARE INCORRECT, IT WILL BE THE RESPONSIBILITY OF THE CONTRACTOR/DEVELOPER/OWNER TO MAKE CORRECTIVE REPAIRS AT THEIR OWN EXPENSE.
- REQUIREMENTS: 98% STANDARD PROCTOR ON ALL SOILS EVERY 300'. ALL LOCATIONS TESTED SHALL MEET THE 98% TESTING REQUIREMENTS. AVERAGING OF DENSITY SCORES TO MEET STANDARD IS NOT ALLOWED.
- SUCCESSFUL PROOF-ROLLS REQUIRED FOR ALL SUB-GRADE SOILS. ALL ROADWAY SUBGRADE MUST PASS A PROOF-ROLL TEST (NO EXCEPTIONS).
- ROADWAY/GREENWAY SUB GRADE THAT DOES NOT PASS THE PROOF ROLL TEST OR DENSITY TEST WILL REQUIRE REMEDIAL REPAIRS. REPAIR RECOMMENDATIONS FROM GEO-TECHNICAL FIRM CAN BE MADE BY USING SEVERAL METHODS INCLUDING THE USE OF GEO-GRID/STABILIZATION FABRIC AND ADDITIONAL ABC STONE, CEMENT STABILIZATION, LIME STABILIZATION OR REPLACEMENT OF UNSUITABLE SOILS WITH DRIER/MORE SUITABLE SOILS. REGARDLESS OF THE METHOD CHOSEN BY THE CONTRACTOR, GEOTECHNICAL FIRM, DEVELOPER OR OWNER FOR REMEDIAL REPAIRS; A SUCCESSFUL PROOF-ROLL MUST BE OBTAINED PRIOR TO PLACEMENT OF ABC STONE CAN BEGIN.
- REPAIRS WERE MADE TO THE ROADWAY/GREENWAY SUB GRADE INVOLVE USING GEO-GRID/STABILIZATION FABRIC AND ADDITIONAL STONE; NO DENSITY ADDITIONAL TESTING IS REQUIRED. IF REPAIRS TO THE ROADWAY SUB GRADE INVOLVE UNDERCUTTING UNSUITABLE SOILS AND REPLACEMENT WITH OTHER SOILS THAT ARE MORE SUITABLE THEN DENSITY TESTING IS REQUIRED TO VERIFY COMPLIANCE OF 98% COMPACTION REQUIREMENT. THE CONTRACTOR/GEO-TECHNICAL FIRM MUST PROVIDE THE TOWN OF ZEBULON INSPECTOR WITH DENSITY TEST RESULTS PRIOR TO PLACEMENT OF ABC STONE WERE REQUIRED. ALL COST OF DENSITY TESTING SHALL BE BY THE DEVELOPER OR OWNER.
- NOTE: IF THE ROADWAY/GREENWAY SUB-GRADE IS EXPOSED TO PRECIPITATION (RAIN, SNOW, ICE, ETC.) GREATER THAN A 1/10 OF INCH BEFORE IT IS COVERED WITH ABC STONE, THE EXPOSED SUB-GRADE MUST PASS AN ADDITIONAL PROOFROLL. ADDITIONAL DENSITY TESTING IS NOT REQUIRED UNDER THESE CONDITIONS.
- REQUIREMENTS: 98% STANDARD PROCTOR ON ALL ROADWAY/GREENWAY ABC EVERY 150'. ALL LOCATIONS TESTED SHALL MEET THE 98% TESTING REQUIREMENTS. AVERAGING OF DENSITY SCORES TO MEET STANDARD IS NOT ALLOWED. SUCCESSFUL PROOF-ROLLS REQUIRED FOR ALL ROADWAY/GREENWAY ABC STONE.
- ROADWAY/GREENWAY ABC STONE MUST BE INSTALLED PER TOWN OF ZEBULON MINIMUM REQUIREMENTS AND/OR APPROVED ENGINEERING ROADWAY DRAWINGS. ROADWAY ABC STONE SHALL BE INSTALLED IN COMPACTED LIFTS PER MANUFACTURE EQUIPMENT RECOMMENDATIONS. A MINIMUM OF SIX INCHES OF COMPACTED ABC STONE SHALL BE INSTALLED UNDER CURB AND GUTTER. ALL ROADWAYS WILL HAVE A MINIMUM OF EIGHT INCHES OF COMPACTED ABC STONE. THE PLACEMENT OF ROADWAY ABC STONE IS REQUIRED TO PASS A PROOFROLL AND PASS DENSITY TESTING OF 98% MINIMUM EVERY 150' FEET. THE ZEBULON CONSTRUCTION INSPECTOR MUST HAVE DENSITY TESTING RESULTS PRIOR TO START OF PAVING. THE ROADWAY STONE CROSS-SLOPE, FROM CROWN TO CURB, SHALL BE CHECKED WITH A STRING LINE PRIOR TO THE PLACEMENT OF ASPHALT.
- THE ROADWAY/GREENWAY STONE SHALL BE PROOF ROLLED JUST PRIOR TO THE PLACEMENT OF ASPHALT. IF A SECTION OF ROADWAY FAILS PRIOR TO PLACEMENT OF ASPHALT AFTER ALL OTHER SUCCESSFUL TESTS; ADDITIONAL ASPHALT AT THE DIRECTION OF THE CONSTRUCTION INSPECTOR MAY BE ALLOWED. ONE INCH OF ASPHALT MAY BE SUBSTITUTED FOR EVERY TWO INCHES OF STONE.
- NOTE: IF THE ROADWAY/GREENWAY ABC IS EXPOSED TO PRECIPITATION (RAIN, SNOW, ICE, ETC.) GREATER THAN 1/10 INCH BEFORE IT IS COVERED WITH ABC STONE, THE EXPOSED SUB-GRADE MUST PASS AN ADDITIONAL PROOF-ROLL. ADDITIONAL DENSITY TESTING IS NOT REQUIRED UNDER THESE CONDITIONS.
- ASPHALT PLACEMENT SHOULD BE IN ACCORDANCE WITH ENGINEERING DRAWINGS, SIGNED AND SEALED BY A LICENSED NORTH CAROLINA PROFESSIONAL ENGINEER. THE CONTRACTOR SHALL INSTALL ASPHALT IN MULTIPLE LAYERS/LIFTS. THE FINAL 1" OR 1.5" OVERLAY WILL BE AT THE 80% BUILDING PERMIT LEVEL FOR EACH PHASE OR AT THE DIRECTION OF THE PUBLIC WORKS DIRECTOR. ASPHALT CORES WILL BE TAKEN AT BOTH OVERLAYS TO INSURE COMPLIANCE WITH ENGINEERING DRAWINGS FOR THICKNESS AND DENSITY.

Mix Type	Single Lift Depths - min/max	Max layer total depths	Density
SF4.75A	0.5-1.0 inches	2" Depth	85%
SF9.5C & D	1.5-2.0 inches	3" Depth	92%
SF9.5B	1.0-1.5 inches	3" Depth	90%
I-19.0C	2.5-4.0 inches	4" Depth	92%
B25.0C	3.0-5.5 inches	No limit	92%

- ASPHALT MIXTURES SHALL NOT BE PLACED DURING RAINY WEATHER. WHEN SUBGRADE OR COURSE IS FROZEN, OR WHEN THE MOISTURE ON THE SURFACE TO BE PAVED WOULD PREVENT A PROPER BOND. ASPHALT MATERIAL MUST NOT BE PLACED WHEN THE AIR TEMPERATURE MEASURED IN THE SHADE AWAY FROM ARTIFICIAL HEAT AT THE LOCATION OF THE PAVING OPERATION AND THE ROAD SURFACE TEMPERATURE IN THE SHADE AT THE PAVING SITE IS BELOW 40 DEGREES AIR TEMPERATURE AND 50 DEGREES MINIMUM SURFACE TEMPERATURE.
- ASPHALT CORE SAMPLES SHOULD BE SELECTED EVERY 300' FEET OR MINIMUM OF TWO CORES PER ROADWAY FOR ANALYSIS OF THICKNESS AND DENSITY.
- THE CONTRACTOR IS RESPONSIBLE FOR DEVELOPING/CREATING A CHART/MAP IF THE CORED LOCATIONS FOR SUBMITTAL WITH THE TESTING. CORES WILL BE RANDOMLY TAKEN ALONG THE LONGITUDINAL DIRECTIONS ACROSS THE ROADWAY/GREENWAY BUT NOT WITHIN ONE FOOT OF THE EDGE OF PAVEMENT. THE RESULTS OF SAMPLES GREATER THAN 10 FEET APART WILL NOT BE AVERAGE AND USED TO VERIFY COMPLIANCE WITH THE TOWN OF ZEBULON SPECIFICATIONS. (SECTION 2.6.H)

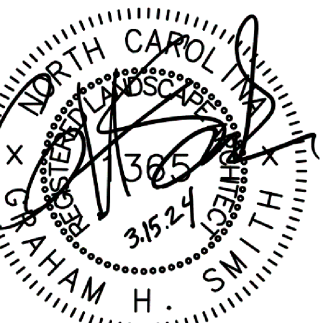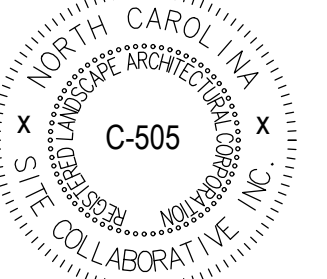

REUSE OF DOCUMENT
This document is the property of Site Collaborative Inc. The ideas and design incorporated on this document is an instrument of professional service and shall not be used for any other project without written authorization of Site Collaborative Inc.

ZEBULON ANIMAL HOSPITAL
ZAH REALTY, LLC
1620 N. ARENDELL AVE., ZEBULON, NC

PROJECT NUMBER:
22091

PROJECT PHASE:
CONSTRUCTION
DRAWINGS
DATE: 10.02.2023
REVISED: 11.20.2023
REVISED: 1.5.2024
REVISED: 2.1.2024
3.4.2024 PER NCDOT
REVISED: 3.15.2024
REVISED: 6.4.2024

SHEET TITLE:
ZONING
CONDITIONS &
TOWN OF ZEBULON
STANDARD NOTES

SHEET NUMBER:

EXISTING CONDITIONS LEGEND	
KEY	DESCRIPTION
— W — W —	EXISTING WATERLINE
— SS —	EXISTING SANITARY SEWER
— — — — —	EXISTING OVERHEAD ELECTRIC
— G — G —	EXISTING GAS MAIN
— — — — —	EXISTING STORM SEWER
⊗	EXISTING FIRE HYDRANT
⊗	EXISTING WATER VALVE


EXISTING CONDITIONS NOTES


- EXISTING CONDITIONS SURVEY PROVIDED BY CMP PROFESSIONAL LAND SURVEYORS, WAKE FOREST, NC. DATED MARCH 22, 2023.
- PROJECT PROPERTY DOES NOT LIE WITHIN A SPECIAL FLOOD HAZARD AREA AS REFERENCED BY FEMA FLOOD INSURANCE RATE MAP NO. 3720179600K, EFFECTIVE DATE JULY 19, 2022.
- CONTRACTOR SHALL VERIFY EXISTING CONDITIONS AND NOTIFY LANDSCAPE ARCHITECT OF ANY DISCREPANCIES PRIOR TO CONSTRUCTION.

DEMOLITION LEGEND	
KEY	DESCRIPTION
	EXISTING ASPHALT AND SUBBASE TO BE REMOVED
	EXISTING DRIVEWAY AND SUBBASE TO BE REMOVED
	EXISTING STRUCTURE AND FOUNDATION TO BE REMOVED
⊗	EXISTING TREE OR SHRUB TO BE REMOVED. GRIND STUMP TO 12" BELOW GRADE.
— TP —	TREE PROTECTION FENCE
— LOD — LOD —	LIMITS OF DISTURBANCE

DEMOLITION NOTES

- THE CONTRACTOR SHALL NOTIFY THE N.C. ONE CALL CENTER AT 811 OR 1-800-632-4949 PRIOR TO STARTING WORK.
- THE CONTRACTOR SHALL NOTIFY THE LOCAL GOVERNING PUBLIC UTILITIES DEPARTMENT PRIOR TO STARTING WORK.
- ALL DEMOLITION, AND ANY SUBSEQUENT CONSTRUCTION, SHALL BE PERFORMED IN ACCORDANCE WITH THESE PLANS AND SPECIFICATIONS SET FORTH AND APPROVED BY THE LOCAL GOVERNING MUNICIPALITY OR THE STATE. THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL REQUIRED PERMITS.
- THE CONTRACTOR SHALL NOT MAKE ANY LANE CLOSURES OR CHANGES TO THE EXISTING TRAVEL PATTERNS ON ANY PUBLIC STREET WITHOUT PRIOR APPROVAL FROM THE LOCAL GOVERNING MUNICIPALITY TRANSPORTATION DEPARTMENT AND/OR STATE TRANSPORTATION DEPARTMENT.
- LANE CLOSURE, TRAFFIC CONTROL PLAN, OR PEDESTRIAN CONTROL PLAN TO BE COORDINATED WITH APPROPRIATE STAFF OF THE LOCAL GOVERNING MUNICIPALITY AND/OR STATE DEPARTMENT OF TRANSPORTATION PRIOR TO ANY CONSTRUCTION IN PUBLIC RIGHT-OF-WAY.
- THE CONTRACTOR IS RESPONSIBLE FOR CONFORMING TO ALL LOCAL, STATE AND FEDERAL REQUIREMENTS REGARDING REMOVAL AND DISPOSAL OF MATERIALS AND DEBRIS.
- CONTRACTOR SHALL REFER TO CIVIL SHEETS FOR SANITARY SEWER AND WATER REMOVALS AND RELOCATIONS.
- RELOCATION OF EXISTING UTILITIES TO BE COORDINATED WITH THE LOCAL UTILITY PROVIDER(S).
- WHERE UTILITIES (TO BE REMOVED) IMPACT THE FOOTPRINT OF THE NEW BUILDING, CONTRACTOR SHALL EXCAVATE AND REMOVE AN ADDITIONAL 2 FEET OF SOILS TO EITHER SIDE OF PIPE, AND 1 FOOT BELOW TO REMOVE UNSUITABLE SOILS, IF UNSUITABLE SOILS EXIST.
- CLEANOUTS LOCATED IN AREAS OF DEMOLITION OR SUBSEQUENT CONSTRUCTION THAT ARE TO REMAIN, SHALL BE PROTECTED FROM DAMAGE AND RAISED TO FLUSH WITH NEW GRADE.
- ELECTRICAL OR GAS UTILITY SERVICES TO BE REMOVED SHALL BE REMOVED AND RELOCATED (AS INDICATED) BY THE UTILITY PROVIDER. CONTRACTOR SHALL SCHEDULE AND COORDINATE THIS WORK WITH THE APPROPRIATE SERVICE PROVIDER. ALL SERVICES SHOULD BE RE-INSTALLED PRIOR TO THE INSTALLATION OF PAVEMENT, SIDEWALKS, CURB AND GUTTER, OR OTHER PERMANENT FEATURES.
- REMOVE EXISTING CONCRETE (WHERE REQUESTED) TO FIRST COLD JOINT OR SAWCUT JOINT TO OBTAIN A CLEAN EDGE FOR NEW CONSTRUCTION. SAWCUT EXISTING ASPHALT DRIVE AT LIMITS OF NEW CURBING TO OBTAIN A CLEAN EDGE.
- CONTRACTOR SHALL RESTORE THE LAYDOWN AND STAGING AREA TO ORIGINAL CONDITIONS AND TO THE SATISFACTION OF THE OWNER, PRIOR TO DEMOBILIZATION AT THE CONCLUSION OF THE PROJECT.
- CLEAN SOILS SHALL BE UTILIZED FOR BACKFILL. COMPACTION OF THESE SOILS PERFORMED IN ACCORDANCE WITH SPECIFICATIONS, GEOTECHNICAL REPORT, AND SITE PLAN.
- ALL FENCING TO BE REMOVED SHALL BE REMOVED AT NEXT NEAREST POLE.
- ALL GRAVEL TO BE REMOVED (SURFACE OR SUBSURFACE) SHALL BE STOCKPILED AND REUSED ON SITE WHERE POSSIBLE.
- ALL ITEMS DESIGNATED TO BE REMOVED SHALL BE REMOVED COMPLETELY, INCLUDING ALL SUBGRADE MATERIALS DIRECTLY ASSOCIATED WITH ITEMS TO BE REMOVED.
- ALL ITEMS DESIGNATED TO BE REMOVED SHALL BE DISPOSED OF LEGALLY OFFSITE UNLESS OTHERWISE NOTED ON THIS PLAN.
- ALL TREES TO BE REMOVED SHALL BE GROUND DOWN TO A MINIMUM DEPTH OF 12" BELOW PROPOSED FINISH GRADE.
- ALL TREE PROTECTION FENCING SHALL REMAIN IN PLACE DURING DEMOLITION AND CONSTRUCTION.
- CONTRACTOR SHALL NOT STOCKPILE SOILS OR CONSTRUCTION EQUIPMENT WITHIN ROOT ZONES OF EXISTING TREES TO REMAIN. ANY DAMAGED TREES SHALL BE REPLACED AT CONTRACTOR'S EXPENSE.

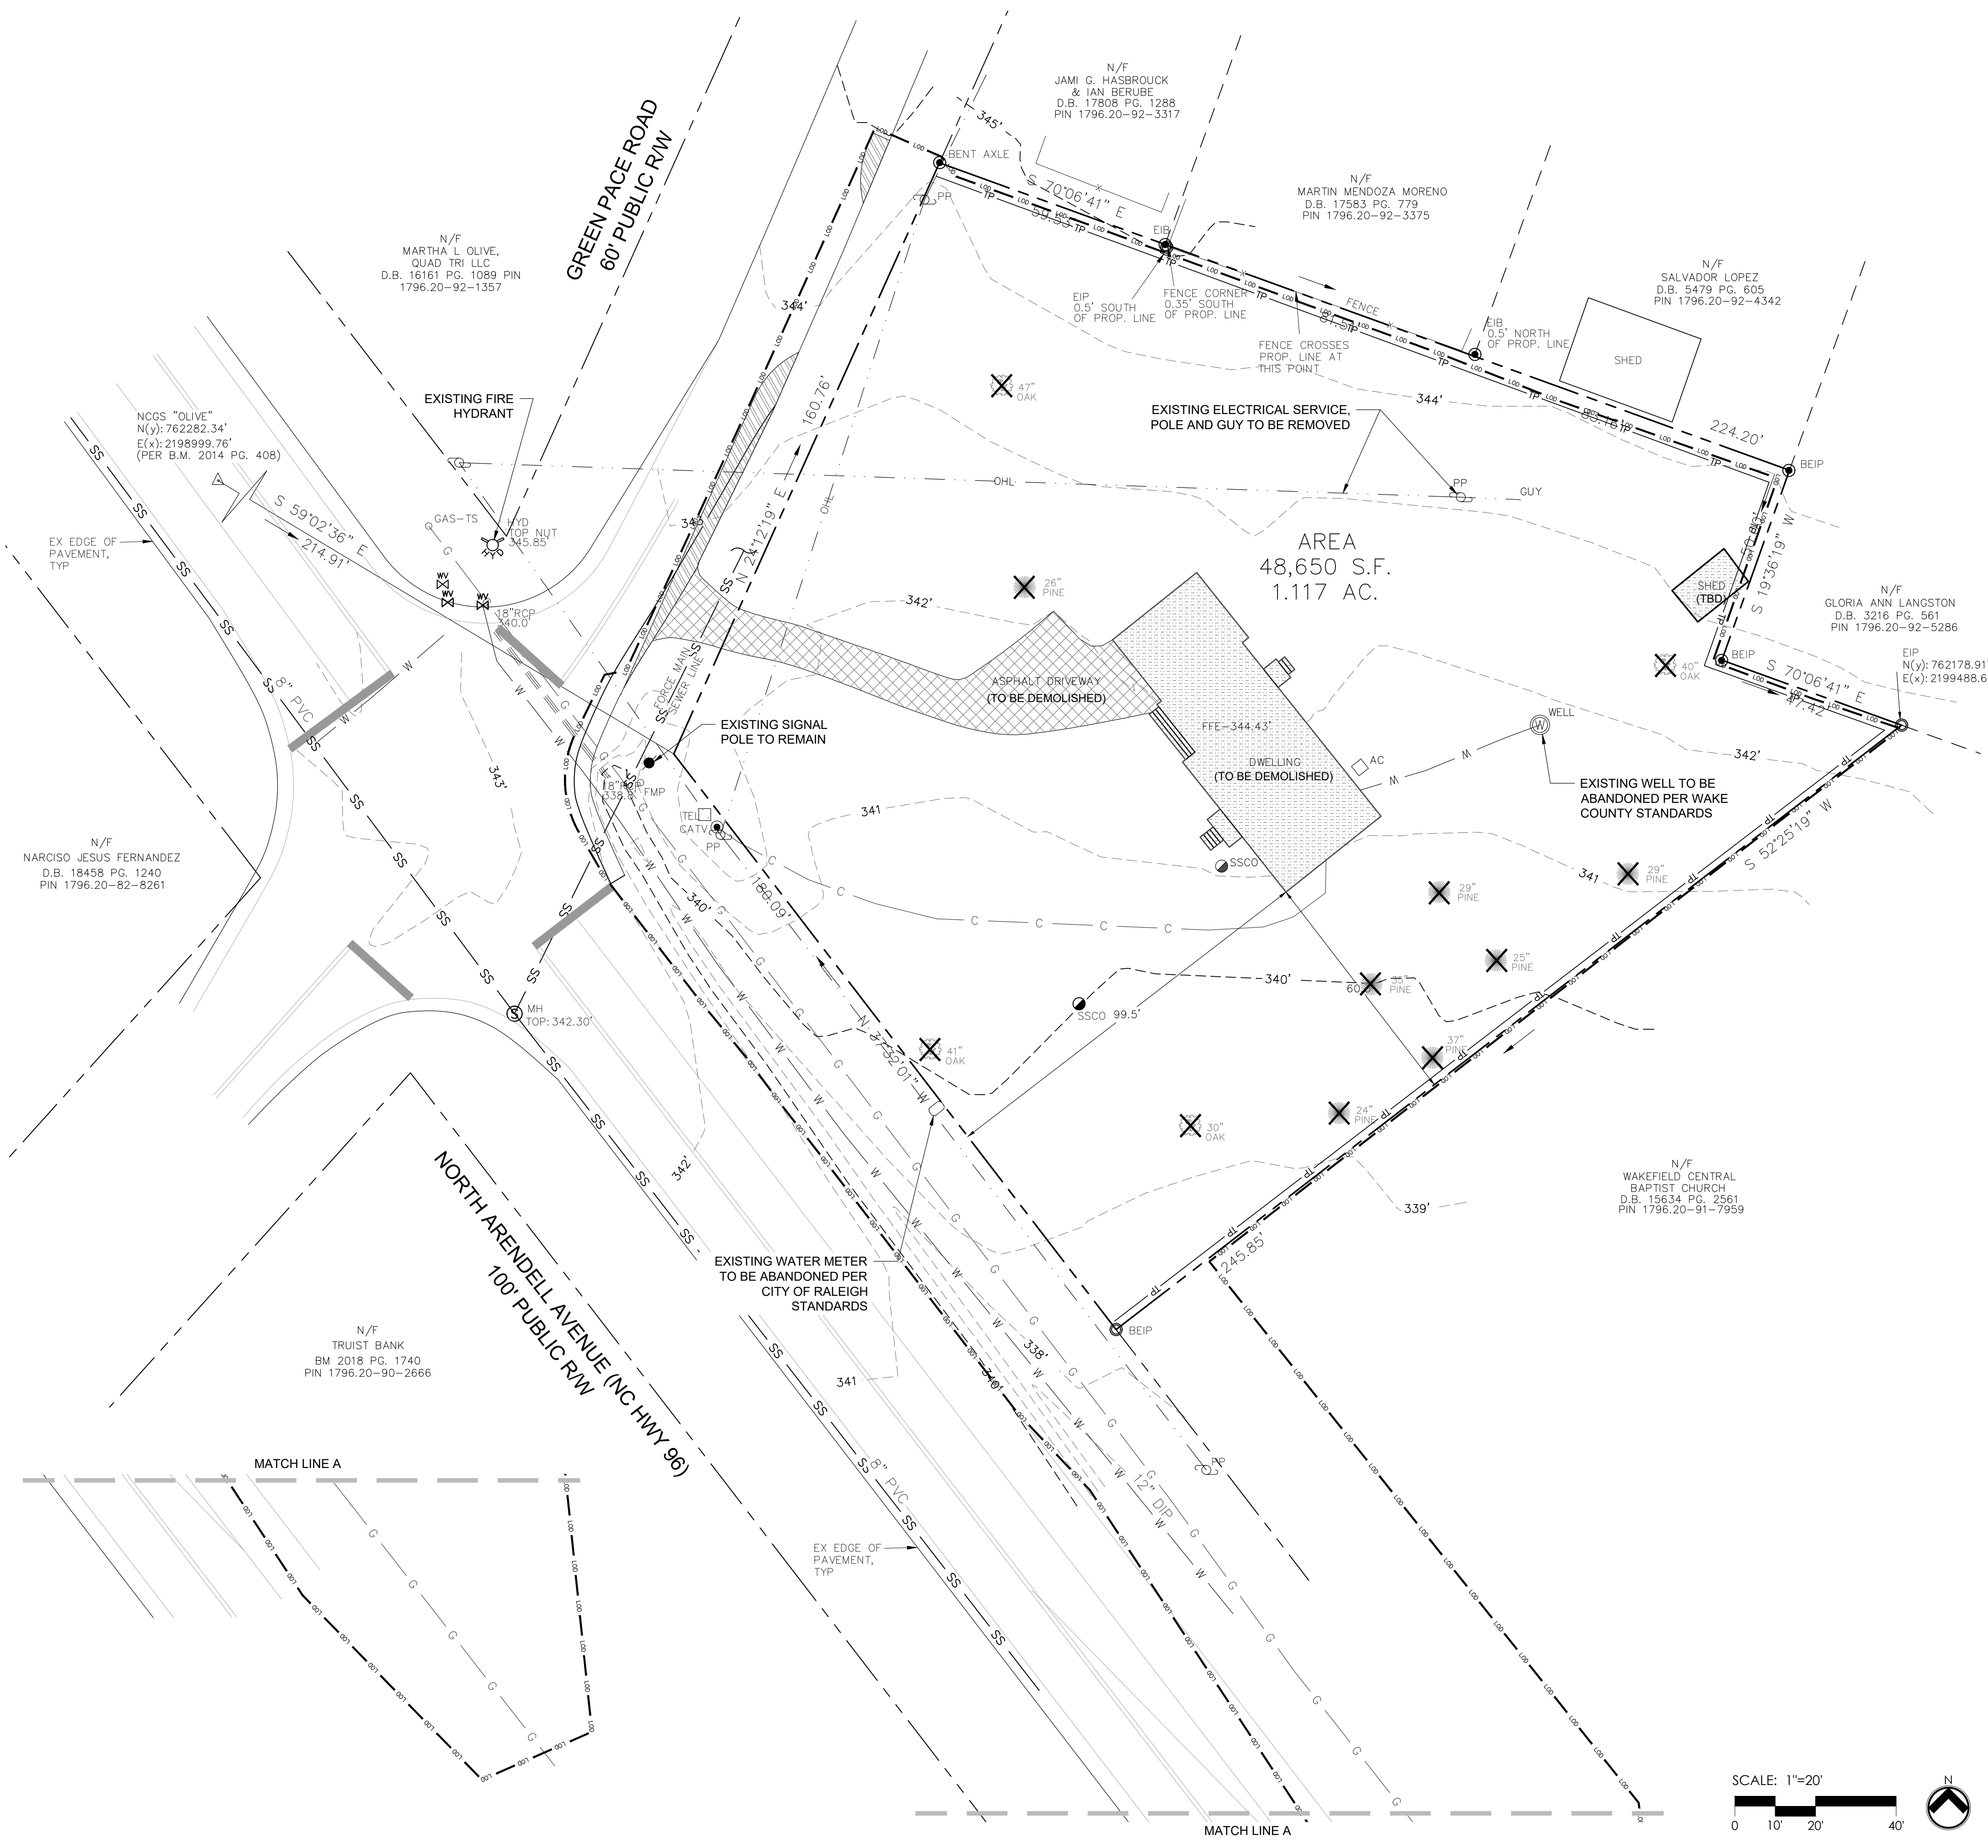

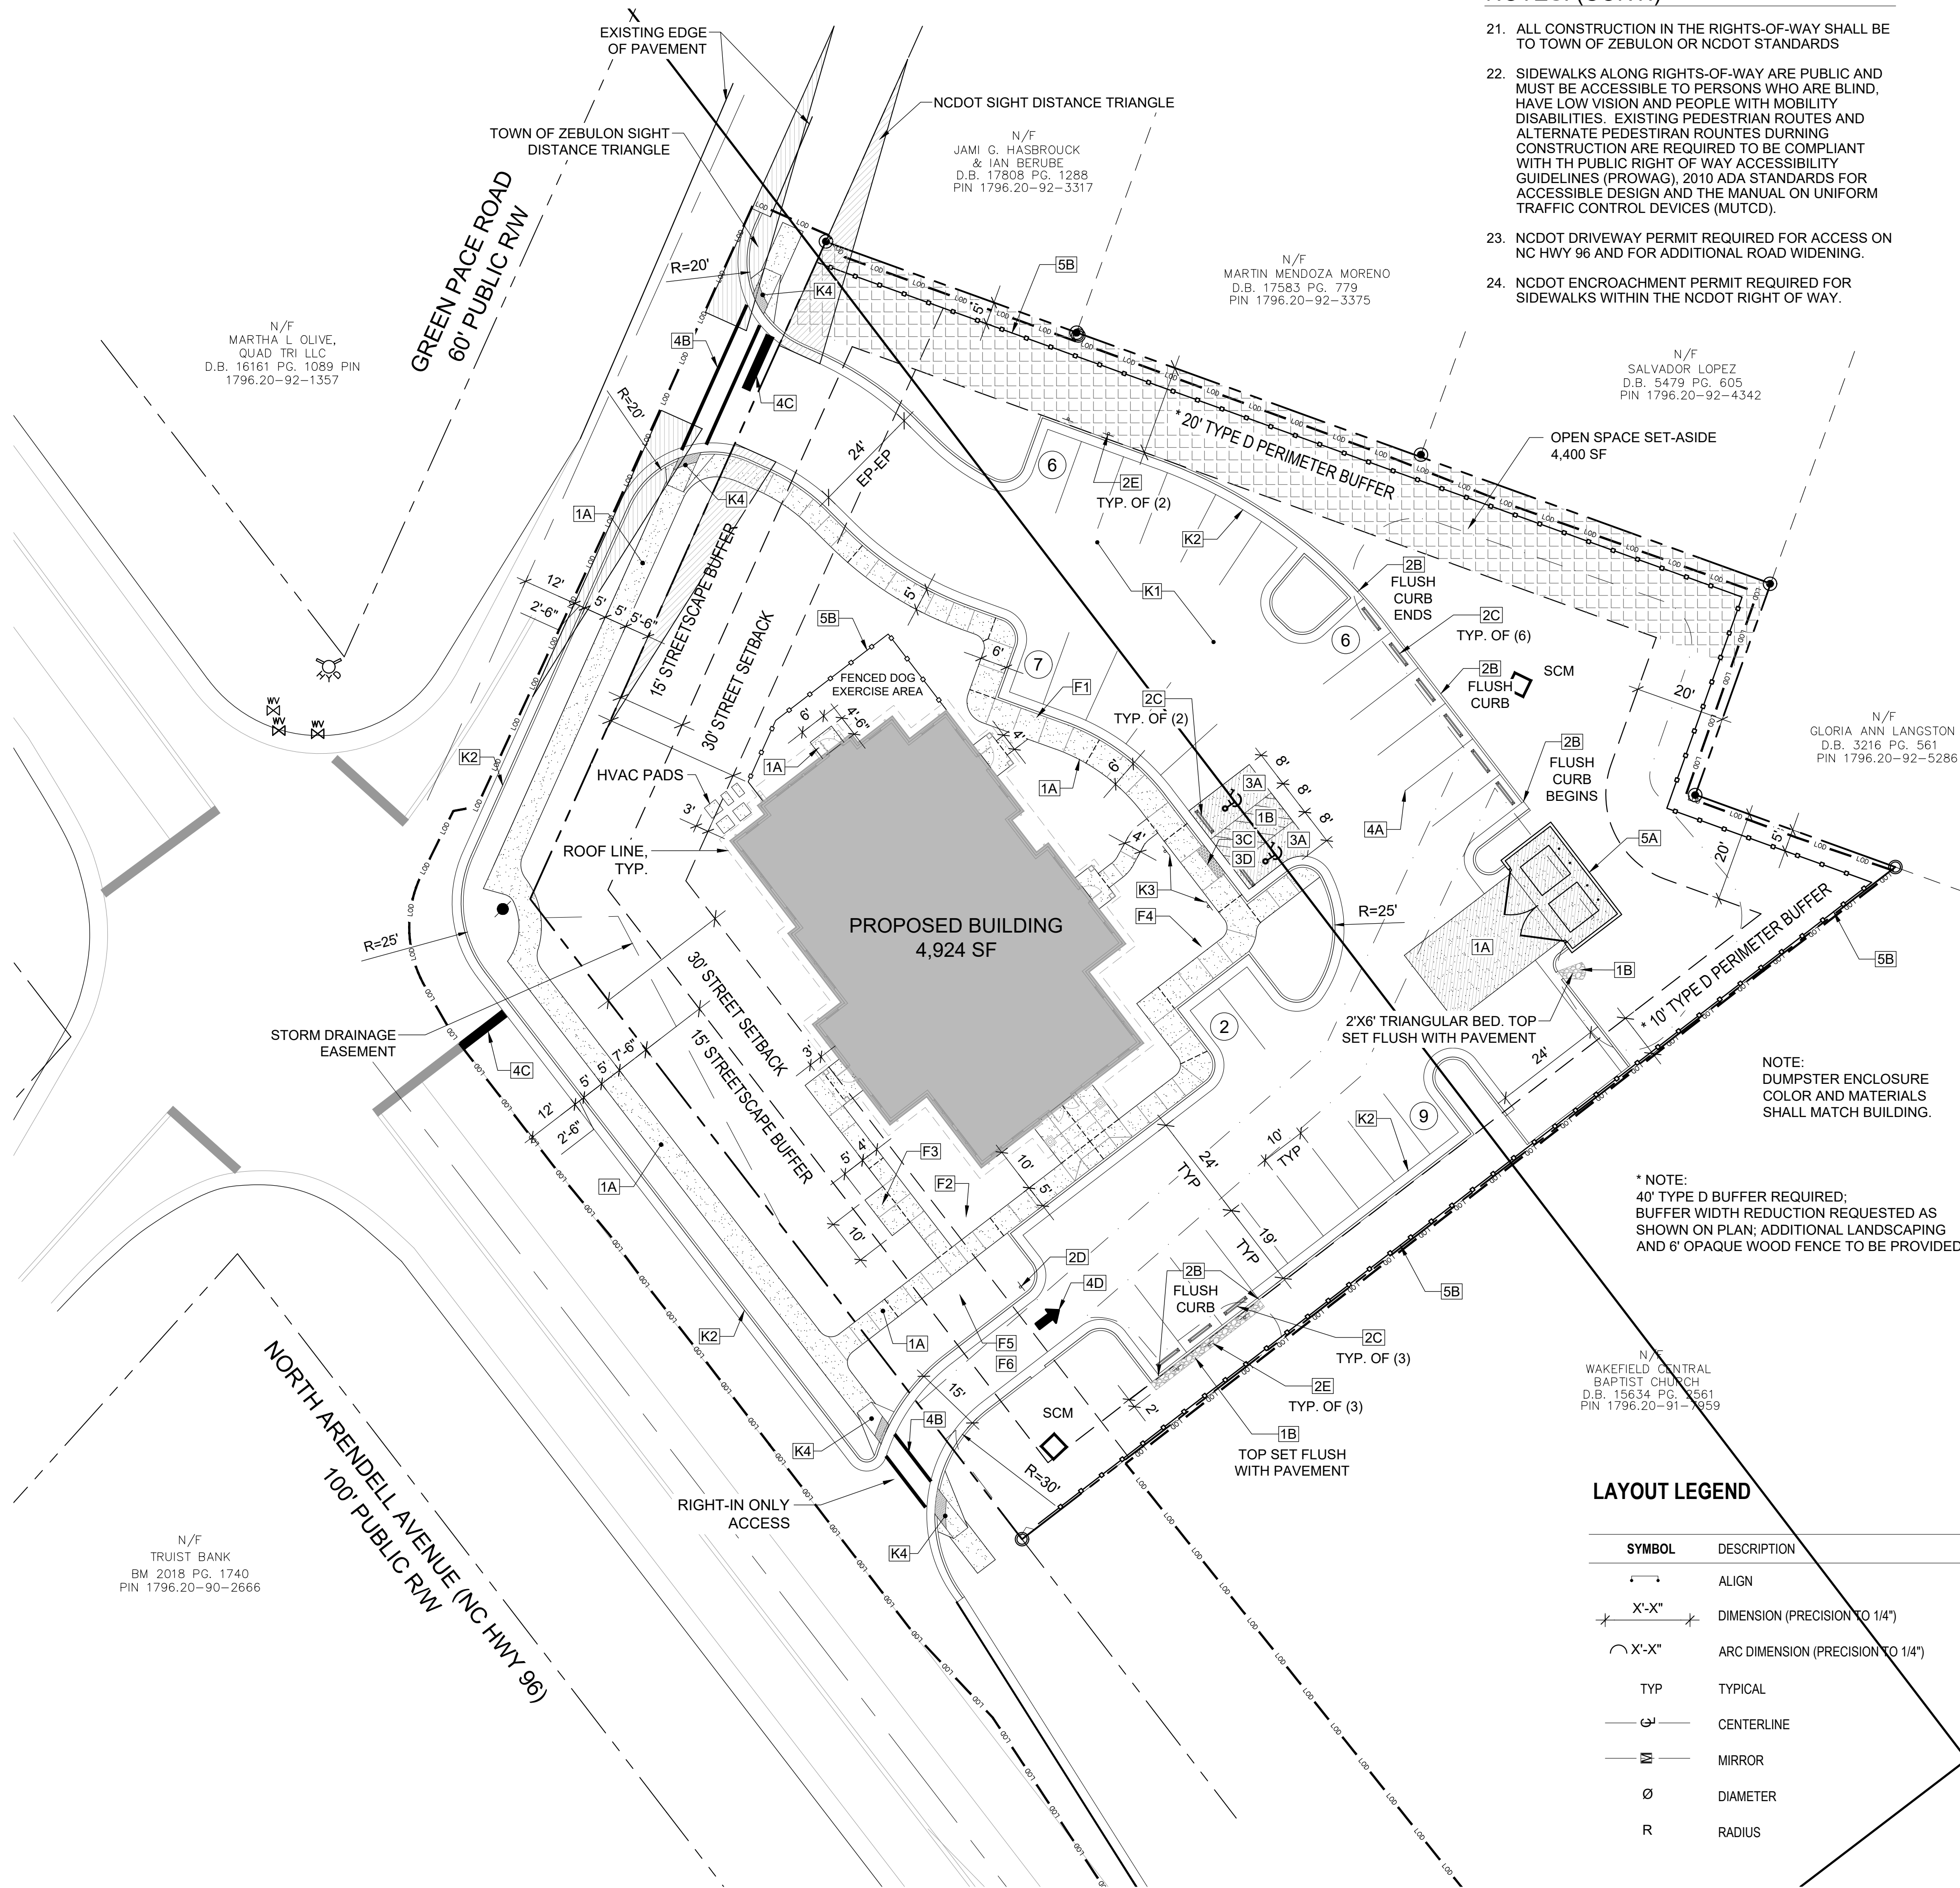

NOTES: (CONT.)

- ALL CONSTRUCTION IN THE RIGHTS-OF-WAY SHALL BE TO TOWN OF ZEBULON OR NCDOT STANDARDS
- SIDEWALKS ALONG RIGHTS-OF-WAY ARE PUBLIC AND MUST BE ACCESSIBLE TO PERSONS WHO ARE BLIND, HAVE LOW VISION AND PEOPLE WITH MOBILITY DISABILITIES. EXISTING PEDESTRIAN ROUTES AND ALTERNATE PEDESTRIAN ROUTES DURING CONSTRUCTION ARE REQUIRED TO BE COMPLIANT WITH THE PUBLIC RIGHT OF WAY ACCESSIBILITY GUIDELINES (PROWAG), 2010 ADA STANDARDS FOR ACCESSIBLE DESIGN AND THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD).
- NCDOT DRIVEWAY PERMIT REQUIRED FOR ACCESS ON NC HWY 96 AND FOR ADDITIONAL ROAD WIDENING.
- NCDOT ENCROACHMENT PERMIT REQUIRED FOR SIDEWALKS WITHIN THE NCDOT RIGHT OF WAY.

GENERAL SITE NOTES

- ALL PAVEMENTS TO SLOPE POSITIVELY AWAY FROM ALL BUILDINGS. PONDING OF WATER IS PROHIBITED.
- ALL DIMENSIONS ARE TO BACK OF CURB OR EDGE OF SIDEWALK UNLESS OTHERWISE NOTED.
- ALL CURB RADII ARE 4'-6" AT BACK OF CURB UNLESS OTHERWISE NOTED.
- PROVIDE CONSTRUCTION JOINTS IN CONCRETE WALKWAYS AS SHOWN IN PLANS. IF NOT SHOWN ON PLANS, SCORE JOINT - MAX SPACING @ 10', EXPANSION JOINT MAX SPACING @ 50'.
- THROUGHOUT PROJECT SITE, ALL DIMENSIONS TO BE FIELD VERIFIED. NOTIFY THE LANDSCAPE ARCHITECT OF ANY DISCREPANCY. ALL DIMENSIONS ARE TO OUTSIDE FACE OF BUILDING, TO CENTERLINE, CENTER TO CENTER ON STRIPES, AND/OR FACE OF CURB, UNLESS OTHERWISE NOTED.
- THE CONTRACTOR, AT ALL TIMES, MUST KEEP THE PREMISES FREE FROM ACCUMULATIONS OF WASTE MATERIALS OR RUBBISH CAUSED BY THE CONTRACTOR, THE CONTRACTOR'S EMPLOYEES OR THE CONTRACTOR'S SUBCONTRACTOR. ALL DEBRIS SHALL BE REMOVED FROM THE PROJECT SITE ON A DAILY BASIS.
- IF DEPARTURES FROM THE DRAWINGS OR SPECIFICATIONS ARE DEEMED NECESSARY BY THE CONTRACTOR, DETAILS OF SUCH DEPARTURES FROM THE CONTRACT DOCUMENTS SHALL BE MADE ONLY WITH THE EXPRESSED WRITTEN PERMISSION OF THE OWNER.
- LANDSCAPE ARCHITECT AND/OR OWNER DISCLAIM ANY ROLE IN THE CONSTRUCTION MEANS AND/OR METHODS ASSOCIATED WITH THE PROJECT AS SET FORTH IN THESE PLANS.
- EXISTING UTILITIES AND STRUCTURES SHOWN, BOTH UNDERGROUND AND ABOVE, ARE BASED ON A FIELD DATA PROVIDED TO LANDSCAPE ARCHITECT. THE CONTRACTOR SHALL LOCATE EXISTING UTILITIES, UNDERGROUND LINES, AND STRUCTURES AS NECESSARY TO AVOID DAMAGING OR DESTROYING EXISTING SERVICES.
- CONTRACTOR SHALL NOTIFY THE NORTH CAROLINA ONE CALL CENTER AT 811 OR 1-800-832-4343 PRIOR TO STARTING WORK. ALL UTILITIES SHALL BE MARKED PRIOR TO STARTING WORK.
- THE CONTRACTOR IS RESPONSIBLE FOR FIELD VERIFYING THE ACTUAL AND EXACT LOCATION, SIZE, AND MATERIAL COMPOSITION OF ANY EXISTING WATER OR SEWER SERVICE PROPOSED FOR CONNECTION OR USE ON THIS PROJECT AND FOR THE RELOCATION OF ANY UTILITY SERVICES REQUIRED TO COMPLETE ANY PORTION OF THESE CONSTRUCTION PLANS.
- CONTRACTOR SHALL MAINTAIN AN "AS BUILT" SET OF DRAWINGS TO RECORD ANY FIELD CHANGES, ALONG WITH ANY PIPING PRIOR TO CONCEALMENT. DRAWINGS SHALL BE GIVEN TO THE OWNER AT THE END OF THE PROJECT.
- THE CONTRACTOR IS RESPONSIBLE FOR OBTAINING ALL REQUIRED PERMITS. ALL CONSTRUCTION SHALL BE IN ACCORDANCE WITH PERMITS AS ISSUED, AND ANY AND ALL APPLICABLE STATE, COUNTY AND LOCAL CODES.
- EXISTING IMPROVEMENTS DAMAGED OR DESTROYED DURING CONSTRUCTION SHALL BE REPLACED OR RESTORED TO THEIR ORIGINAL CONDITION, AND TO THE SATISFACTION OF THE OWNER OF THE IMPROVEMENTS.
- THE CONTRACTOR SHALL OBTAIN AND PAY FOR ALL INSPECTIONS, CERTIFICATIONS, AND/OR ANY OTHER REQUIREMENTS WHICH MUST BE MET UNDER CONTRACT.
- CONTRACTOR SHALL REFER TO ARCHITECTURAL PLANS FOR DETAILS OF BUILDINGS AND BUILDING DIMENSIONS.
- CONTRACTOR SHALL COORDINATE CONSTRUCTION OF ALL UNDERGROUND UTILITIES FOR THIS PROJECT WITH THE OWNER'S REPRESENTATIVE PER ALL APPLICABLE REGULATIONS.
- CONTRACTOR SHALL COORDINATE WITH OTHER CONTRACTORS ON SITE AND UTILITY PROVIDERS DURING CONSTRUCTION TO ENSURE SMOOTH TRANSITION BETWEEN DISCIPLINES.
- ALL DEMOLITION, AND ANY SUBSEQUENT CONSTRUCTION, SHALL BE PERFORMED IN ACCORDANCE WITH THESE PLANS AND SPECIFICATIONS. ALL TREE PROTECTION FENCING SHALL REMAIN IN PLACE DURING CONSTRUCTION.
- THIS SITE SHALL BE FULLY COMPLIANT WITH THE CURRENT EDITION OF THE NORTH CAROLINA ACCESSIBILITY CODES (ANSI 117.1 AND CHAPTER 11 OF THE NCCBC) UNLESS AND EXCEPT IN AREAS WHERE AN APPROVED STATEMENT FROM A SITE ENGINEER, SURVEYOR OR LANDSCAPE ARCHITECT VERIFIES THAT SITE CONDITIONS EXIST WHERE THE TOPOGRAPHY OF THE SITE IS EXTREME AND ONLY ALTERNATE METHODS OF COMPLIANCE ARE POSSIBLE.




HARDSCAPE LEGEND

REFER TO SHEET L201 FOR FULL LEGEND

SYMBOL	PROPOSED SITE ITEM	DETAIL/SHEET
1A	C.I.P. CONCRETE PAVING	2/L202
1B	ROUNDED RIVER COBBLE (4"-6" DIA)	7/L202
2B	6" WIDE FLUSH CONCRETE CURB	6/L202
2C	CONCRETE WHEELSTOP	3/L202
2D	"DO NOT ENTER" SIGN	
2E	"EMPLOYEE PARKING ONLY" SIGN	
3A	ADA PARKING	1/L203
3C	ADA DETECTABLE WARNING SURFACE	2/L203
3D	ADA RAMP	4/L203
4A	4" THERMOPLASTIC PARKING STRIPE	
4B	CROSSWALK, THERMOPLASTIC PAINT	1/L204
4C	STOP BAR, THERMOPLASTIC PAINT	2/L204
4D	DIRECTIONAL ARROW, THERMOPLASTIC PAINT	
5A	DUMPSTER ENCLOSURE WITH GATE	3/L203
5B	6' HT. OPAQUE FENCE	1/L202

LAYOUT LEGEND

SYMBOL	DESCRIPTION
—	ALIGN
X'-X"	DIMENSION (PRECISION TO 1/4")
⌒ X'-X"	ARC DIMENSION (PRECISION TO 1/4")
TYP	TYPICAL
—	CENTERLINE
—	MIRROR
∅	DIAMETER
R	RADIUS

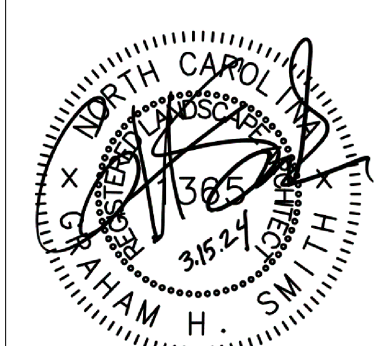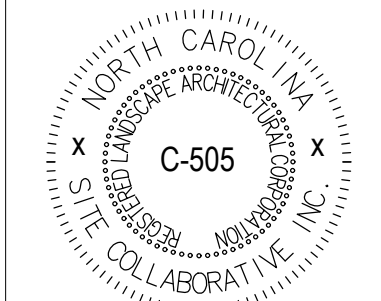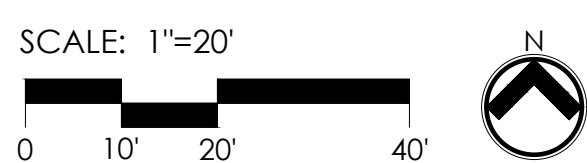

REUSE OF DOCUMENT
This document is the property of Site Collaborative Inc. The ideas and design incorporated on this document is an instrument of professional service and shall not be used for any other project without written authorization of Site Collaborative Inc.

ZEBULON ANIMAL HOSPITAL
ZAH REALTY, LLC
1620 N. ARENDELL AVE., ZEBULON, NC



PROJECT NUMBER:
22091

PROJECT PHASE:
CONSTRUCTION DRAWINGS

DATE: 10.02.2023
REVISED: 11.20.2023
REVISED: 1.5.2024
REVISED: 2.1.2024
3.4.2024 PER NCDOT
REVISED: 3.15.2024
REVISED: 6.4.2024

SHEET TITLE:
LAYOUT AND HARDSCAPE PLAN

SHEET NUMBER:
L200

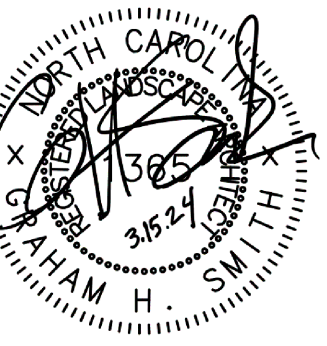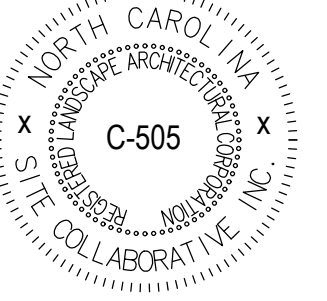

REUSE OF DOCUMENT
 This document is the property of Site Collaborative Inc. The ideas and design incorporated on this document is an instrument of professional service and shall not be used for any other project without written authorization of Site Collaborative Inc.

HARDSCAPE LEGEND

REFER TO SHEET L201 FOR FULL LEGEND

SYMBOL	PROPOSED SITE ITEM	DETAIL/SHEET	MANUFACTURER	MODEL #	COLOR	FINISH	NOTE
	1A C.I.P. CONCRETE PAVING	2/L202	LOCAL BATCH PLANT	N/A	NATURAL GRAY	MED. BROOM FINISH	
	1B ROUNDED RIVER COBBLE (4"-6" DIA)	7/L202					
	2B 6" WIDE FLUSH CONCRETE CURB	6/L202	LOCAL BATCH PLANT	N/A	NATURAL GRAY	MED. BROOM FINISH	
	2C CONCRETE WHEELSTOP	3/L202	LOCAL SUPPLIER	CODE COMPLIANT	NATURAL GRAY		
	2D "DO NOT ENTER" SIGN		LOCAL SUPPLIER	MUTCD R5-1, 18"			HIGH INTENSITY, PRISMATIC REFLECTIVE SHEETING
	2E "EMPLOYEE PARKING ONLY" SIGN		LOCAL SUPPLIER				
	3A ADA PARKING	1/L203	LOCAL SUPPLIER	CODE COMPLIANT	CODE COMPLIANT		
	3C ADA DETECTABLE WARNING SURFACE	2/L203	WASAU TILE (715.259.3121), OAE	A-90, 24" X 24"	A-90, SRI 03	TRUNCATED DOMES, ADA COMPLIANT	
	3D ADA RAMP	4/L203	LOCAL BATCH PLANT	N/A	NATURAL	MED. BROOM FINISH	
	4A 4" THERMOPLASTIC PARKING STRIPE		LOCAL SUPPLIER				
	4B CROSSWALK, THERMOPLASTIC PAINT	1/L204	LOCAL SUPPLIER				
	4C STOP BAR, THERMOPLASTIC PAINT	2/L204	LOCAL SUPPLIER				
	4D DIRECTIONAL ARROW, THERMOPLASTIC PAINT		LOCAL SUPPLIER				
	5A DUMPSTER ENCLOSURE WITH GATE	3/L203	LOCAL SUPPLIER		TO MATCH ARCHITECTURE	TBD	
	5B 6' HT. OPAQUE FENCE	1/L202	LOCAL SUPPLIER		TBD	TBD	
SYMBOL SITE FURNITURE							
	F1 2 PORT EV CHARGING STATION	1/L205	BOSCH, OAE	EL-50650-GNTD-A	N/A	N/A	INSTALLATION BY QUALIFIED LICENSED ELECTRICIAN
	F2 DECORATIVE FOUNTAIN		TBD				
	F3 CANOPY WITH PERMANENT SEATING	3/L205					
	F4 DRINKING FOUNTAIN WITH PET FOUNTAIN	4/L205	ELKAY	LK4420DB	EVERGREEN		
	F5 LITTLE FREE LIBRARY		TBD				
	F6 ALL-WEATHER BULLETIN BOARD	2/L205	PARK WAREHOUSE	ACMC31-3	GREEN		
SYMBOL BY OTHER CONSULTANTS							
	K1 ASPHALT PAVING		PER CIVIL				
	K2 STANDARD CURB & GUTTER		PER CIVIL				
	K3 HANDICAP SIGN		PER CIVIL				
	K4 SINGLE HANDICAP RAMP		PER CIVIL				
SYMBOL OTHER							
	PA PLANTING AREA						
	TYP. TYPICAL						
	EXPANSION JOINT	4/L202					
	SCORE JOINT	4/L202					
	OPEN SPACE SET-ASIDE						
	10x70' SIGHT TRIANGLE						

ZEBULON ANIMAL HOSPITAL
 ZAH REALTY, LLC
 1620 N. ARENDELL AVE., ZEBULON, NC


PROJECT NUMBER:
 22091

PROJECT PHASE:
 CONSTRUCTION
 DRAWINGS

DATE: 10.02.2023
 REVISED: 11.20.2023
 REVISED: 1.5.2024
 REVISED: 2.1.2024
 3.4.2024 PER NCDOT
 REVISED: 3.15.2024
 REVISED: 6.4.2024


SHEET TITLE:
 HARDSCAPE
 LEGEND

SHEET NUMBER:
 L201

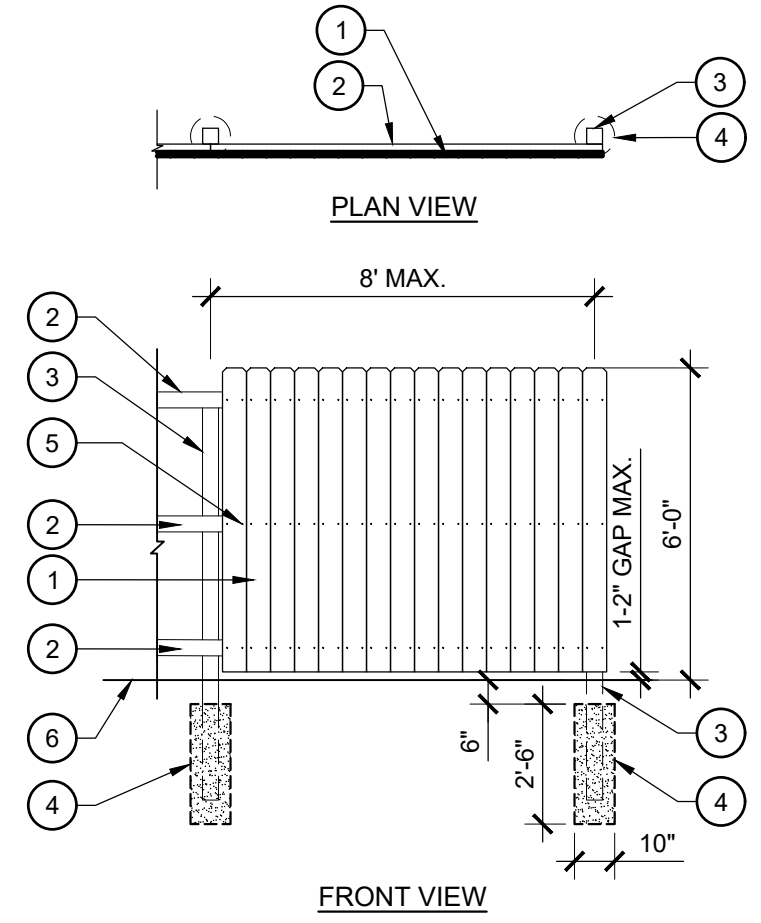


- LEGEND**
- 1" X 6" VERTICAL PICKET
 - 2" X 4" WOOD FRAMING
 - 4" X 4" WOOD POST
 - 3000 PSI CONCRETE FOOTING
 - GALVANIZED NAIL
 - FINISH GRADE
- NOTES**
- ALL LUMBER DIMENSIONS NOMINAL
 - ALL LUMBER TO BE PRESSURE TREATED.
 - INSTALL FENCE SO THAT FRONT VIEW FACES ADJACENT LOT.


1 6" OPAQUE FENCE
SCALE: 1-1/2" = 1'-0"

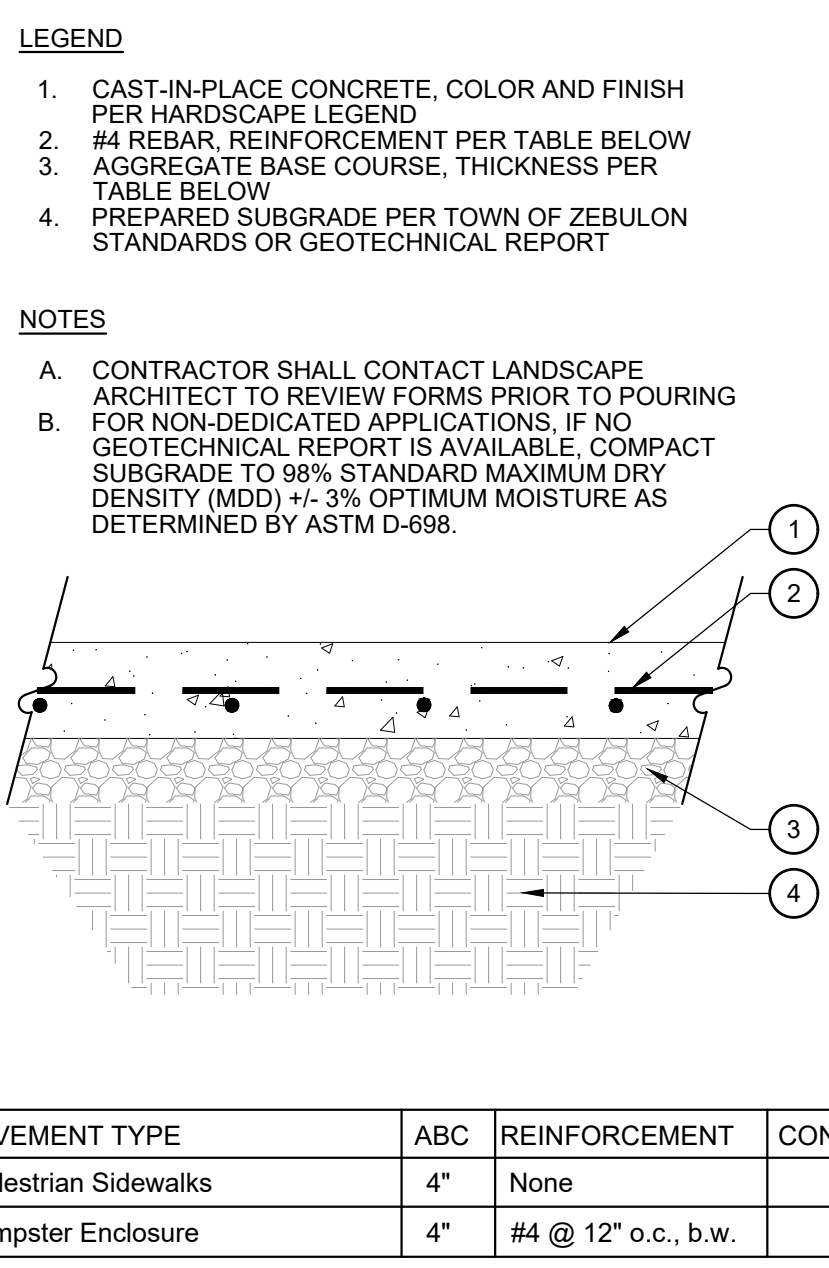


2 CONCRETE PAVING
SCALE: 1" = 1'-0"

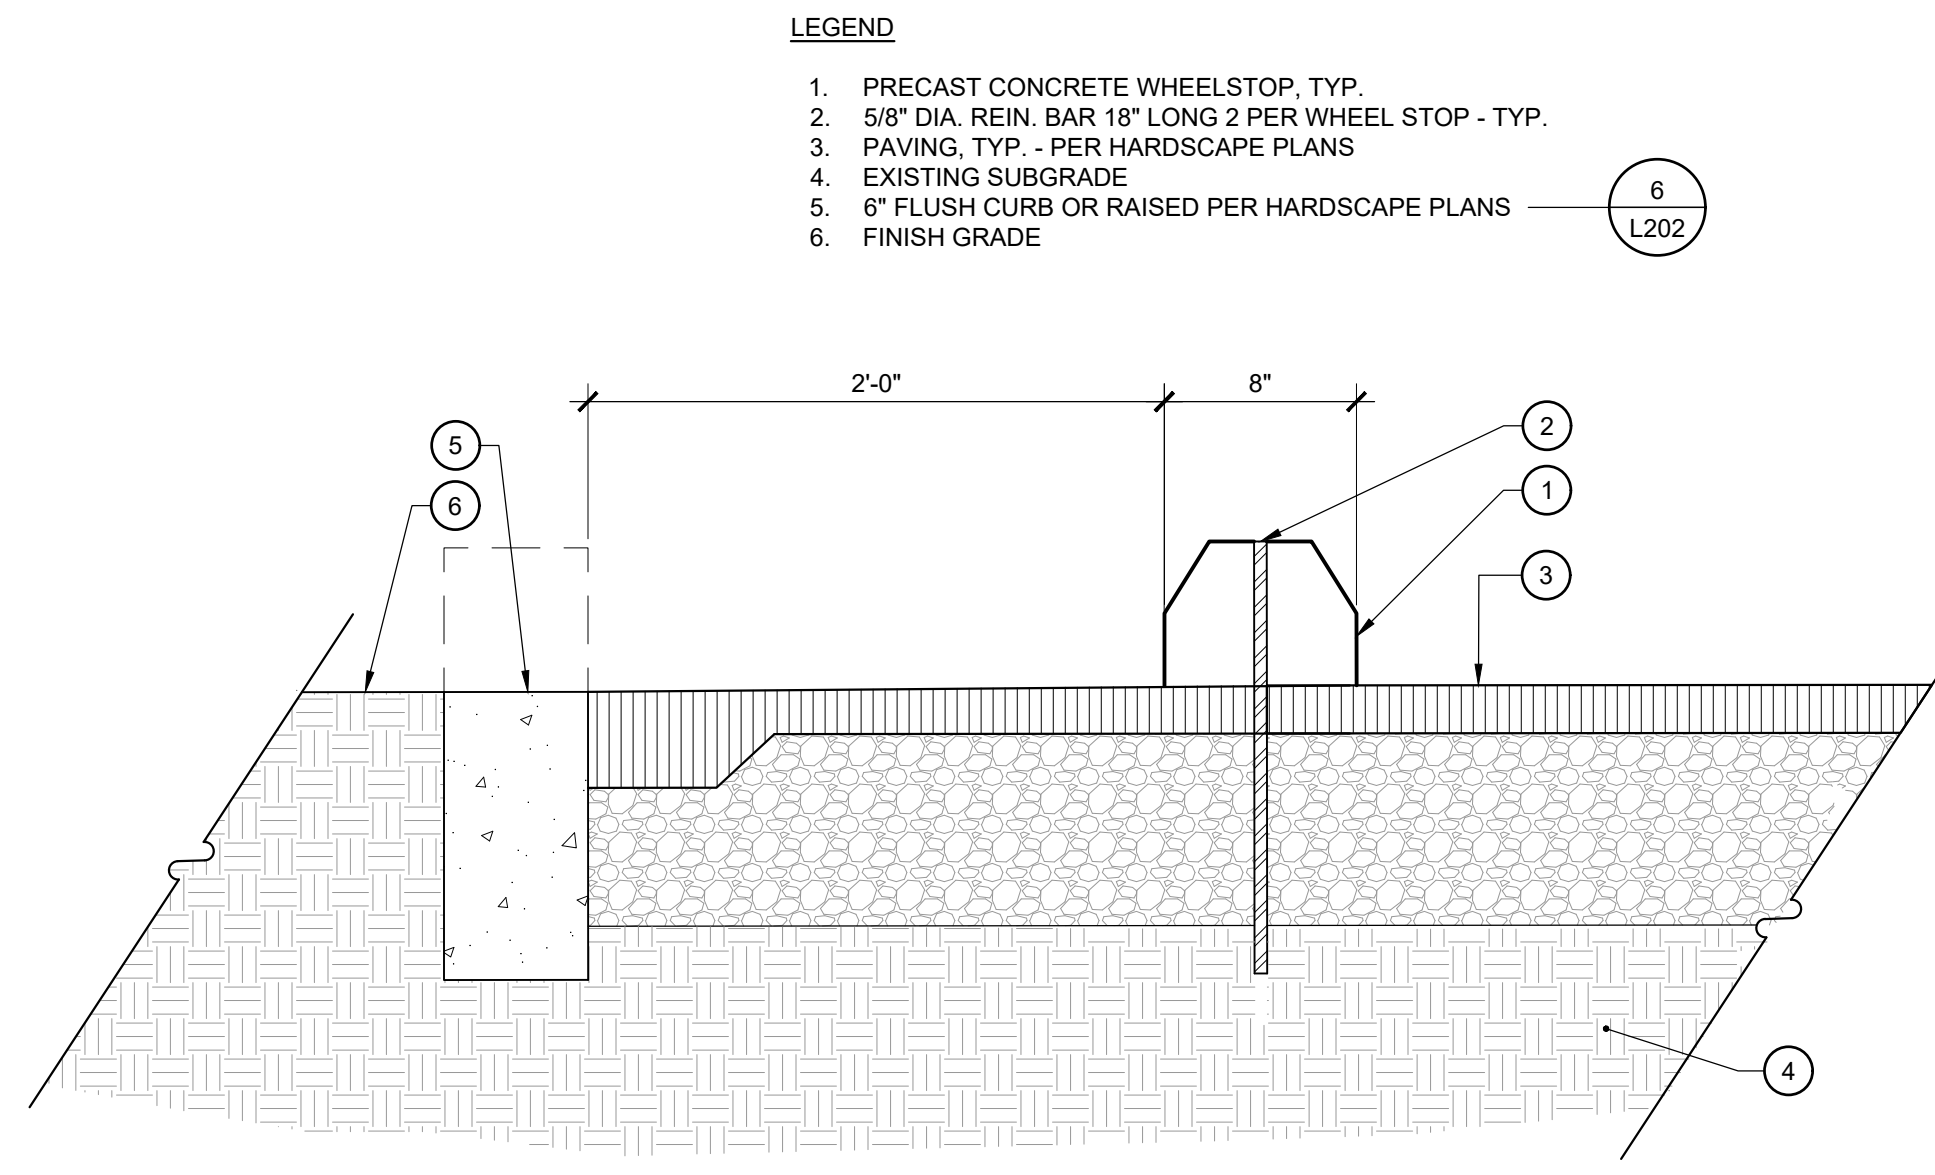

3 CONCRETE WHEEL STOP
SCALE: 1-1/2" = 1'-0"

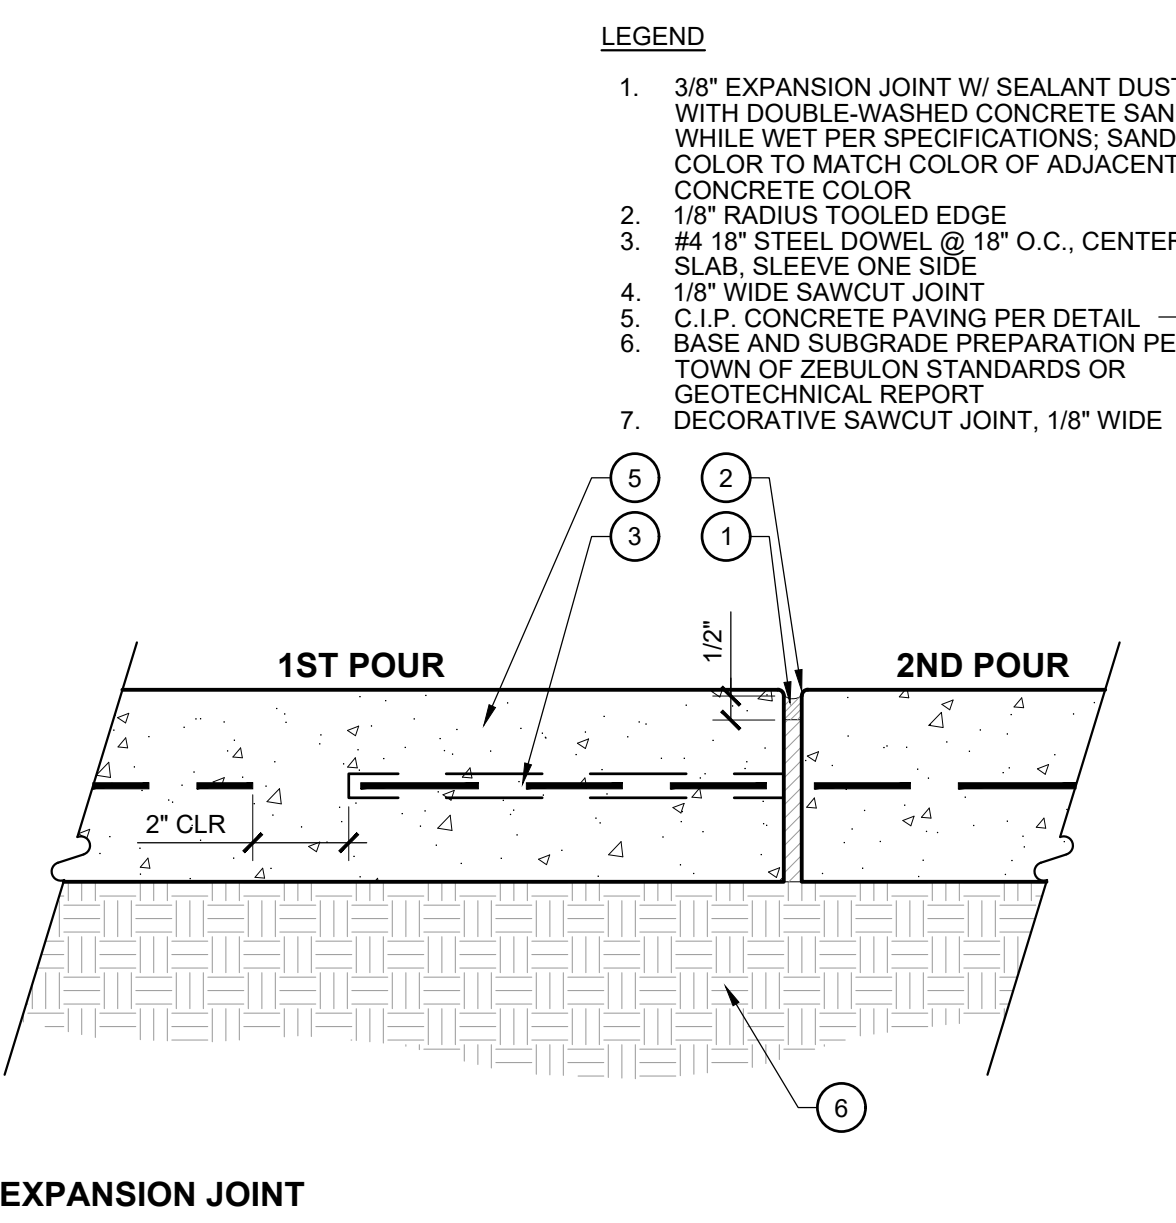


EXPANSION JOINT

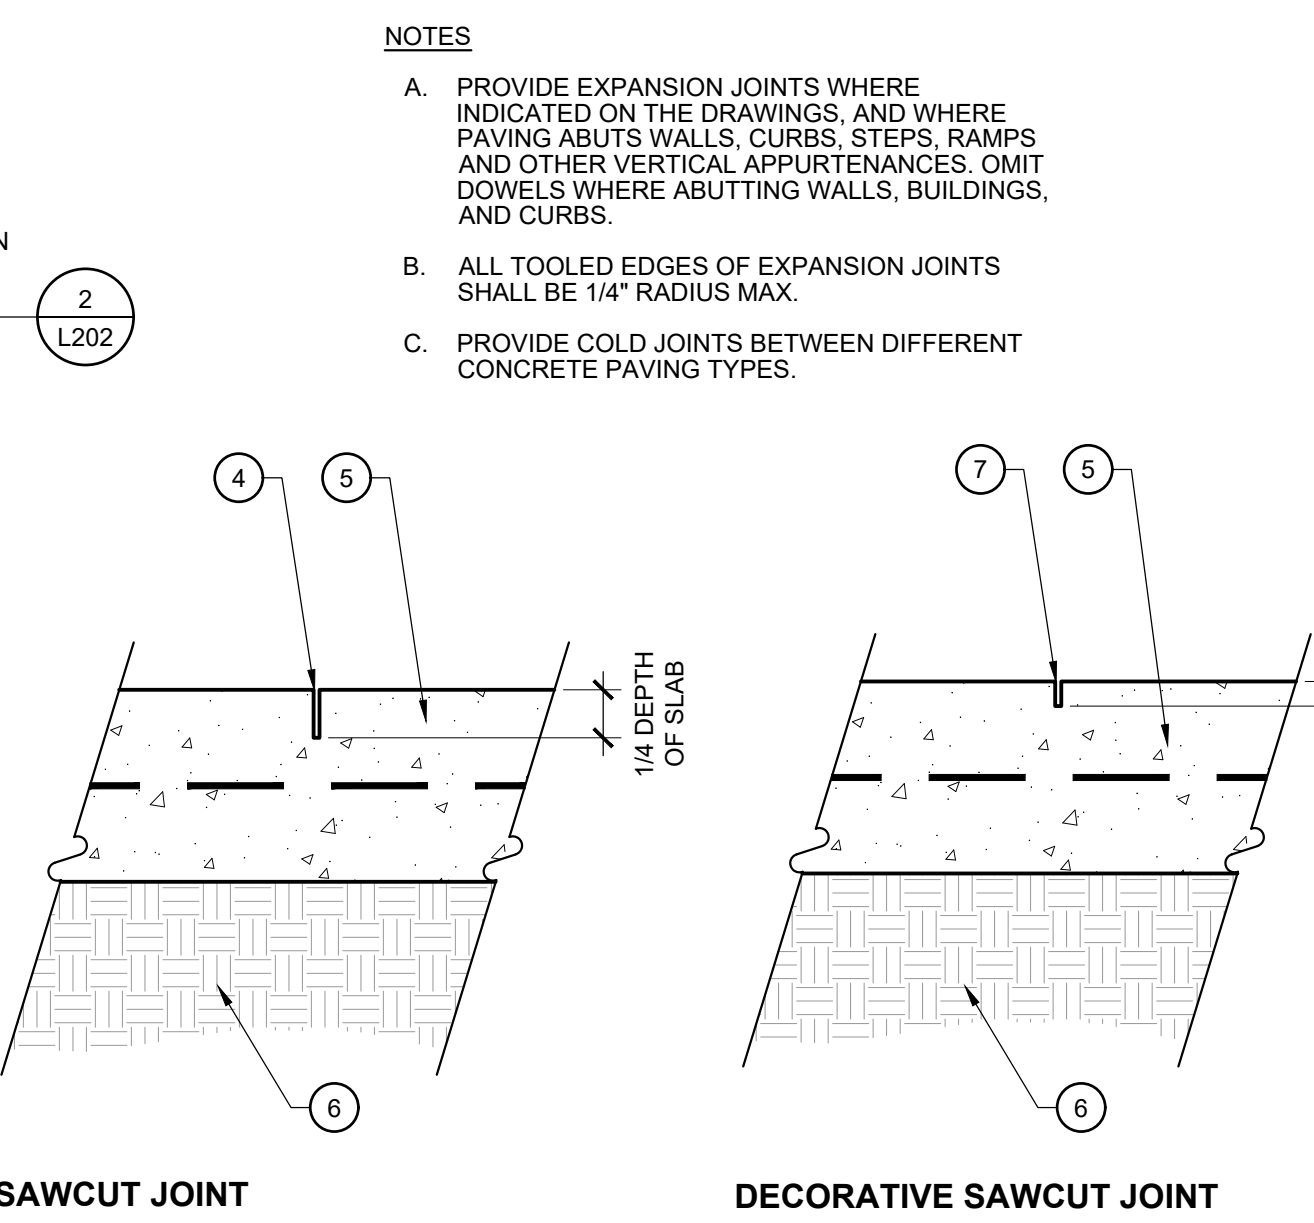


SAWCUT JOINT

DECORATIVE SAWCUT JOINT


4 CONCRETE PAVING JOINTS
SCALE: 1-1/2" = 1'-0"

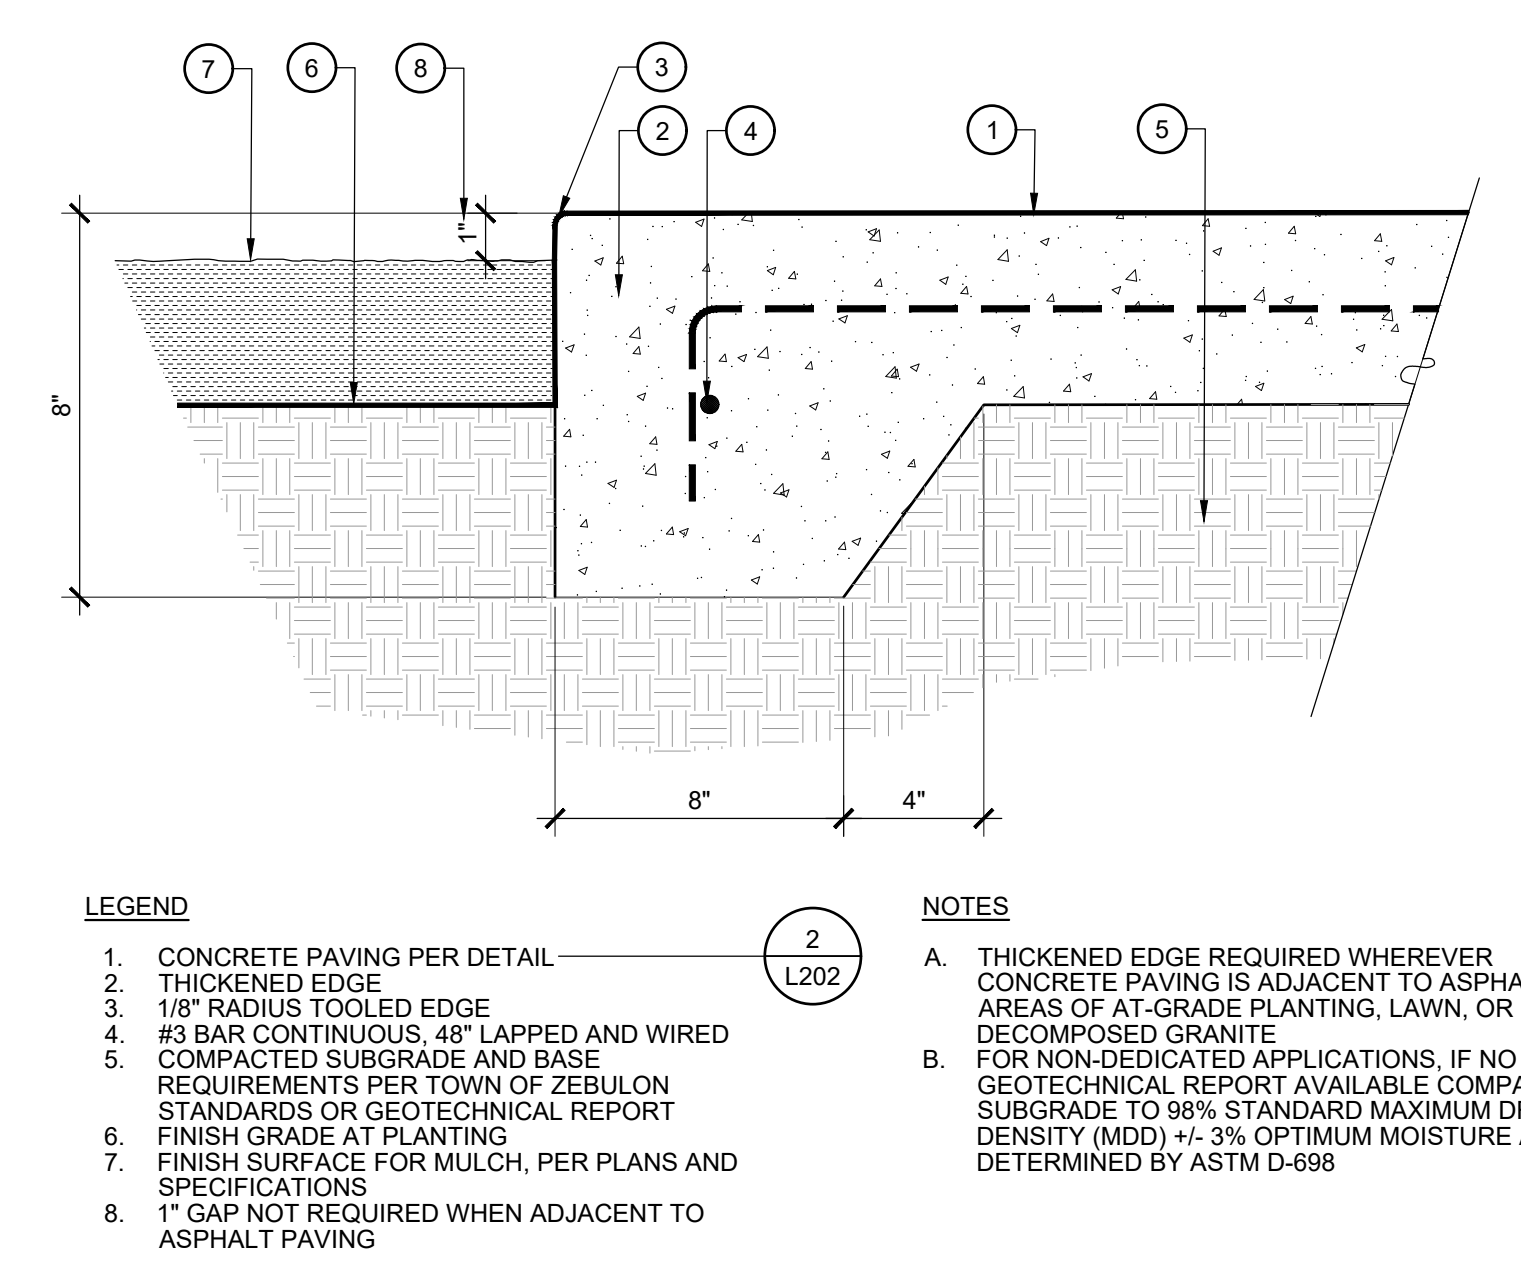


5 CONCRETE THICKENED EDGE
SCALE: 3" = 1'-0"

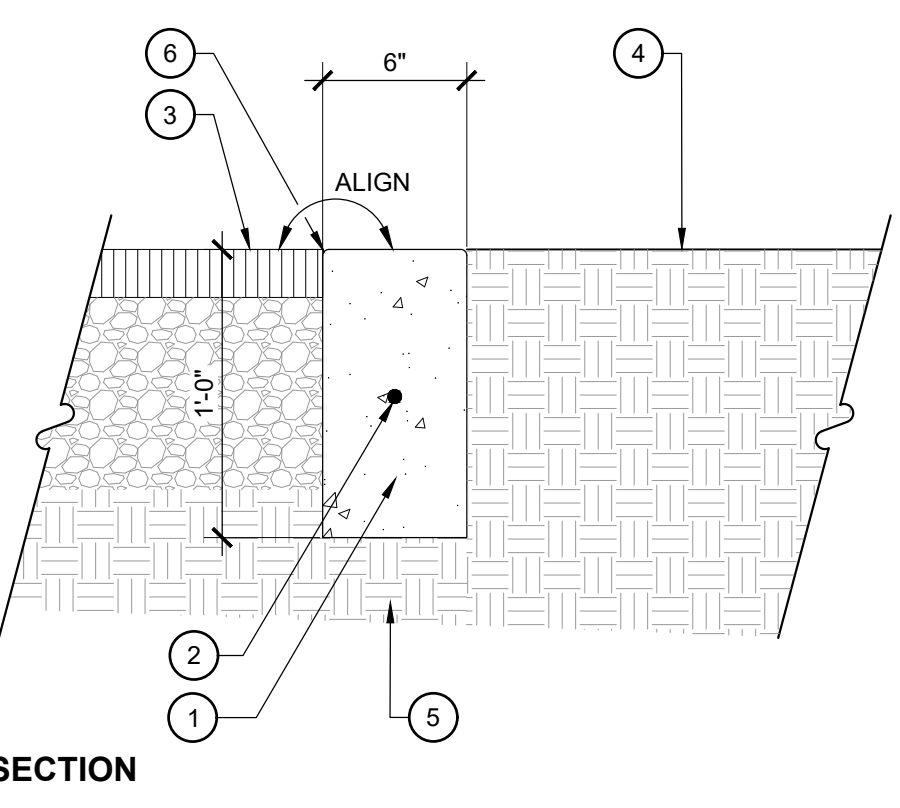

6 6" FLUSH CURB
SCALE: 1-1/2" = 1'-0"

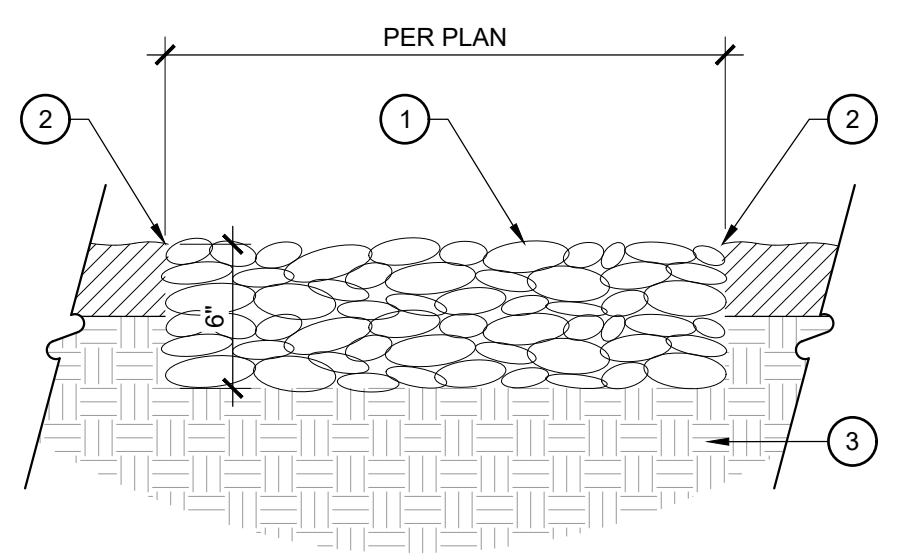


7 ROUNDED RIVER COBBLE
SCALE: 1-1/2" = 1'-0"

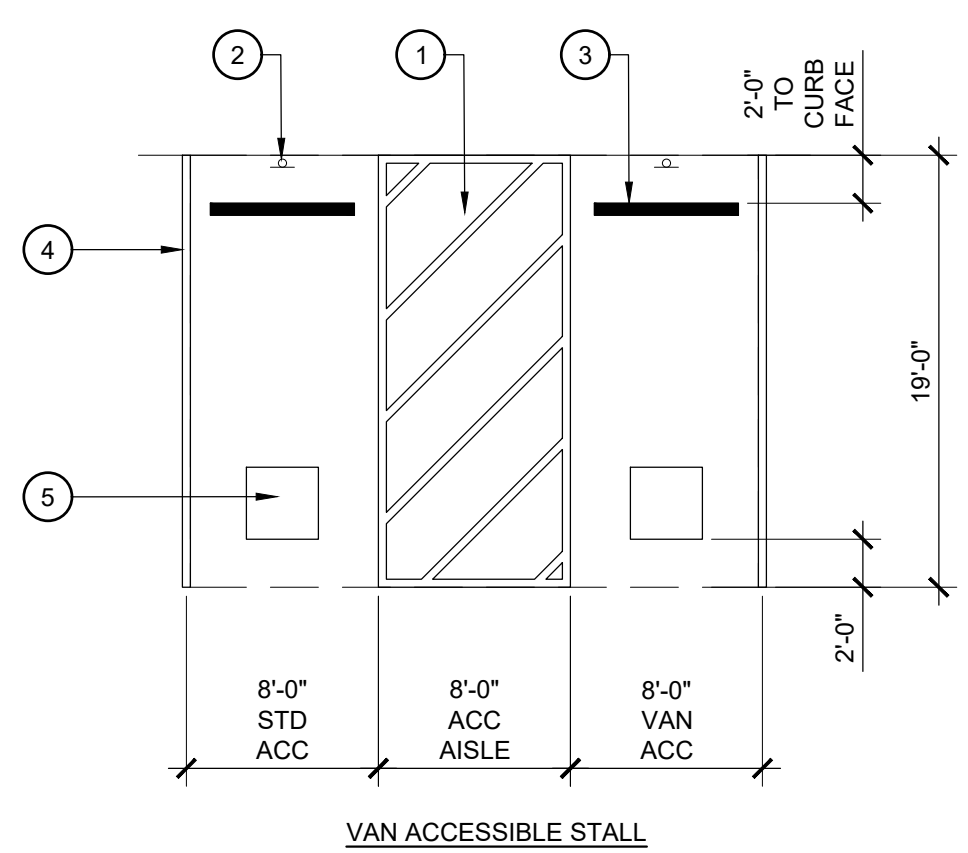


- LEGEND**
1. ACCESSIBLE AISLE TO BE CLEAR OF ALL OBSTRUCTIONS
 2. ACCESSIBLE SIGN, SEE HARDSCAPE PLAN FOR LOCATION
 3. CONCRETE WHEELSTOP
 4. 4" WIDE WHITE STRIPE
 5. 36" X 36" INTERNATIONAL SIGN OF ACCESSIBILITY EMBLEM

NOTES

A. CONTRACTOR SHALL VERIFY A MAX. SLOPE OF 2% IN ALL DIRECTIONS. NOTIFY LANDSCAPE ARCHITECT OF ANY DISCREPANCIES PRIOR TO INSTALLATION

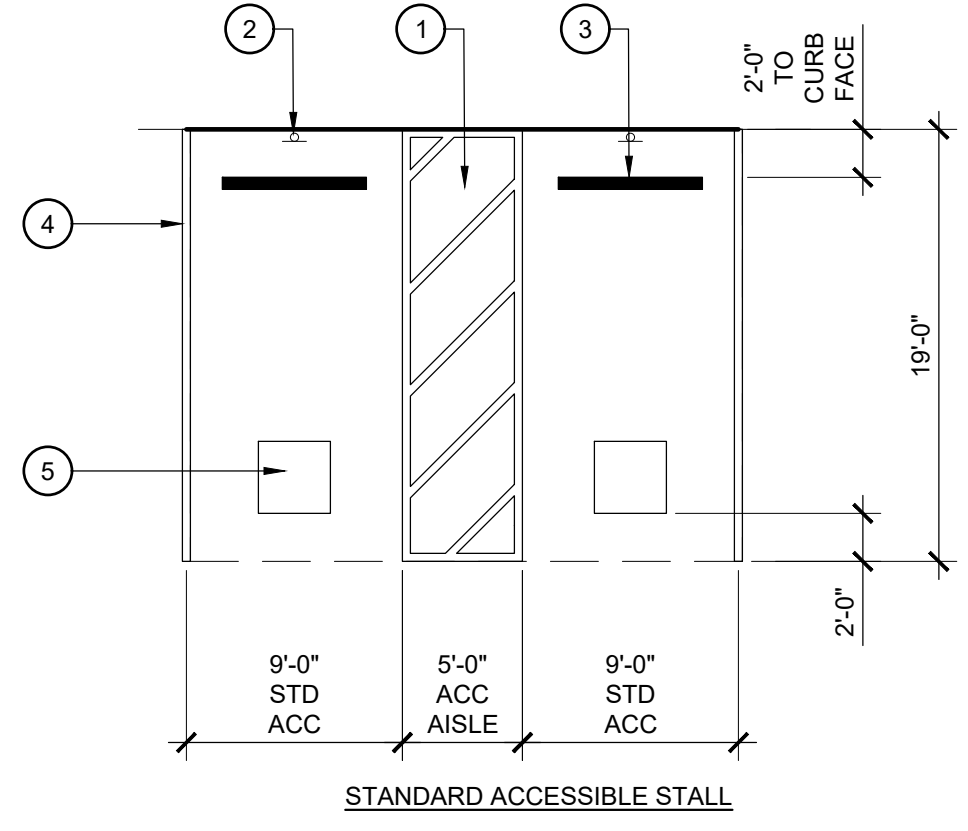


1 ADA PARKING
SCALE: 1/8" = 1'-0"

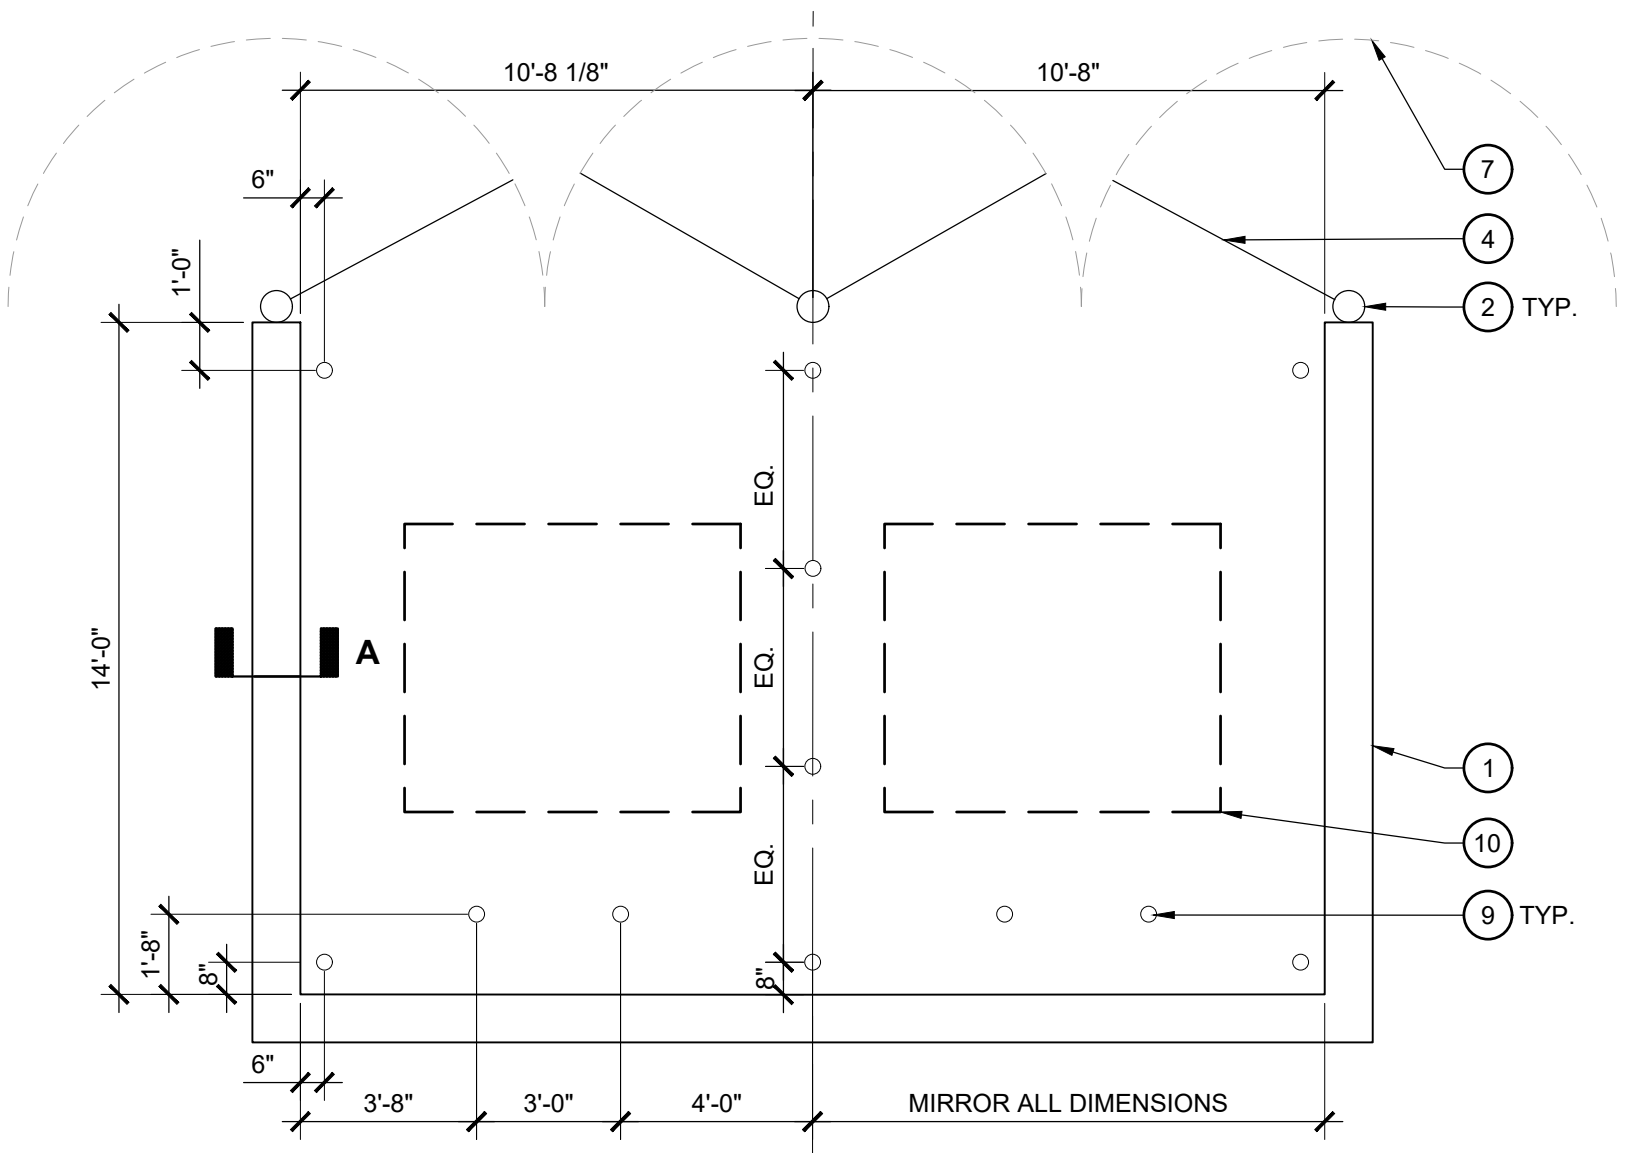


- LEGEND**
1. CMU BLOCK WALL WITH BRICK CLADDING, BRICK TO MATCH ARCHITECTURE
 2. 8" DIA. GALVANIZED STEEL GATE POST
 3. HEAVY DUTY GALVANIZED STEEL GATE HINGES, THREE (3) AT EACH GATE EQUALLY SPACED
 4. 2"X2" SQ. GALVANIZED H.S.S. EXTERIOR SUPPORT GATE FRAME
 5. 1"X1" SQ. GALVANIZED H.S.S. INTERIOR SUPPORT GATE FRAME
 6. STANDING SEAM METAL PANEL WELDED TO H.S.S. FRAME
 7. GATE HINGES SHALL ALLOW FOR 180° SWING
 8. 1/2" DIA. SOLID STOCK STEEL DROP ROD
 9. 4" DIA. HOLLOW CORE GALVANIZED STEEL BOLLARD, EMBED INTO PAVEMENT AND FILL SOLID WITH GROUT
 10. 8 YARD DUMPSTER BY OTHERS (SHOWN FOR REFERENCE ONLY)
 11. FINISH SURFACE

NOTES


A. ALL MOUNTING HARDWARE TO BE GALVANIZED STEEL.
B. PROVIDE SHOP DRAWINGS PRIOR TO INSTALLATION.
C. ALL BRICK TO MATCH ARCHITECTURE.

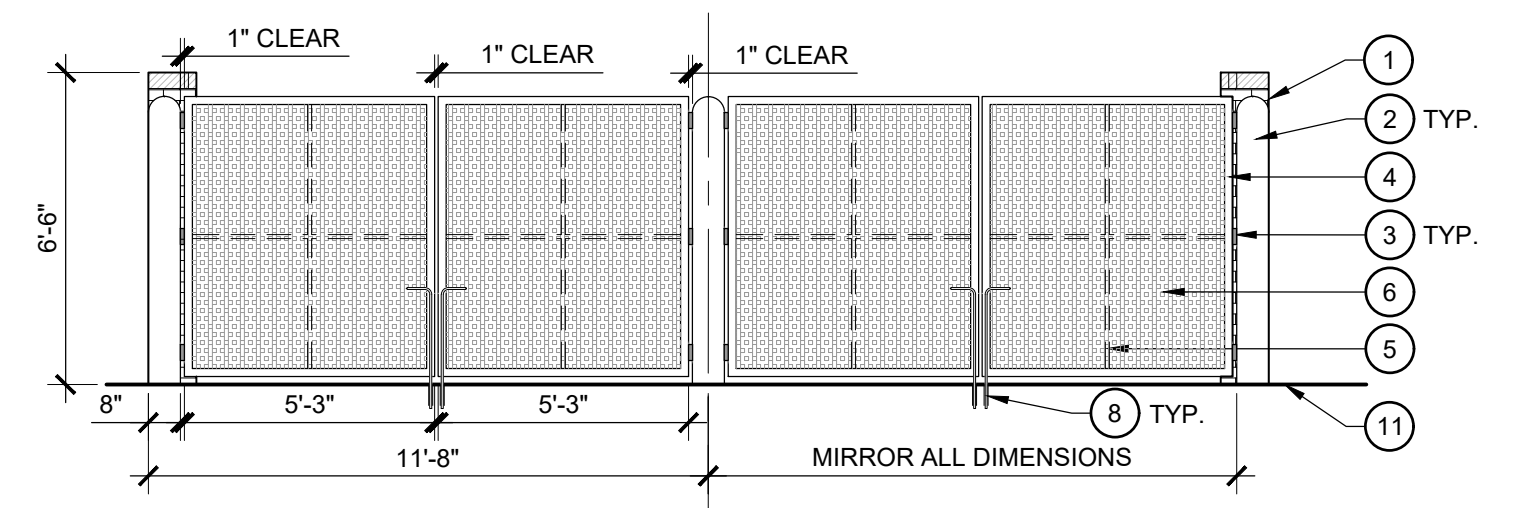

3 DUMPSTER ENCLOSURE WITH GATE
SCALE: 1/4" = 1'-0"

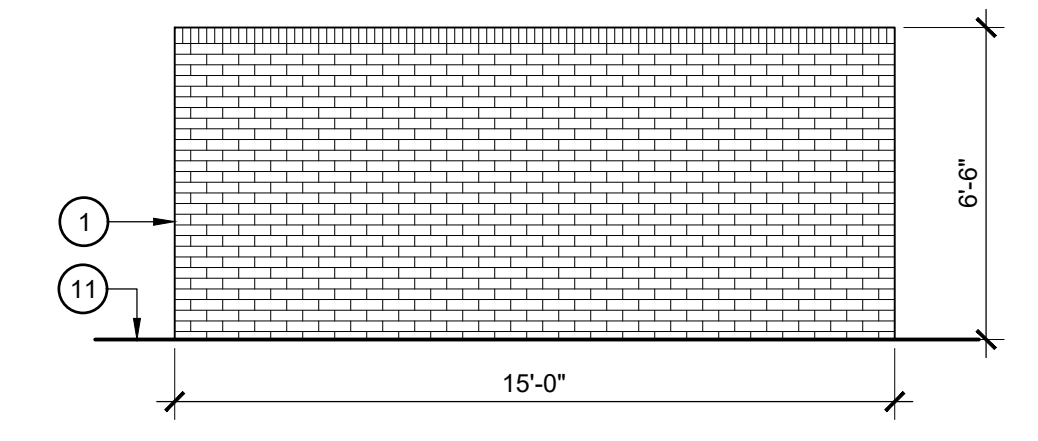


ELEVATION - SIDE

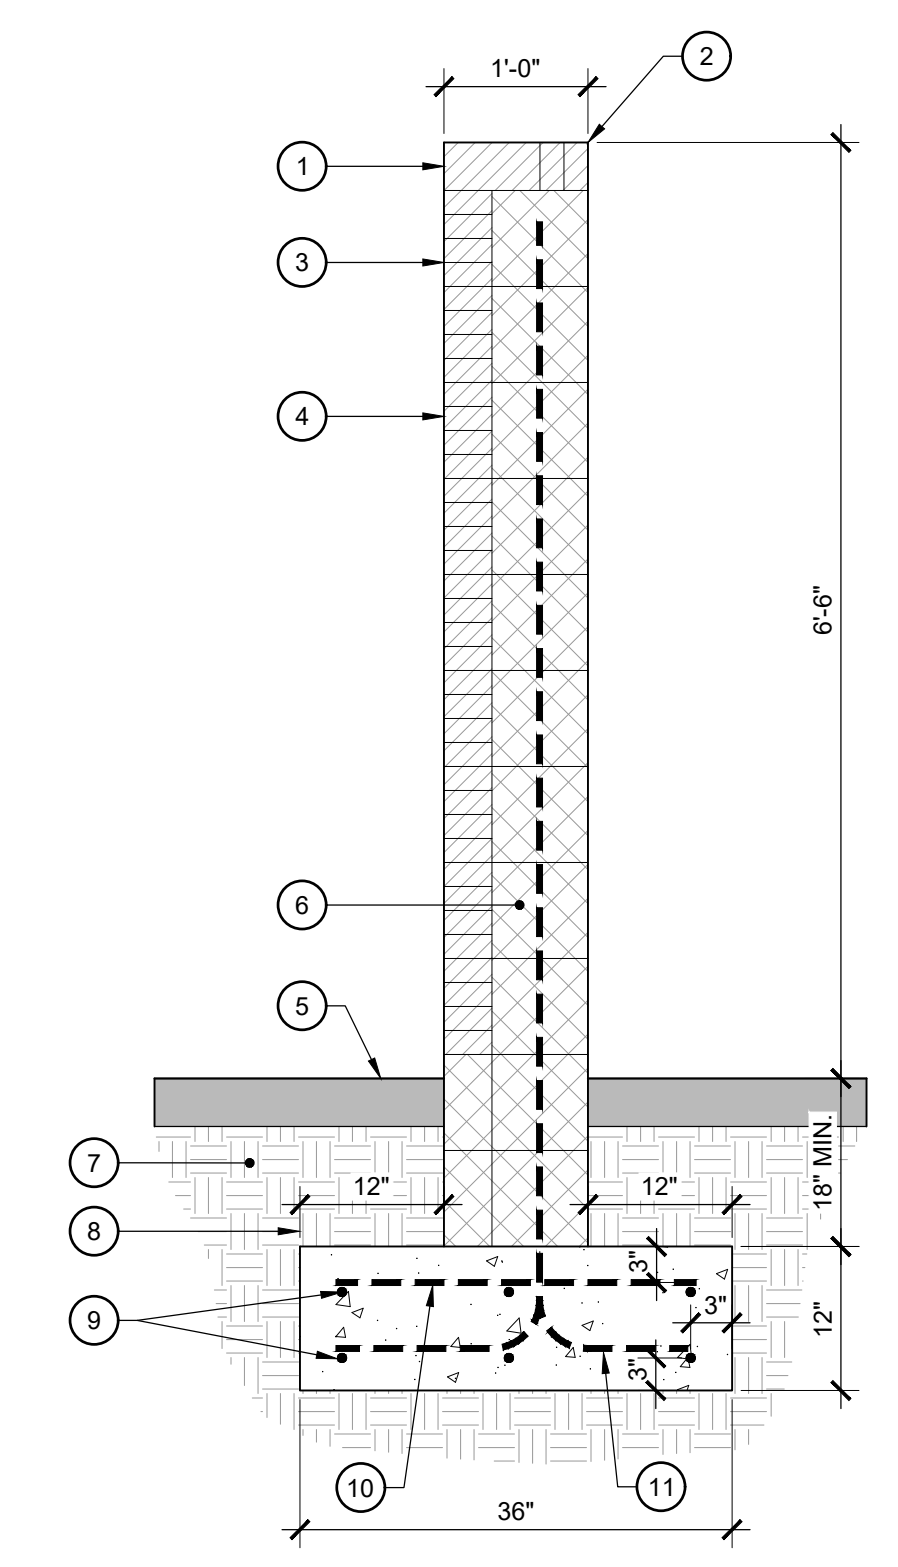

- LEGEND**
1. BRICK ROWLOCK COURSE, BRICK TO MATCH ARCHITECTURE
 2. BRICK SHINER COURSES, BRICK TO MATCH ARCHITECTURE
 3. 1/2" TOOLED JOINT, GROUT TO MATCH ARCHITECTURE
 4. BRICK VENEER IN RUNNING BOND PATTERN W/ HORIZONTAL MASONRY TIES @ 16" O.C. BRICK TO MATCH ARCHITECTURE
 5. ADJACENT PAVING PER HARDSCAPE PLAN. PROVIDE EXPANSION JOINT IF ADJACENT TO CONCRETE PAVING.
 6. 8"X8"X16" CMU BLOCK W/ #5 REBAR @ 16" O.C. GROUT REINFORCED CMU CORES SOLID
 7. COMPACT SUBGRADE TO 95% STANDARD MAXIMUM DRY DENSITY (MDD) ± 3% OPTIMUM MOISTURE AS DETERMINED BY ASTM D-698
 8. CAST-IN-PLACE CONCRETE FOOTING
 9. #5 REBAR CONTINUOUS @ 15" O.C. TOP AND BOTTOM (TYP) SPACE EVENLY
 10. #5 REBAR @ 16" O.C.
 11. #5 1" DOVELS @ 16" O.C. ALTERNATE HOOK DIRECTION

3 DUMPSTER ENCLOSURE SECTION
SCALE: 3/4" = 1'-0"

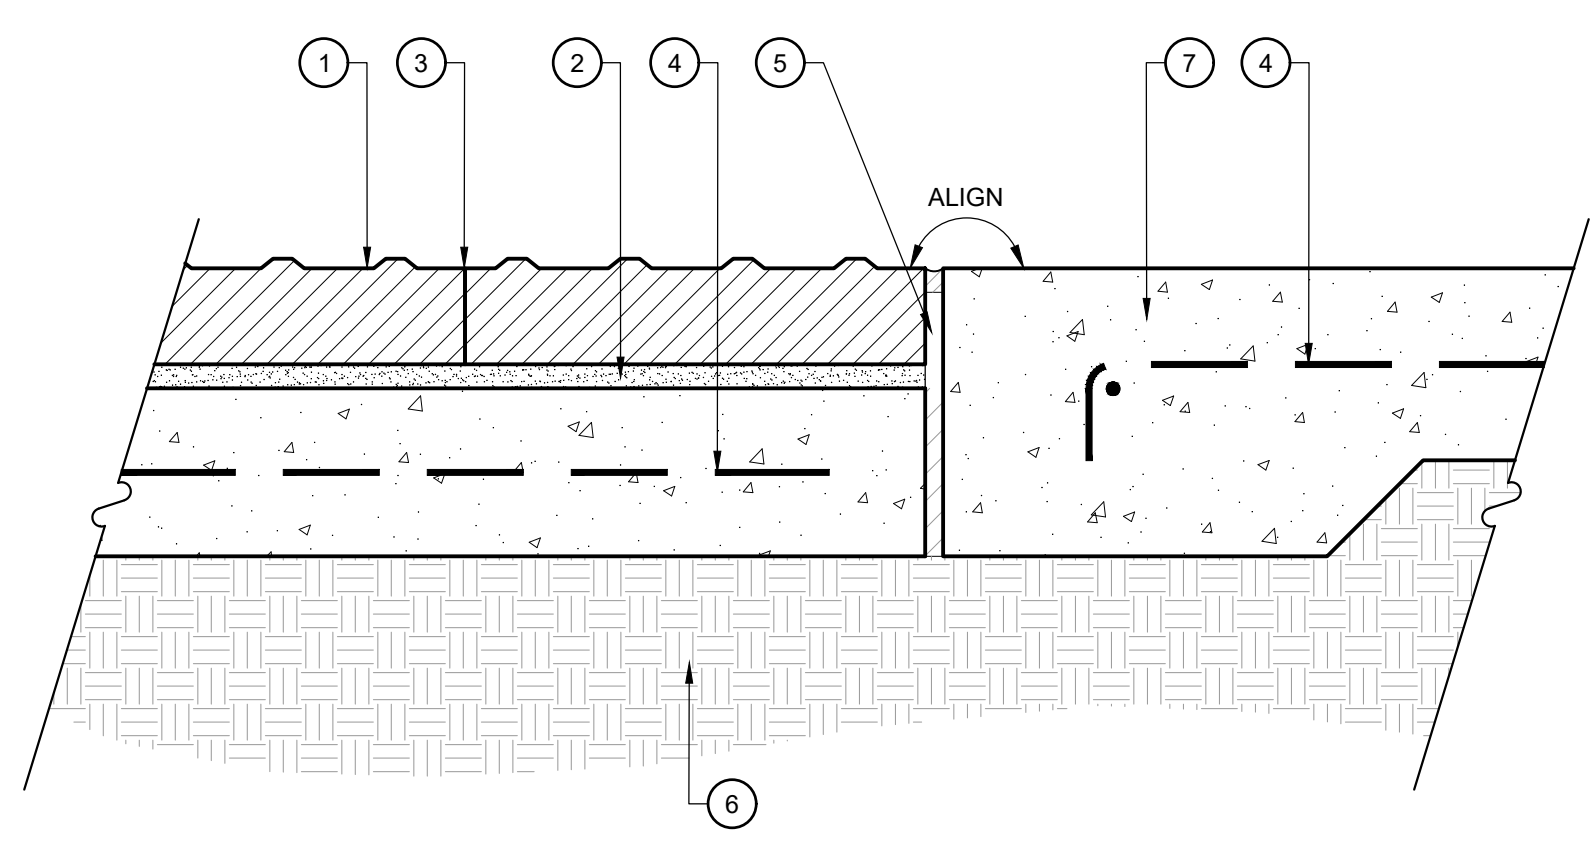


- LEGEND**
1. PRECAST CONCRETE DETECTABLE WARNING PAVERS PER HARDSCAPE LEGEND
 2. MORTAR SETTING BED PER MANUFACTURER'S RECOMMENDATION
 3. BUTT JOINT BETWEEN PAVERS
 4. CONCRETE REINFORCEMENT PER GEOTECHNICAL REPORT
 5. EXPANSION JOINT PER DETAIL
 6. BASE AND SUBGRADE PREPARATION PER TOWN OF ZEBULON STANDARDS OR GEOTECHNICAL REPORT
 7. CONCRETE THICKENED EDGE PER DETAIL

NOTES

A. REFER TO HARDSCAPE PLAN AND LEGEND FOR LAYOUT AND PATTERN OF PAVERS.
B. CONTRACTOR SHALL SUBMIT PAVES SAMPLE TO LANDSCAPE ARCHITECT FOR REVIEW AND APPROVAL PRIOR TO ORDERING AND INSTALLATION.
C. FINISH SURFACE OF DETECTABLE WARNING PAVERS SHALL BE LEVEL WITH ADJACENT PAVING.


2 ADA DETECTABLE WARNING SURFACE
SCALE: 1-1/2" = 1'-0"

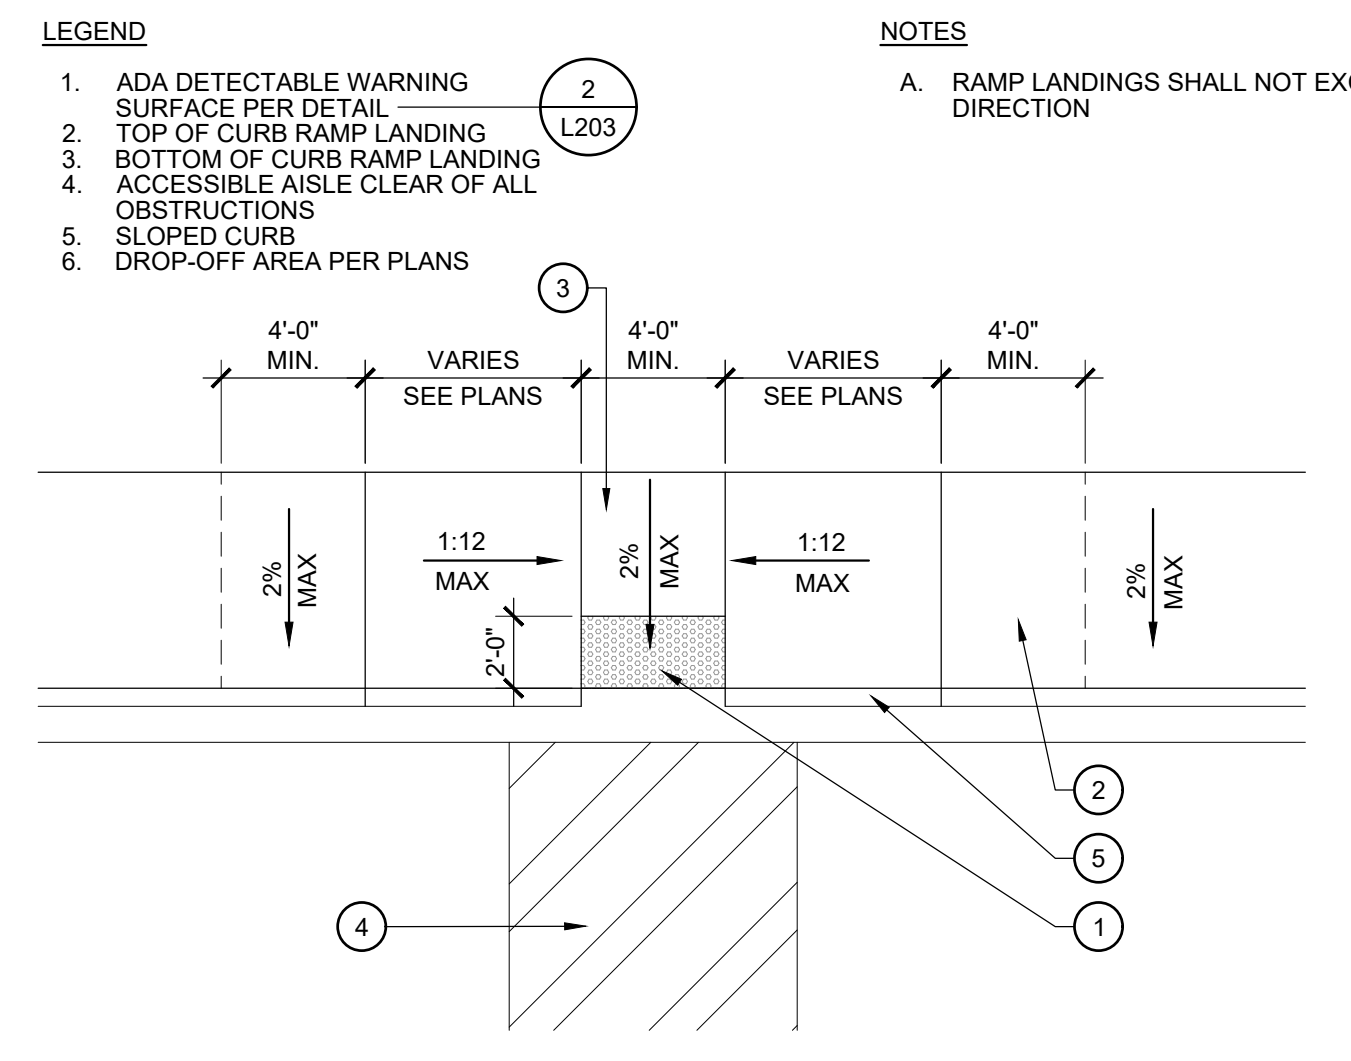

PLAN - PARALLEL CURB RAMP

NOTES

A. RAMP LANDINGS SHALL NOT EXCEED 2% IN ANY DIRECTION

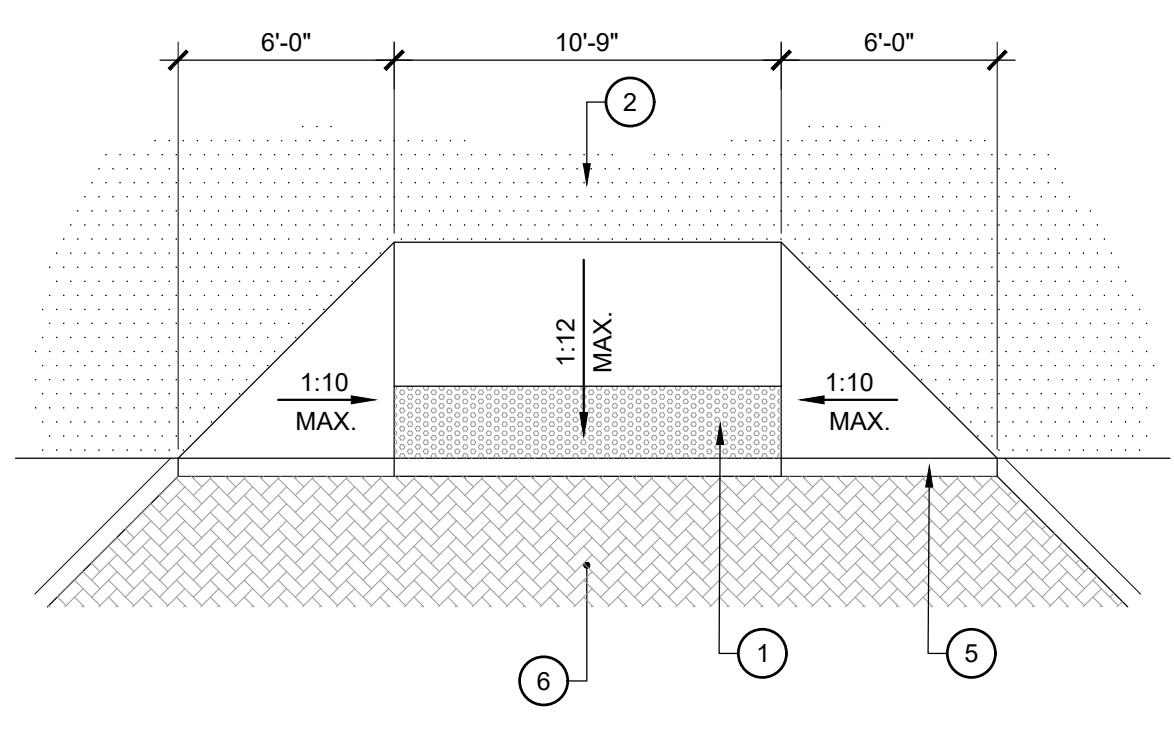


PLAN - PERPENDICULAR CURB RAMP

4 ADA RAMP
SCALE: 3/16" = 1'-0"

LEGEND
 1. 24" WHITE, THERMOPLASTIC PAINT
 2. CROSSWALK PER SITE PLAN


NOTES
 A. STOP BAR TO MEET TOWN OF ZEBULON STANDARDS.

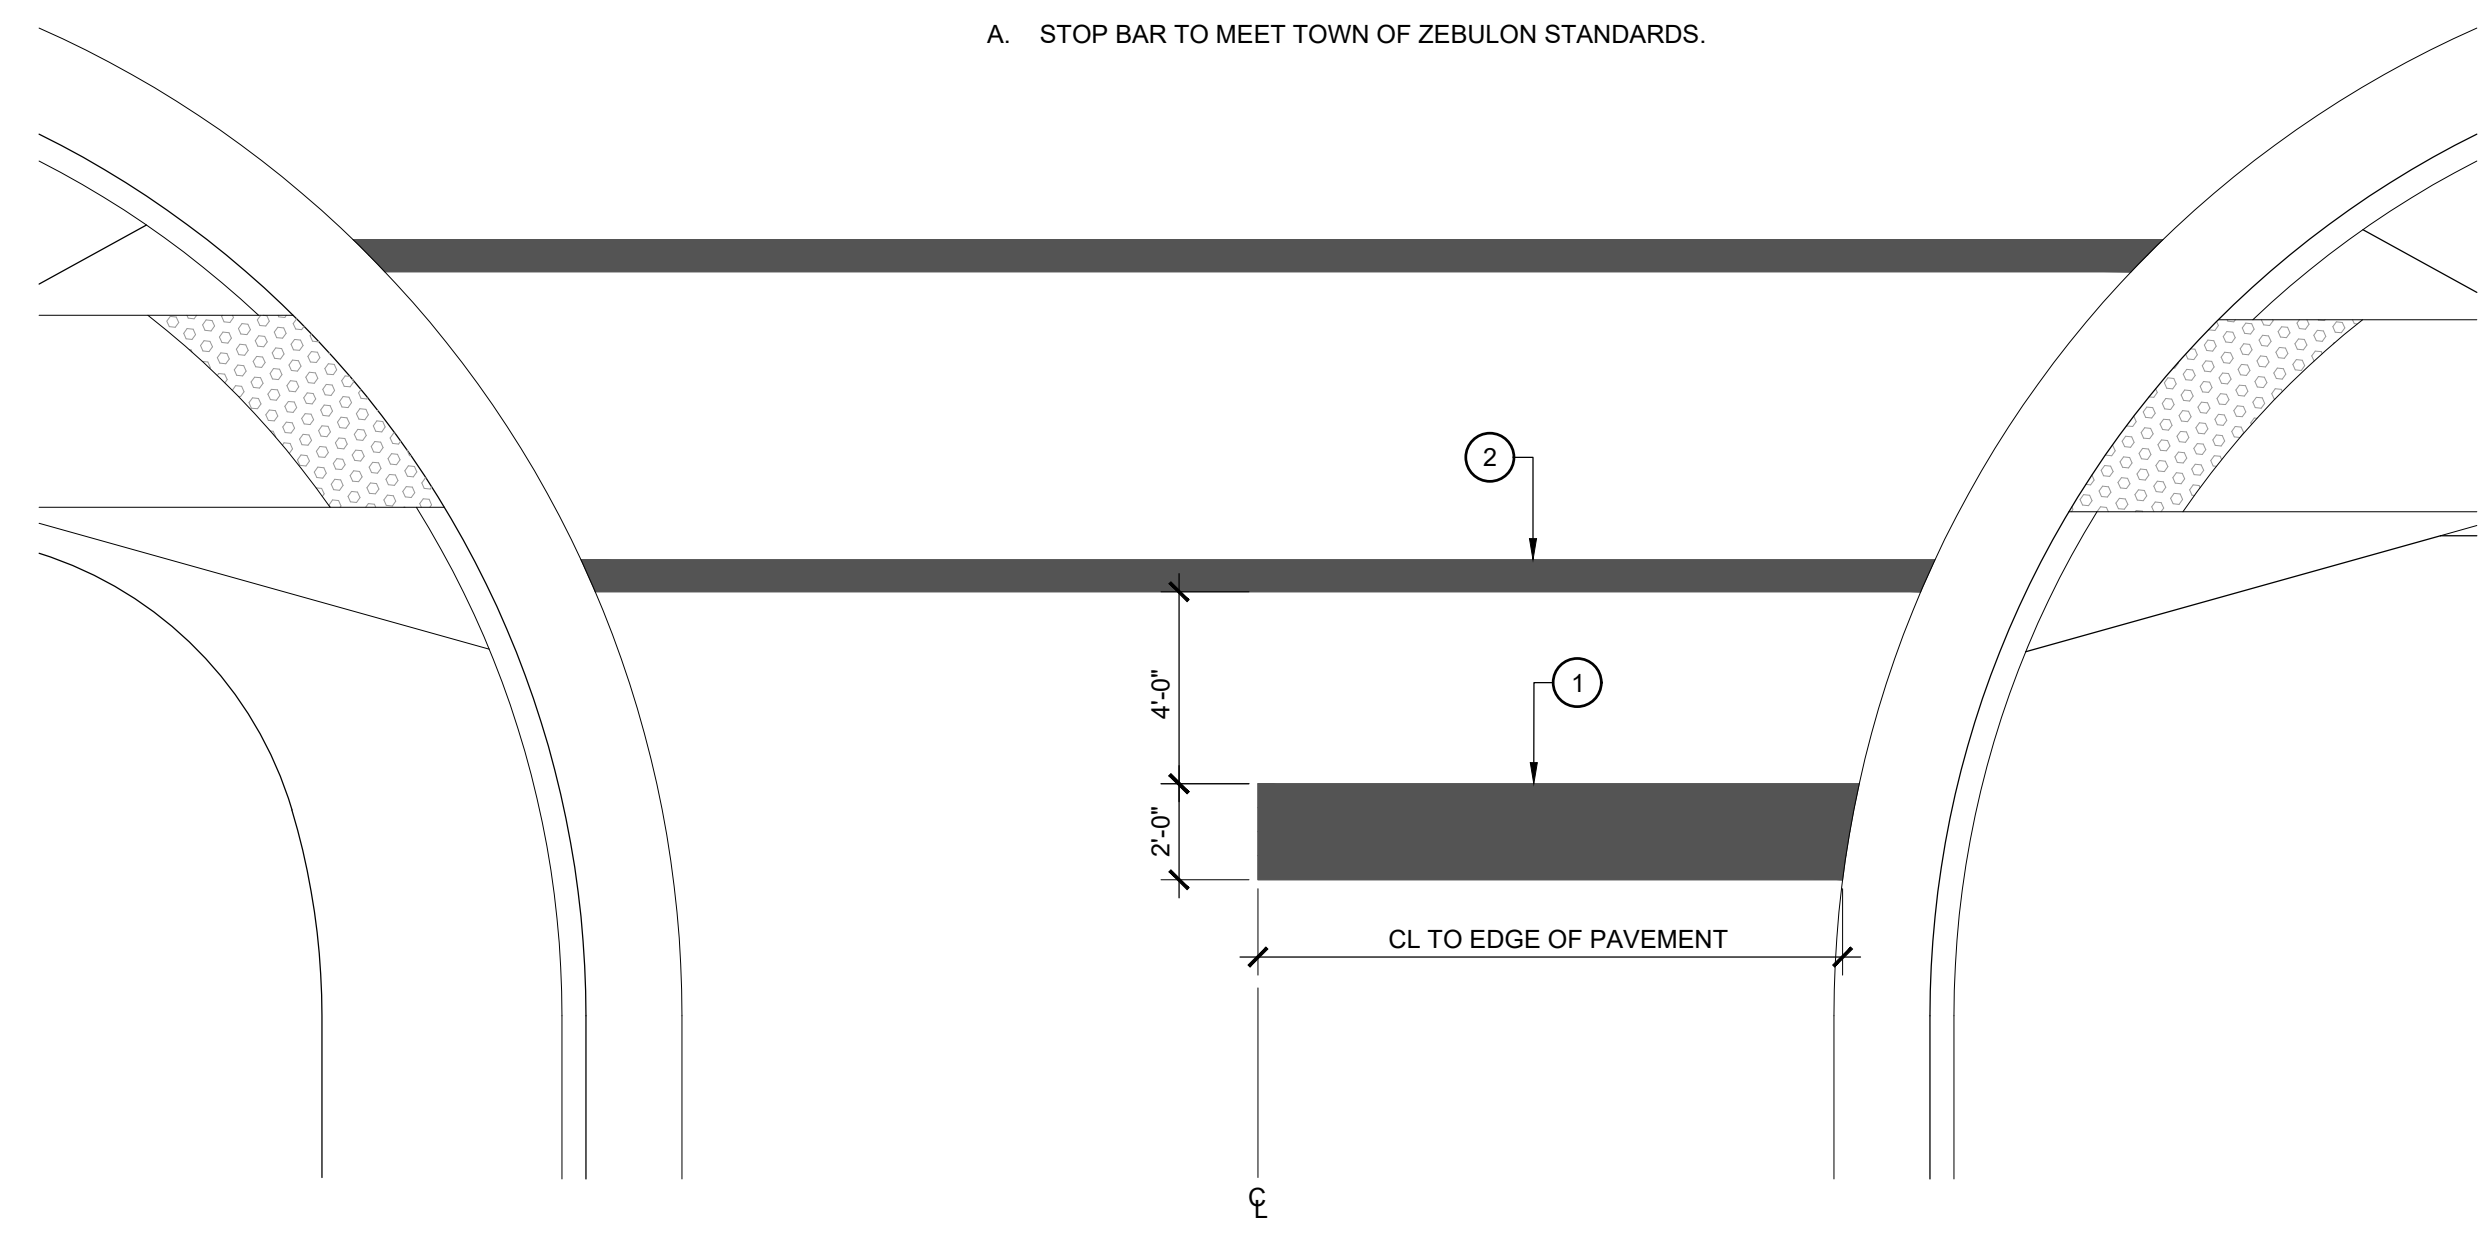

2 STOP BAR
 SCALE: 1/4" = 1'-0"

LEGEND
 1. 8" WHITE, THERMOPLASTIC PAINT
 2. SIDEWALK PER SITE PLAN

NOTES
 A. CROSSWALK TO MEET ALL NCDOT AND TOWN OF ZEBULON STANDARDS. MOST STRINGENT STANDARD TO APPLY

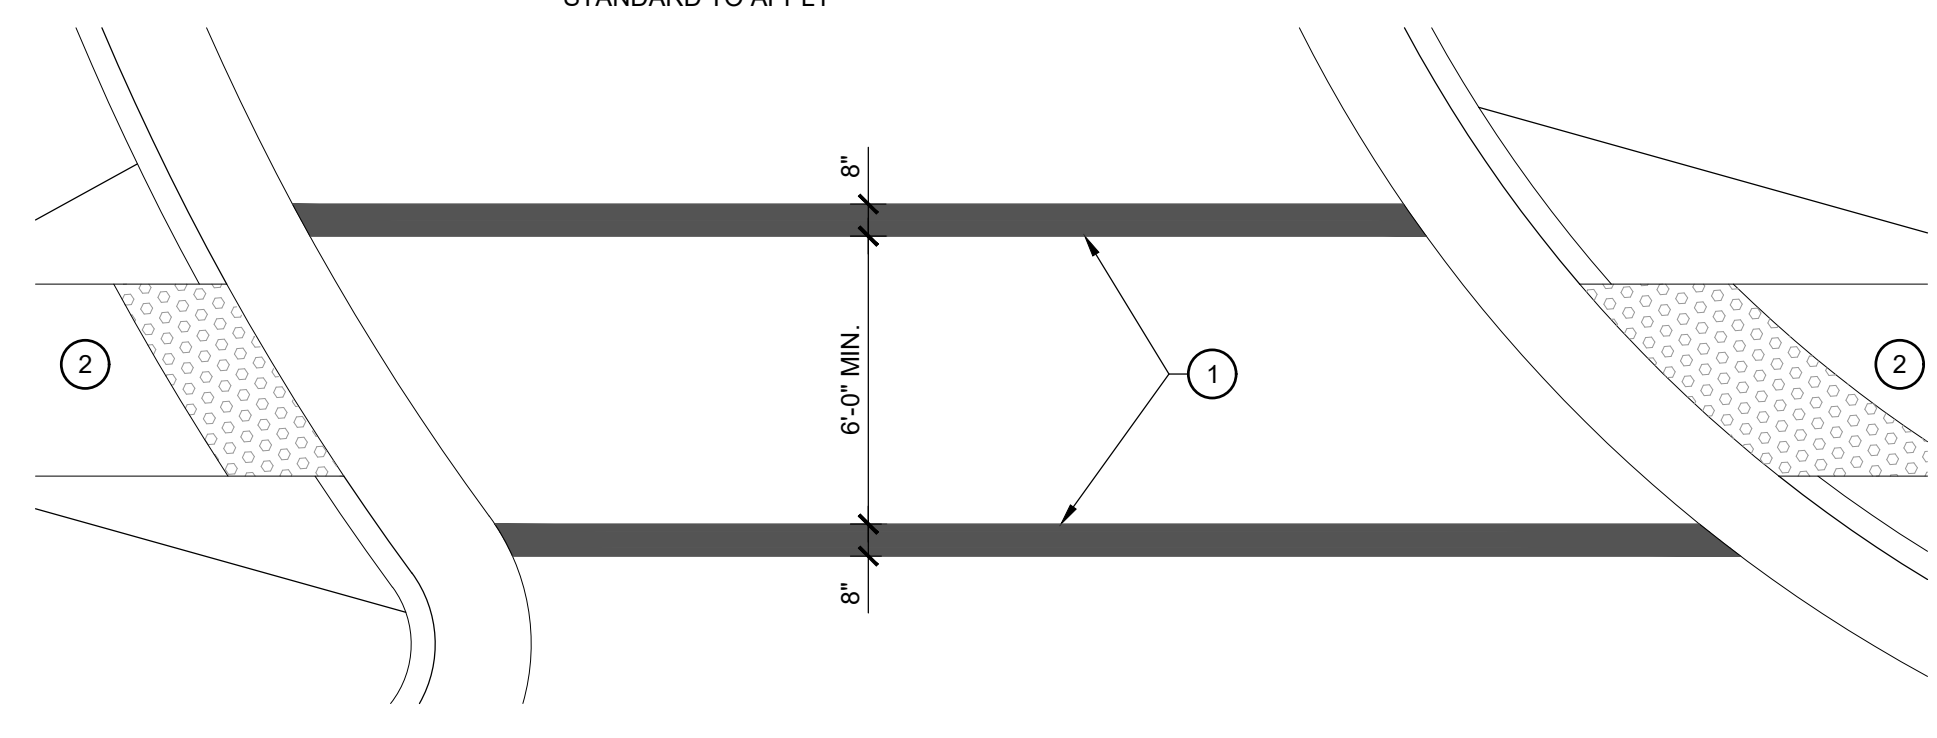

1 CROSSWALK
 SCALE: 1/4" = 1'-0"

Invented for life

Electric Vehicle Charging Solutions

Simple plug and play

- No complicated installation configurations or modifications
- No app needed
- No expensive network subscription required

EV3000 Level 2 Charging Station

- Easy to install and use
- Industry standard NEMA 14-50 plug included
- NEMA 4-rated enclosure for indoor or outdoor installation (outdoor installation requires in-use cover over receptacle)
- Compact design ideal for areas with limited space (indoor and outdoor)
- Includes tamper resistant mounting bracket
- Easy to manage 10' cable
- 240V, 32A capacity for faster vehicle charging
- Up to 6 times faster than a standard wall outlet
- SAE J1772 charging connector is compatible with all EVs in North America
- 3 year warranty

EV3000 DC Fast Charger

- 30kW DC charging charges up to 4 times faster than Level 2 AC charging
- Ideal for fleets, public parking lots and dealerships
- Can charge new vehicles that operate at higher voltages
- SAE J1772 CCS cable. Compatible with nearly all battery electric vehicles sold in North America
- Wall mountable
- High resolution LCD display
- IP55 rated enclosure for indoor or outdoor installation
- 3 year warranty

EV4000 Series Level 2 Charging Station

- 25' cable is the longest available for more versatility and installation locations
- NEMA 3R-rated enclosure for indoor or outdoor installation (outdoor installation requires in-use cover over receptacle)
- SAE J1772 charging connector is compatible with all EVs in North America
- Movable, plug-in installation allows charging when you need it, leaving an open outlet when not charging
- Safety charges in all weather conditions (rain, snow, sleet, ice and extreme heat or cold)
- Bracketless mounting for fast and easy installation
- Clear, bright LEDs indicate charging and power status, stop and reset functions
- Industry leading 4 year warranty

EV810 Series Level 2 Charging Station

- NEMA 4X-rated enclosure is weatherproof for safe charging in any weather or location
- SAE J1772 charging connector is compatible with all EVs in North America
- Flexible mounting. Hardware from back, top, or side. Can be fitted with included NEMA plug
- Movable, plug-in installation option allows charging when you need it, leaving an open outlet when not charging
- 3 year warranty

All Bosch EV chargers meet either UL/cUL or ETL/cETL safety standards on full units

EV850 Series Single Bollard Charging Station

- Galvanized steel bollard for parking lot and commercial use
- 1" thick galvanized steel bollard protects against car bumpers, shopping carts and vandalism, protecting your investment
- NEMA 4X-rated enclosure is weatherproof for safe charging in any weather or location
- SAE J1772 charging connector is compatible with all EVs in North America
- Hardware installation and protective bollard creates safe, tamper proof setup
- Also available as EV850 Dual bollard charging station with two EV810 Series charging stations in a galvanized steel bollard

Item: 80STG9 Mfr. Model: EV3000
Item: 800HH7 Mfr. Model: EV3000
Item: 61HP12 Mfr. Model: EL-42500
Item: 28V238 Mfr. Model: EL-50600-D
Item: 52ND57 Mfr. Model: EL-50600-GINT-B
Item: 61HP13 Mfr. Model: EL-50600-GINT-A

GRAINGER.COM | 1.800.GRAINGER

1 2 PORT EV CHARGING STATION
SCALE: NTS

Med Double Sided W/ Posts Message Center

3D PERSPECTIVE

Item: ACMC31-3

AVAILABLE THROUGH
GRAINGER

PARC WAREHOUSE

2 ALL WEATHER BULLETIN BOARD
SCALE: NTS

Canopy Benches | Steel

Seating, Shade & Style

Create cool seating accommodations by installing these single and double sided contour benches with integrated arched shade canopy top. Offering mild sun protection and engineered for high-volume use, it's easy to understand why they're a favored addition for town squares, parks, playgrounds, schools and home owners associations.

Overall Dimensions
79-1/2" L x 77-3/4" W x 95-7/8" H
*From Grade when installed

Model 321-P6

The convenient design these fixed canopies features MIG welded dual post frame constructed with 4" square structural steel and finished in an impact, weather resistant powder-coating. The canopy tops and contour bench seat assemblies are available with a diamond or perforated pattern steel and are finished with a durable polyethylene offered in a variety of popular color options.

Matching Products

- Classic Style Perforated Steel Trash Receptacles
- Rectangular Perforated Steel Picnic Tables

Canopy/Seat Color Options

- ultra blue, blue, green, brown, burgundy, red, beige, black

Frame Color Options

- yellow, orange, red, burgundy, purple, sky blue, blue, ultra blue, spring green, green, brown, beige, champagne, dark, black, matte, white

3 CANOPY WITH PERMANENT SEATING
SCALE: NTS

ELKAY SPECIFICATIONS

Elkay Outdoor Fountain Bi-Level Pedestal with Pet Station Non-Filtered Non-Refrigerated Model LK4420DB

PRODUCT SPECIFICATIONS

Elkay Outdoor Fountain Bi-Level Pedestal with Pet Station, Non-Filtered Non-Refrigerated. Features shall include 316 Stainless, Heavy Duty Vandal Resistant, Pet Fountain. Furnished with Vandal Resistant bubbler. Mechanical Front Bubbler Button activation. Product shall be Floor Mount/Freestanding, for Outdoor applications, serving 2 station(s). Unit shall be lead-free design which is certified to NSF/ANSI 61 & 372 (lead free) and meets Federal and State low-lead requirements.

Special Features: 316 Stainless, Heavy Duty Vandal Resistant, Pet Fountain

Finish: Beige (BGE), Black (BLK), Blue (BLU), Brown (BRN), Evergreen (EVG), Gray (GRY), Orange (ORN), Purple (PUR), Red (RED), Terracotta (TER), White (WHT), Yellow (YLW)

Power: No Electrical Required

Bubbler Style: Vandal Resistant

Activation by: Mechanical Front Bubbler Button

Mounting Type: Floor Mount/Freestanding

Chilling Option: Non-refrigerated

Dimensions (L x W x H): 31" x 26" x 40-5/16"

Approx. Shipping Weight: 170 lbs.

Installation Location: Outdoor

No. of Stations Served: 2

- Mechanically-Activated bubbler continues to supply water in event of service disruptions.
- Base material constructed from marine-grade 316 stainless steel provides the ultimate corrosion protection from even the most corrosive elements.
- Pet Fountain: Features slow drainage for easy drinking.

AMERICAN PRIDE. A LIFETIME TRADITION.

Like your family, the Elkay family has values and traditions that endure. For almost a century, Elkay has been a family-owned and operated company, providing thousands of jobs that support our families and communities.

Included with Product: Outdoor Fountain

PRODUCT COMPLIANCE

ADA & ICC A117.1
ASME A112.19.3/CSA B45.4
Buy American Act
NSF/ANSI 61 & 372 (lead free)

OPTIONAL ACCESSORIES

LK4471LHB - Locking Hose Bib
97890C - Accessory - Direct Bury Adaptor

Warranty pertains to drinking water applications only. Non-drinking water applications are not covered under warranty.

RESTROOMDIRECT

4 DRINKING FOUNTAIN WITH PET BOWL
SCALE: NTS

ELKAY SPECIFICATIONS

Elkay Outdoor Fountain Bi-Level Pedestal with Pet Station Non-Filtered Non-Refrigerated Model LK4420DB

OPERATING PRESSURES:
Supply water 20 - 105 psi maximum

TOP VIEW

MOUNTING INSTRUCTIONS and PLUMBING CONNECTIONS

Provide solid, well-drained surface to mount pedestal fountain (concrete pad recommended) with adequate support (300lb. load minimum). (3) 3/8" minimum fasteners (not included) should be attached firmly to mounting surfaces in order to secure unit. (refer to rough-in diagram)

Locate and install plumbing through ground as required.
NOTE: Unit is not furnished with service valve.

Position pedestal over plumbing and secure base to fasteners. Remove access panels and connect supply and water lines. Turn on water supply and check for leaks. Reassemble access panels to pedestal.

*Trap and service not included.

BACK VIEW

SIDE & FRONT VIEWS

A = 3/8" O.D. Unplated copper tube connect shut off valve by 20psi
B = Access Panel (7" x 10")
C = Removable bottom cover


RESTROOMDIRECT

4 DRINKING FOUNTAIN WITH PET BOWL
SCALE: NTS


GRADING NOTES

- CONTRACTOR TO FIELD VERIFY ALL INFORMATION AND REPORT ANY DISCREPANCIES TO LANDSCAPE ARCHITECT PRIOR TO ANY CONSTRUCTION ACTIVITY.
- ALL DIMENSIONS AND GRADES SHOWN ON THE PLANS SHALL BE FIELD VERIFIED BY THE CONTRACTOR PRIOR TO CONSTRUCTION. CONTRACTOR SHALL NOTIFY LANDSCAPE ARCHITECT IF ANY DISCREPANCIES EXIST PRIOR TO PROCEEDING WITH CONSTRUCTION FOR NECESSARY PLAN OR GRADE CHANGES. NO EXTRA COMPENSATION SHALL BE PAID TO CONTRACTOR FOR ANY WORK DONE DUE TO DIMENSIONS OR GRADES SHOWN INCORRECTLY ON THESE PLANS IF SUCH NOTIFICATION HAS NOT BEEN GIVEN.
- ALL PAVEMENTS TO SLOPE POSITIVELY AWAY FROM ALL BUILDINGS. PONDING OF WATER IS PROHIBITED.
- THE GENERAL CONTRACTOR IS RESPONSIBLE FOR MAINTENANCE OF EROSION CONTROL METHODS DURING CONSTRUCTION, AND THE OWNER IS RESPONSIBLE FOR MAINTENANCE OF ALL PERMANENT EROSION CONTROL METHODS AFTER CONSTRUCTION IS COMPLETE, IF ANY PERMANENT METHODS ARE REQUIRED.
- CONSTRUCTION AND MAINTENANCE OF ALL EROSION CONTROL DEVICES SHALL CONFORM TO THE STANDARDS SET FORTH IN THE CITY OF RALEIGH EROSION AND SEDIMENT CONTROL MANUAL.
- INSPECTOR REFERS TO AUTHORIZED REGULATORY AGENCY SEDIMENTATION AND EROSION CONTROL INSPECTOR OR HIS/HER REPRESENTATIVE. FIELD INSPECTIONS MAY REQUIRE ADDITIONAL SEDIMENTATION AND EROSION CONTROL MEASURES AS DEEMED NECESSARY BY THE INSPECTOR, CLIENT, AND/OR CLIENT'S REPRESENTATIVES.
- WHEN HAND PLANTING, MULCH (HAY OR STRAW) SHOULD BE UNIFORMLY SPREAD OVER SEEDED AREA WITHIN 24 HOURS OF SEEDING.
- DURING UNSUITABLE GROWING SEASONS, MULCH WILL BE USED AS A TEMPORARY COVER ON SLOPES THAT ARE 4:1 OR STEEPER, MULCH WILL BE ANCHORED.
- EROSION AND SEDIMENT CONTROL DEVICES MUST BE INSTALLED AND INSPECTED PRIOR TO ANY GRADING ON SITE. PLEASE CALL THE REGULATORY AUTHORITY FOR AN INSPECTION.
- INSPECT AND MAINTAIN ALL EROSION CONTROL MEASURES EVERY 7 DAYS AND AFTER EACH SIGNIFICANT RAINFALL (0.5 INCHES OR GREATER) AND DOCUMENT WITH INSPECTION REPORTS.
- EACH DEVICE IS TO BE MAINTAINED OR REPLACED IF SEDIMENT ACCUMULATION HAS REACHED ONE HALF THE CAPACITY OF THE DEVICE.
- LOCATE STOCKPILES UPSLOPE FROM EROSION CONTROL MEASURES. ALL SOIL STOCK PILES SHALL HAVE APPROPRIATE EROSION CONTROL PER THE LATEST VERSION OF THE CITY OF RALEIGH EROSION AND SEDIMENT CONTROL MANUAL INCLUDING SEEDING AND SILT FENCE AROUND THE BASE OF THE STOCK PILE.

GRADING LEGEND	
KEY	DESCRIPTION
FG	FINISH GRADE
MG	MEET EXISTING GRADE
HP	HIGH POINT
HPS	HIGH POINT OF SWALE
LP	LOW POINT
BS	BOTTOM OF STAIRS
TS	TOP OF STAIRS
BR	BOTTOM OF RAMP
TR	TOP OF RAMP
BC	BOTTOM OF CURB
TC	TOP OF CURB
BW	BOTTOM OF WALL
TW	TOP OF WALL
	ACCESSIBLE ROUTE
	TREE PROTECTION FENCE
	LIMITS OF DISTURBANCE

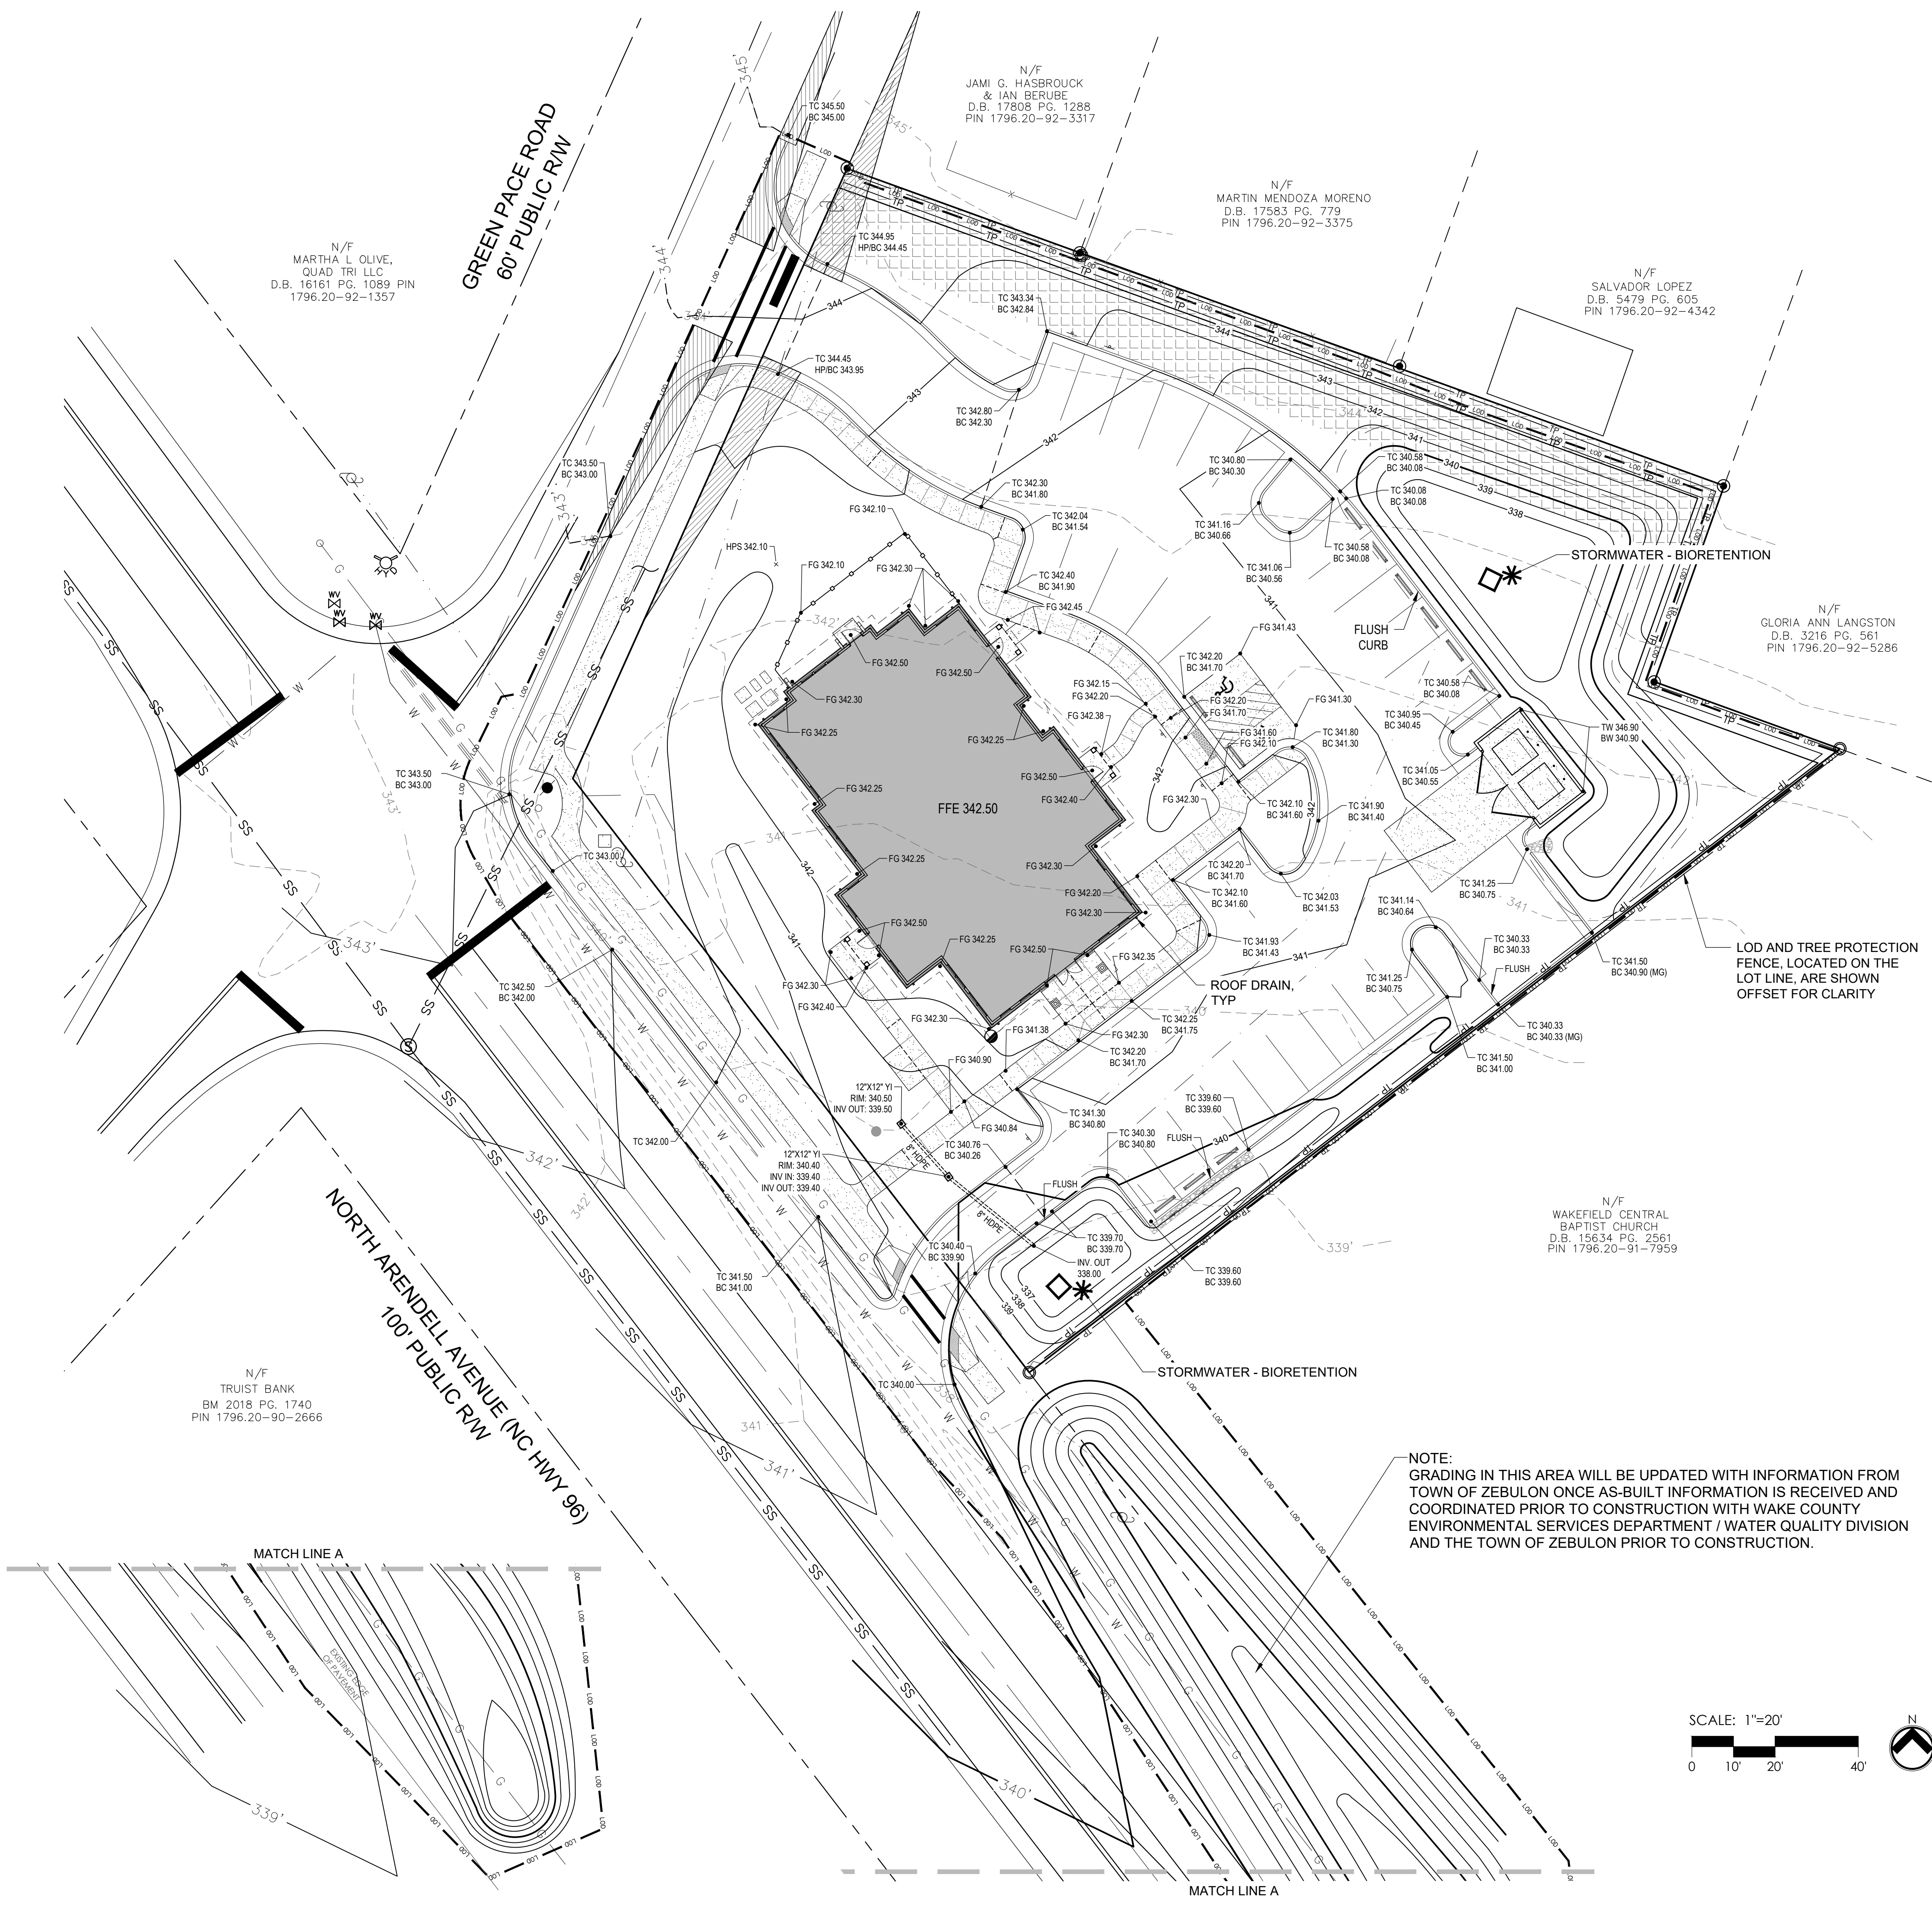

NOTE:
GRADING IN THIS AREA WILL BE UPDATED WITH INFORMATION FROM TOWN OF ZEBULON ONCE AS-BUILT INFORMATION IS RECEIVED AND COORDINATED PRIOR TO CONSTRUCTION WITH WAKE COUNTY ENVIRONMENTAL SERVICES DEPARTMENT / WATER QUALITY DIVISION AND THE TOWN OF ZEBULON PRIOR TO CONSTRUCTION.

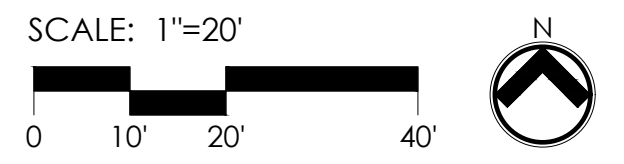

N/F
MARTHA L. OLIVE,
QUAD TRI LLC
D.B. 16161 PG. 1089 PIN
1796.20-92-1357

N/F
JAMI G. HASBROUCK
& IAN BERUBE
D.B. 17808 PG. 1288
PIN 1796.20-92-3317


N/F
MARTIN MENDOZA MORENO
D.B. 17583 PG. 779
PIN 1796.20-92-3375

N/F
SALVADOR LOPEZ
D.B. 5479 PG. 605
PIN 1796.20-92-4342

N/F
GLORIA ANN LANGSTON
D.B. 3216 PG. 561
PIN 1796.20-92-5286

N/F
WAKEFIELD CENTRAL
BAPTIST CHURCH
D.B. 15634 PG. 2561
PIN 1796.20-91-7959

N/F
TRUIST BANK
BM 2018 PG. 1740
PIN 1796.20-90-2666

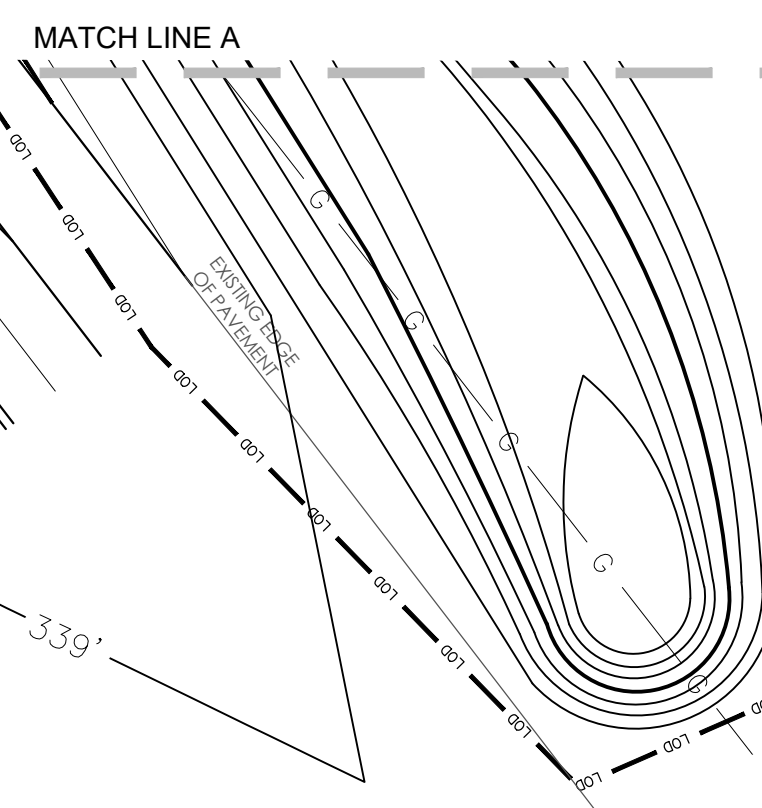

MATCH LINE A

PLANT SCHEDULE

TREES	CODE	QTY	BOTANICAL NAME	COMMON NAME
	AA	3	Acer x freemanii 'Armstrong'	Armstrong Freeman Maple
	AG	6	Amelanchier x grandiflora 'Autumn Brilliance'	Autumn Brilliance Apple Serviceberry
	CC2	4	Carpinus caroliniana 'CCMTF1'	Collynair® American Hornbeam
	CC	15	Cercis canadensis 'NC2016-2'	Flame Thrower® Eastern Redbud
	CK	2	Cladrastis kentukea	American Yellowwood
	IG2	17	Ilex opaca 'Tinga'	Tinga American Holly
	MG	25	Magnolia grandiflora 'Kay Parris'	Kay Parris Southern Magnolia
	NW	14	Nyssa sylvatica 'Wildfire'	Black Gum
	PK	15	Pistacia chinensis 'Keith Davey'	Keith Davey Chinese Pistache

SHRUBS	CODE	QTY	BOTANICAL NAME	COMMON NAME
	AT	15	Azalea encore 'Autumn Sundance' TM	'Autumn Sundance' Encore Azalea
	CW	153	Camellia sasanqua 'Green 02-004'	October Magic® White Shi-Shi Camellia
	ICB	60	Ilex cornuta 'Dwarf Burford'	Dwarf Burford Holly
	IG	93	Ilex glabra 'Shamrock'	Shamrock Inkberry Holly
	LC	8	Loropetalum chinense rubrum 'Fire Dance'	Fire Dance Fringe Flower
	MC	10	Myrica cerifera	Wax Myrtle

GROUND COVERS	CODE	QTY	BOTANICAL NAME	COMMON NAME
		282 sf	POLLINATOR GARDEN	
	AT2	45	Asclepias tuberosa	Butterfly Milkweed
	BX	4	Buddleja x 'Lilac Cascade'	Lilac Cascade Butterfly Bush
	CA2	30	Centaurea montana 'Amethyst in Snow'	Amethyst in Snow Perennial Cornflower
	CL	20	Coreopsis lanceolata	Lanceleaf Tickseed
	EA	8	Echinacea purpurea	Echinacea Mix
	HA	14	Heliopsis helianthoides 'Asahi'	Double False Sunflower
	LA	20	Leucanthemum maximum 'Jane'	Sweet Daisy™ Jane Shasta Daisy
	SL	29	Schizachyrium scoparium	Little Bluestem

TURF	CODE	QTY	BOTANICAL NAME	COMMON NAME
	NT	1,622	Nassella tenuissima	Mexican Feather Grass
	TS	15,637 sf	Sod	Drought Tolerant Fescue Blend



LANDSCAPE REQUIREMENTS:

PARKING LOT
1 CANOPY TREE PER 12 PARKING SPACES
NO PARKING SPACE MORE THAN 50' FROM CANOPY TREE
EVERGREEN SHRUBS A 3' OC REQUIRED AROUND PERIMETER

TYPE D PERIMETER BUFFER
4 CANOPY TREES REQUIRED PER 100 LINEAR FEET
8 UNDERSTORY TREES REQUIRED PER 100 LINEAR FEET
35 EVERGREEN SHRUBS REQUIRED PER 100 LINEAR FEET

75% OF UNDERSTORY TREES SHALL BE EVERGREEN

NOTE:
LANDSCAPING IN THE VICINITY OF THE BIORETENTION PONDS ARE COMPLIANT WITH THE NCDEQ STORMWATER DESIGN MANUAL APPROVED LIST OF TREES AND SHRUBS.

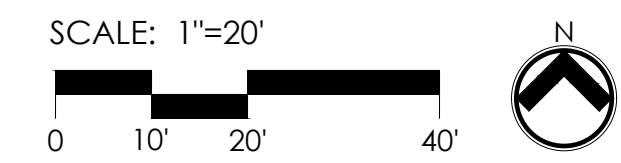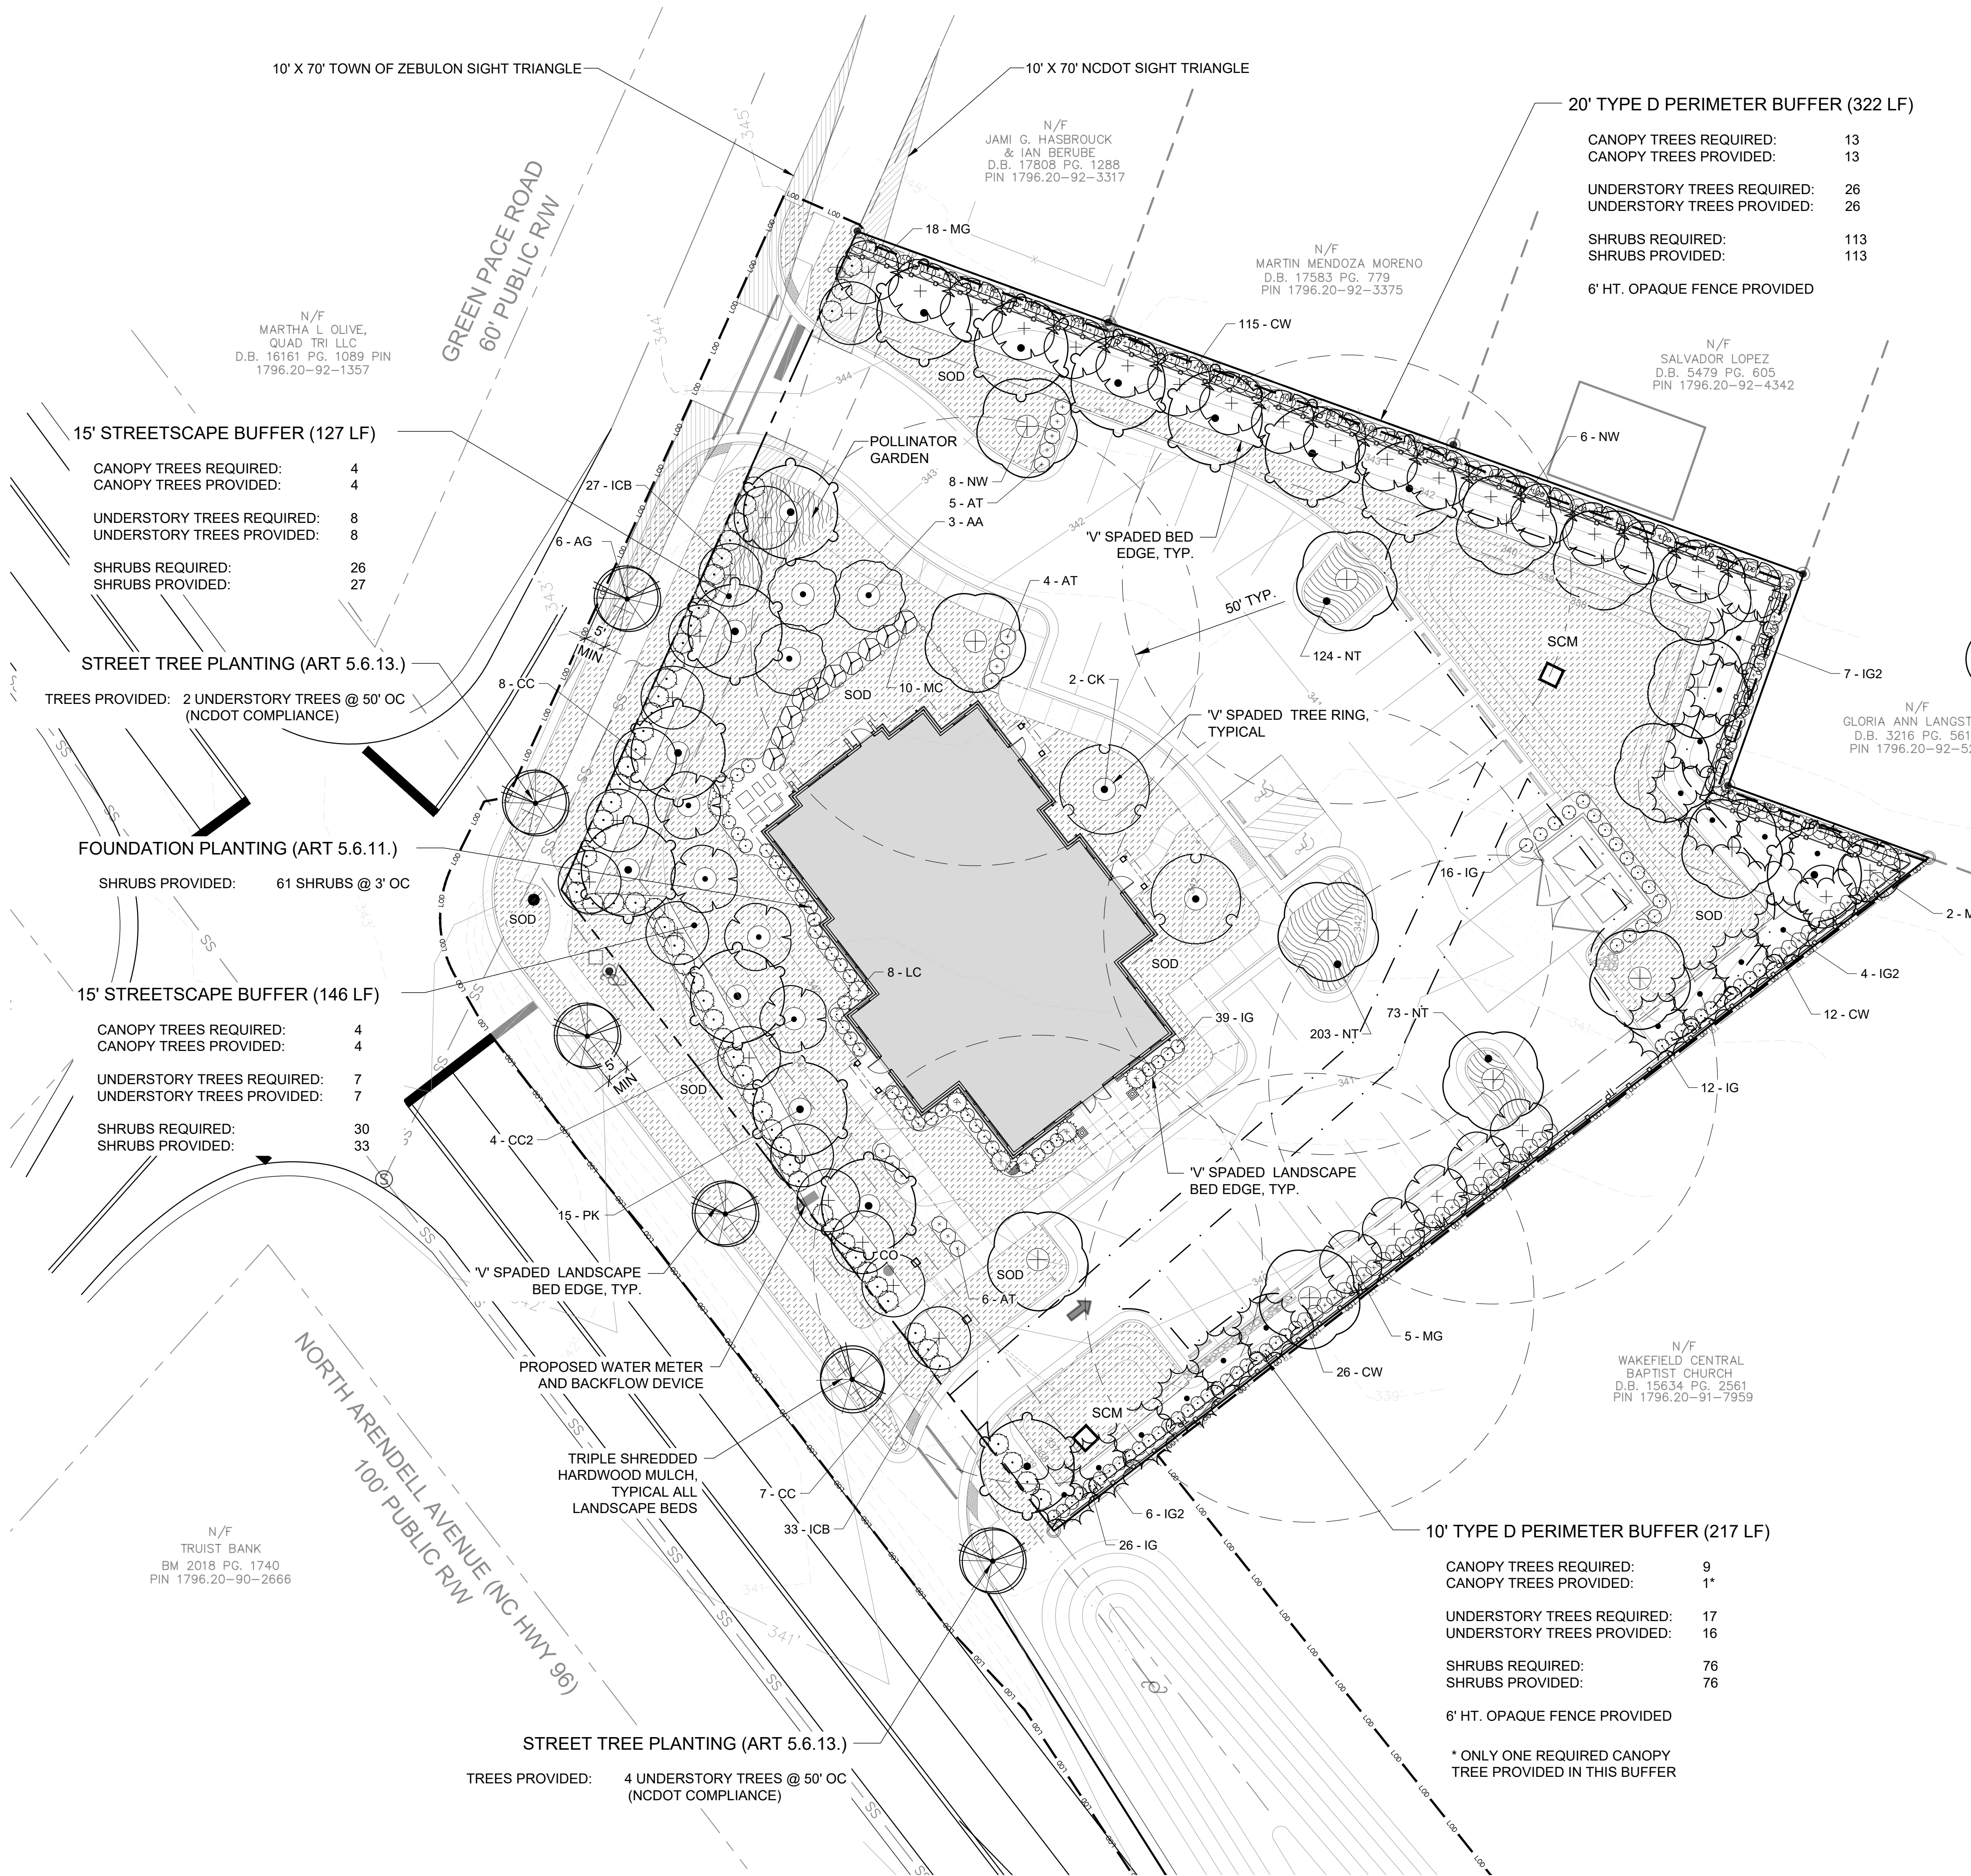

10' TYPE D PERIMETER BUFFER (217 LF)
CANOPY TREES REQUIRED: 9
CANOPY TREES PROVIDED: 1*

UNDERSTORY TREES REQUIRED: 17
UNDERSTORY TREES PROVIDED: 16

SHRUBS REQUIRED: 76
SHRUBS PROVIDED: 76

6' HT. OPAQUE FENCE PROVIDED

* ONLY ONE REQUIRED CANOPY TREE PROVIDED IN THIS BUFFER

20' TYPE D PERIMETER BUFFER (322 LF)
CANOPY TREES REQUIRED: 13
CANOPY TREES PROVIDED: 13

UNDERSTORY TREES REQUIRED: 26
UNDERSTORY TREES PROVIDED: 26

SHRUBS REQUIRED: 113
SHRUBS PROVIDED: 113

6' HT. OPAQUE FENCE PROVIDED

15' STREETSCAPE BUFFER (127 LF)
CANOPY TREES REQUIRED: 4
CANOPY TREES PROVIDED: 4

UNDERSTORY TREES REQUIRED: 8
UNDERSTORY TREES PROVIDED: 8

SHRUBS REQUIRED: 26
SHRUBS PROVIDED: 27

STREET TREE PLANTING (ART 5.6.13.)
TREES PROVIDED: 2 UNDERSTORY TREES @ 50' OC (NCDOT COMPLIANCE)

FOUNDATION PLANTING (ART 5.6.11.)
SHRUBS PROVIDED: 61 SHRUBS @ 3' OC

15' STREETSCAPE BUFFER (146 LF)
CANOPY TREES REQUIRED: 4
CANOPY TREES PROVIDED: 4

UNDERSTORY TREES REQUIRED: 7
UNDERSTORY TREES PROVIDED: 7

SHRUBS REQUIRED: 30
SHRUBS PROVIDED: 33

STREET TREE PLANTING (ART 5.6.13.)
TREES PROVIDED: 4 UNDERSTORY TREES @ 50' OC (NCDOT COMPLIANCE)

N/F
MARTHA L. OLIVE,
QUAD TRI LLC
D.B. 16161 PG. 1089 PIN
1796.20-92-1357

N/F
JAMI G. HASBROUCK
& IAN BERUBE
D.B. 17808 PG. 1288
PIN 1796.20-92-3317

N/F
MARTIN MENDOZA MORENO
D.B. 17583 PG. 779
PIN 1796.20-92-3375

N/F
SALVADOR LOPEZ
D.B. 5479 PG. 605
PIN 1796.20-92-4342

N/F
GLORIA ANN LANGSTON
D.B. 3216 PG. 561
PIN 1796.20-92-5286

N/F
WAKEFIELD CENTRAL
BAPTIST CHURCH
D.B. 15634 PG. 2561
PIN 1796.20-91-7959

N/F
TRUIST BANK
BM 2018 PG. 1740
PIN 1796.20-90-2666

PLANT SCHEDULE


TREES	CODE	QTY	BOTANICAL NAME	COMMON NAME	CALIPER	HEIGHT	B&B OR CONT.	FORM	SPACING (O.C.)	REMARKS
	AA	3	Acer x freemanii 'Armstrong'	Armstrong Freeman Maple	2 1/2"	10'	B&B		AS SHOWN	UTILITY ALLOCATION POLICY COMPLIANCE - CATEGORY 3
	AG	6	Amelanchier x grandiflora 'Autumn Brilliance'	Autumn Brilliance Apple Serviceberry	---	6'	B&B		AS SHOWN	3-5 TRUNKS
	CC2	4	Carpinus caroliniana 'CCMTF1'	Collynnair® American Hornbeam	2 1/2"	8'	B&B		AS SHOWN	UTILITY ALLOCATION POLICY COMPLIANCE - CATEGORY 3
	CC	15	Cercis canadensis 'NC2016-2'	Flame Thrower® Eastern Redbud	1 1/2"	6'	B&B		AS SHOWN	
	CK	2	Cladrastis kentukea	American Yellowwood	2 1/2"	10'	B&B		AS SHOWN	UTILITY ALLOCATION POLICY COMPLIANCE - CATEGORY 3
	IG2	17	Ilex opaca 'Tinga'	Tinga American Holly	---	6'	B&B		AS SHOWN	SINGLE TRUNK
	MG	25	Magnolia grandiflora 'Kay Parris'	Kay Parris Southern Magnolia	---	6'	B&B		AS SHOWN	SINGLE TRUNK
	NW	14	Nyssa sylvatica 'Wildfire'	Black Gum	2 1/2"	10'	B&B		AS SHOWN	
	PK	15	Pistacia chinensis 'Keith Davey'	Keith Davey Chinese Pistache	2 1/2"	10'	B&B		AS SHOWN	
SHRUBS	CODE	QTY	BOTANICAL NAME	COMMON NAME	CONTAINER	HEIGHT	SPREAD	TYPE	SPACING (O.C.)	REMARKS
	AT	15	Azalea encore 'Autumn Sundance'™	'Autumn Sundance' Encore Azalea	3 GAL.	18" MIN.	18" MIN.		AS SHOWN	
	CW	153	Camellia sasanqua 'Green 02-004'	October Magic® White Shi-Shi Camellia	3 GAL.	18" MIN.	18" MIN.		AS SHOWN	
	ICB	60	Ilex cornuta 'Dwarf Burford'	Dwarf Burford Holly	3 GAL.	18" MIN.	18" MIN.		AS SHOWN	
	IG	93	Ilex glabra 'Shamrock'	Shamrock Inkberry Holly	3 GAL.	18" MIN.	18" MIN.		AS SHOWN	
	LC	8	Loropetalum chinense rubrum 'Fire Dance'	Fire Dance Fringe Flower	5 GAL.	24" MIN.	24" MIN.		AS SHOWN	
	MC	10	Myrica cerifera	Wax Myrtle	7 GAL.	36"	24"		AS SHOWN	
GROUND COVERS	CODE	QTY	BOTANICAL NAME	COMMON NAME	CONTAINER	HEIGHT	SPREAD	TYPE	SPACING (O.C.)	REMARKS
	AT2	282 sf	POLLINATOR GARDEN							UTILITY ALLOCATION POLICY COMPLIANCE - CATEGORY 3
	BX	4	Asclepias tuberosa	Butterfly Milkweed	1 GAL.				12"	
	CA2	30	Buddleja x 'Lilac Cascade'	Lilac Cascade Butterfly Bush	1 GAL.				36"	
	CL	20	Centaurea montana 'Amethyst in Snow'	Amethyst in Snow Perennial Cornflower	1 GAL.				12"	
	EA	8	Coreopsis lanceolata	Lanceleaf Tickseed	1 GAL.				18"	
	HA	14	Echinacea purpurea	Echinacea Mix	1 GAL.				24"	
	LA	20	Helopsis helianthoides 'Asahi'	Double False Sunflower	1 GAL.				18"	
	SL	29	Leucanthemum maximum 'Jane'	Sweet Daisy™ Jane Shasta Daisy	1 GAL.				18"	
	SL	29	Schizachyrium scoparium	Little Bluestem	4" POT				15"	
	NT	1,622	Nassella tenuissima	Mexican Feather Grass	1 GAL.				15"	
TURF	CODE	QTY	BOTANICAL NAME	COMMON NAME	CONTAINER	HEIGHT	SPREAD	TYPE	SPACING (O.C.)	REMARKS
	TS	15,637 sf	Sod	Drought Tolerant Fescue Blend	---					TURF

PLANTING NOTES

- ROUGH GRADING TO BE COMPLETED PRIOR TO THE START OF PLANT INSTALLATION. SUBSTANTIAL COMPLETION SIGN-OFF BY LANDSCAPE ARCHITECT CONTRACTOR TO ENSURE NO CHANNELIZED FLOWS AROUND THE SITE.
- CONTRACTOR RESPONSIBLE FOR LOCATING ALL UTILITIES AND UNDERGROUND IMPEDIMENTS PRIOR TO BEGINNING PLANTING.
- ALL WEEDS, NON-NATIVE INVASIVE SPECIES, AND EXOTIC SPECIES LOCATED WITHIN THE PROJECT CONTRACTOR LIMITS SHALL BE ELIMINATED PRIOR TO PLANTING BED CREATION, PLANTING, AND SEEDING/SODDING OPERATIONS.
- PLANTING SHOULD OCCUR IMMEDIATELY AFTER CONSTRUCTION TO STABILIZE AREAS OF BARE SOIL.
- IT SHALL BE NOTED THAT ALL SECTIONS OF THE SITE THAT ARE SLOPED 3:1 OR HIGHER WILL BE COVERED WITH EROSION CONTROL STABILIZATION COIR FABRIC (WITH 1" SQUARE OPENINGS) PRIOR TO PLANTING TO ENSURE IMMEDIATE STABILIZATION. LANDSCAPE CONTRACTOR SHALL CUT FABRIC AT EACH PLANT LOCATION AND PLACE PLANTS ACCORDING TO PLAN. ALL FABRIC SHALL BE RE-STAKED PER ENGINEERS ORIGINAL DRAWINGS IMMEDIATELY AFTER PLANTING.
- PLANTS ARE TO BE PURCHASED BY BOTANICAL NAMES. THEY SHALL BE REPRESENTATIVE OF THEIR SPECIES, MEET ALL NOTED CONDITIONS OF SPECIFICATIONS, AND SHALL BE IN VIGOROUS GROWING CONDITION MEETING ANSI STANDARD Z60.
- LANDSCAPE ARCHITECT OR OWNER MAINTAINS RIGHT TO REJECT ANY PLANT DUE TO AESTHETICS OR STRUCTURAL DEFICIENCY AT ANY TIME.
- CONTRACTOR RESPONSIBLE FOR FURNISHING AND INSTALLING ALL PLANTS SHOWN ON PLANS IN LOCATIONS SHOWN. QUANTITIES GIVEN ON THE PLANT LEGEND ARE FOR CONTRACTOR'S CONVENIENCE ONLY. IF DISCREPANCIES OCCUR, THE PLANS SHALL OVERRULE THE PLANT LEGEND. CONTRACTOR SHALL LOCATE ALL PLANTS AWAY FROM KNOWN PERMANENT FIXTURES. IF CONFLICT ARISES WITH PLAN, CONTRACTOR SHALL NOTIFY PROJECT MANAGER OR DESIGNEE PRIOR TO PROCEEDING.
- ALL PLANT MATERIAL SHALL CONFORM TO OR EXCEED THE AMERICAN STANDARD FOR NURSERY STOCK (LATEST EDITION) AS PUBLISHED BY THE AMERICAN ASSOCIATION OF NURSERYMEN.
- ALL PLANT MATERIAL SHALL BE FREE OF ALL PESTS, DISEASES, AND CANKERS, IN HEALTHY CONDITION, AND FREE OF MECHANICAL DAMAGE AT THE TIME OF PLANTING.
- IT IS THE RESPONSIBILITY OF THE CONTRACTOR TO ENSURE A HEALTHY AND VIABLE PLANT AND THE PLANT SHALL BE REJECTED IF DEEMED UNHEALTHY OR UNFIT AT ANY TIME DURING THE CONTRACT OR WARRANTY DURATION.
- IF ANY PLANT/MATERIAL SUBSTITUTIONS ARE REQUESTED BY CONTRACTOR, THEN NOTICE SHALL BE GIVEN TO PROJECT MANAGER OR DESIGNEE AT MINIMUM SEVENTY-TWO (72) HOURS (NOT INCLUDING WEEKENDS) PRIOR TO DESIRED ORDERING DATE/TIME. WHEN SUBSTITUTIONS ARE REQUESTED BY CONTRACTOR, SUGGESTED ACCEPTABLE REPLACEMENTS SHALL ALSO BE PRESENTED AT TIME FOR FULL AND COMPLETE REVIEW BY LANDSCAPE ARCHITECT OR OWNER.
- BALLED AND BURLAPPED PLANTS/TREES TO BE PLANTED PRIOR TO CONTAINER OR BEDDING PLANTS.
- BALLED AND BURLAPPED MATERIAL SHALL COMPLY WITH THE FOLLOWING GUIDELINES:
 - TREES DESIGNATED B&B SHALL BE PROPERLY DUG WITH FIRM, NATURAL BALLS OF SOIL RETAINING AS MANY FIBROUS ROOTS AS POSSIBLE, IN SIZES AND SHAPES AS SPECIFIED IN THE AMERICAN STANDARD FOR NURSERY STOCK ANSI Z60.1.
 - ROOT BALLS SHALL BE FIRMLY WRAPPED WITH NONSYNTHETIC, ROTTABLE BURLAP AND SECURED WITH NAILS AND HEAVY, NONSYNTHETIC TWINE.
 - ROOT COLLAR SHALL BE APPARENT AT SURFACE OF BALL, OR THE CONTRACTOR WILL BE RESPONSIBLE FOR REMOVING EXCESS SOIL FROM THE TOP OF THE ROOTBALL.
 - REMOVE ALL BURLAP, LACING, AND WIRE BASKET FROM AT LEAST THE TOP 1/2 OF THE ROOTBALL AND DISCARD FROM PLANTING HOLE.
 - DO NOT MANEUVER BY TRUNK. HANDLE BY ROOT BALL ONLY.
- CONTAINERIZED PLANTS SHALL COMPLY WITH THE FOLLOWING GUIDELINES:
 - MATERIAL SHALL HAVE FIRM, NATURAL BALLS OF SOIL RETAINING AS MANY FIBROUS ROOTS AS POSSIBLE, IN SIZES AND SHAPES AS SPECIFIED IN THE AMERICAN STANDARD FOR NURSERY STOCK ANSI Z60.1
 - ROOT COLLAR SHALL BE APPARENT AT SURFACE OF BALL, OR THE CONTRACTOR WILL BE RESPONSIBLE FOR REMOVING EXCESS SOIL FROM THE TOP OF THE ROOTBALL.
 - REMOVE CONTAINER PRIOR TO PLANTING.
- TREES TO BE STAKED WILL BE DESIGNATED BY THE LANDSCAPE ARCHITECT. TREE STAKING FOR CANOPY AND LARGE EVERGREEN TREES SHALL NOT EXCEED 90 DAYS.
- PLANT BED PREPARATION:
 - ALL PLANT BEDS ARE TO RECEIVE A MINIMUM OF 4" OF APPROVED TOPSOIL TILLED IN TO A DEPTH OF 8" TO ENSURE INTEGRATION WITH EXISTING SOIL.
 - APPROVED TOPSOIL IS TO BE PREFERABLY FROM ON-SITE STOCKPILE FROM STRIPPING OPERATIONS - SEE EROSION AND SEDIMENT CONTROL PLANS.
 - IF ON-SITE TOPSOIL IS NOT AVAILABLE, CONTRACTOR SHALL PROVIDE TO SITE ACCORDINGLY.
- ALL MULCH TO BE CERTIFIED TO BE FREE OF WEEDS, NON-NATIVE INVASIVE SPECIES AND THEIR LARVAE. MULCH SAMPLE SUBMITTAL SHALL BE PROVIDED TO LANDSCAPE ARCHITECT BEFORE SITE DELIVERY.

SEEDING/SODDING NOTES


- ROUGH GRADING TO BE COMPLETED PRIOR TO THE START OF PLANT INSTALLATION. SUBSTANTIAL COMPLETION SIGN-OFF BY LANDSCAPE ARCHITECT CONTRACTOR TO ENSURE NO CHANNELIZED FLOWS AROUND THE SITE.
- ALL SEEDED/SODDED AREAS SHALL BE FINISHED GRADE AT THE THICKNESS OF THE SOD.
- NO SEEDED/SODDED AREAS SHALL BE SODDED UNTIL ALL OTHER CONSTRUCTION ACTIVITIES, INCLUDING PLANTING AND MULCHING HAVE OCCURRED AND LANDSCAPE ARCHITECT HAVE REVIEWED THE FINAL GRADING.
- SOD AREAS WILL BE ACCEPTED WHEN IN COMPLIANCE WITH ALL THE FOLLOWING CONDITIONS:
 - ROOTS ARE THOROUGHLY KNIT TO THE SOIL
 - ABSENCE OF VISIBLE JOINTS
 - ALL AREAS SHOW A UNIFORM STAND OF SPECIFIED GRASS IN HEALTHY CONDITION
 - AT LEAST 30 DAYS HAVE ELAPSED SINCE THE COMPLETION OF WORK UNDER THIS SECTION.
- QUALITY GUARANTEE:
 - SOD SHALL BE UNIFORM IN COLOR, LEAF TEXTURE, LEAF AND ROOT DENSITY, AND FREE FROM WEED, DISEASES, AND OTHER VISIBLE IMPERFECTIONS AT TIME OF FINAL ACCEPTANCE. GUARANTEE DOES NOT COVER DAMAGE AS A RESULT OF FERTILIZERS, PESTICIDES, OR OTHER APPLICATIONS NOT SUPERVISED BY THE CONTRACTOR OR AS A RESULT OF ACTS OF GOD OR VANDALISM.
 - SEED SHALL BE UNIFORM IN COLOR, LEAF TEXTURE, LEAF AND ROOT DENSITY, AND FREE FROM WEED, DISEASES, AND OTHER VISIBLE IMPERFECTIONS AT TIME OF FINAL ACCEPTANCE. GUARANTEE DOES NOT COVER DAMAGE AS A RESULT OF FERTILIZERS, PESTICIDES, OR OTHER APPLICATIONS NOT SUPERVISED BY THE CONTRACTOR OR AS A RESULT OF ACTS OF GOD OR VANDALISM.
- CONTRACTOR SHALL BE RESPONSIBLE FOR ENSURING THAT THE SEED/SOD IS PROPERLY IRRIGATED DURING THE GROW-IN PERIOD AND SHALL BE RESPONSIBLE IF THE SOD SUFFERS IRREPARABLE HARM.
- SEED/SOD IS SUBJECT TO INSPECTION AND ACCEPTANCE. LANDSCAPE ARCHITECT AND/OR CLIENT RESERVES THE RIGHT TO REJECT AT ANY TIME OR PLACE PRIOR TO ACCEPTANCE. ANY WORK AND SOD WHICH IN THE LANDSCAPE ARCHITECTS OPINION FAILS TO MEET THESE SPECIFICATIONS REQUIREMENTS.
- SOD STANDARDS:
 - GENERAL: HEALTHY, THICK TURF HAVING UNDERGONE A PROGRAM OF REGULAR FERTILIZATION, MOWING AND WEED CONTROL, FREE OF OBJECTABLE WEEDS; UNIFORM IN GREEN COLOR, LEAF TEXTURE AND DENSITY; HEALTHY, VIGOROUS ROOT SYSTEM; INSPECTED AND FOUND FREE OF DISEASE, NEMATODES, PEST AND PEST LARVAE BY THE ENTOMOLOGIST OF THE STATE DEPARTMENT OF AGRICULTURE.
 - EACH PIECE OF SOD: SANDY-LOAM SOIL BASE THAT WILL NOT BREAK, CRUMBLE OR TEAR DURING SOD INSTALLATION.
 - THICKNESS: MINIMUM 3/4" THICK, EXCLUDING THE TOP GROWTH THATCH.
 - THATCH: NOT TO EXCEED 1/2" UNCOMPRESSED.
 - SIZE: CUT IN STRIPS 18" WIDE NO MORE THAN 24 HOURS PRIOR TO DELIVERY.
- SOD DELIVERY, STORAGE AND HANDLING GUIDELINES ARE AS FOLLOWS:
 - SOD SHALL BE DELIVERED ON PALLETS PROPERLY LOADED ON VEHICLES AND WITH ROOT SYSTEM PROTECTED FROM EXPOSURE TO SUN, WIND, AND HEAT IN ACCORDANCE WITH STANDARD PRACTICE AND LABELED WITH BOTANICAL AND COMMON NAME OF EACH GRASS SPECIES IN ACCORDANCE WITH FEDERAL SEED ACT. SOD THAT HAS BEEN DAMAGED BY POOR HANDLING OR IMPROPER STORAGE IS SUBJECT TO REJECTION BY THE LANDSCAPE ARCHITECT OR OWNER.
 - PROTECT FROM DEHYDRATION, CONTAMINATION, FREEZING AND HEATING AT ALL TIMES. KEEP STORED SOD MOIST AND UNDER SHADE OR COVERED WITH MOISTENED BURLAP.
 - DO NOT DROP SOD ROLLS FROM CARTS, TRUCKS OR PALLETS.
 - DO NOT DELIVER MORE SOD THAN CAN BE INSTALLED WITHIN 36 HOURS.
 - DO NOT STACK SOD MORE THAN 2 FEET DEEP.
- SEED/SODDED BED PREPARATION:
 - ALL DEBRIS, ROCKS, ETC. LARGER THAN .5" ARE TO BE REMOVED PRIOR TO SEEDING/SODDING OR PLANTING.
 - ALL AREAS TO BE SEEDED/SODDED ARE TO RECEIVE A MINIMUM OF 2" OF APPROVED TOPSOIL TILLED INTO A DEPTH OF 4" TO ENSURE INTEGRATION WITH EXISTING SOIL.
 - APPROVED TOPSOIL IS TO BE PREFERABLY FROM ON-SITE STOCKPILE FROM STRIPPING OPERATIONS - SEE EROSION AND SEDIMENT CONTROL PLANS.
 - IF ON-SITE TOPSOIL IS NOT AVAILABLE, CONTRACTOR SHALL PROVIDE TO SITE ACCORDINGLY.

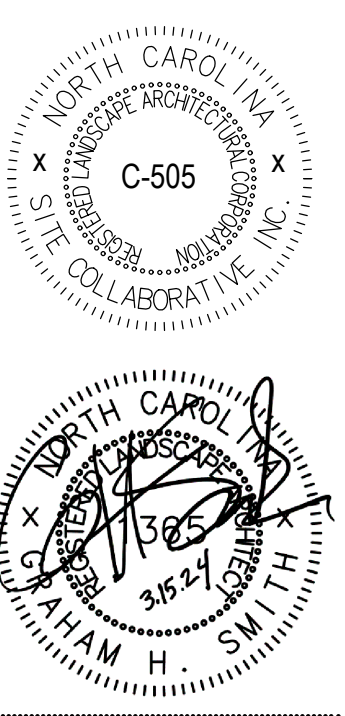

REUSE OF DOCUMENT
This document is the property of Site Collaborative Inc. The ideas and design incorporated on this document is an instrument of professional service and shall not be used for any other project without written authorization of Site Collaborative Inc.

ZEBULON ANIMAL HOSPITAL
ZAH REALTY, LLC
1620 N. ARENDELL AVE., ZEBULON, NC


PROJECT NUMBER: 22091
PROJECT PHASE: CONSTRUCTION DRAWINGS
DATE: 10.02.2023
REVISED: 11.20.2023
REVISED: 1.5.2024
REVISED: 2.1.2024
3.4.2024 PER NCDOT
REVISED: 3.15.2024
REVISED: 6.4.2024
SHEET TITLE: PLANT SCHEDULE AND NOTES
SHEET NUMBER: L401

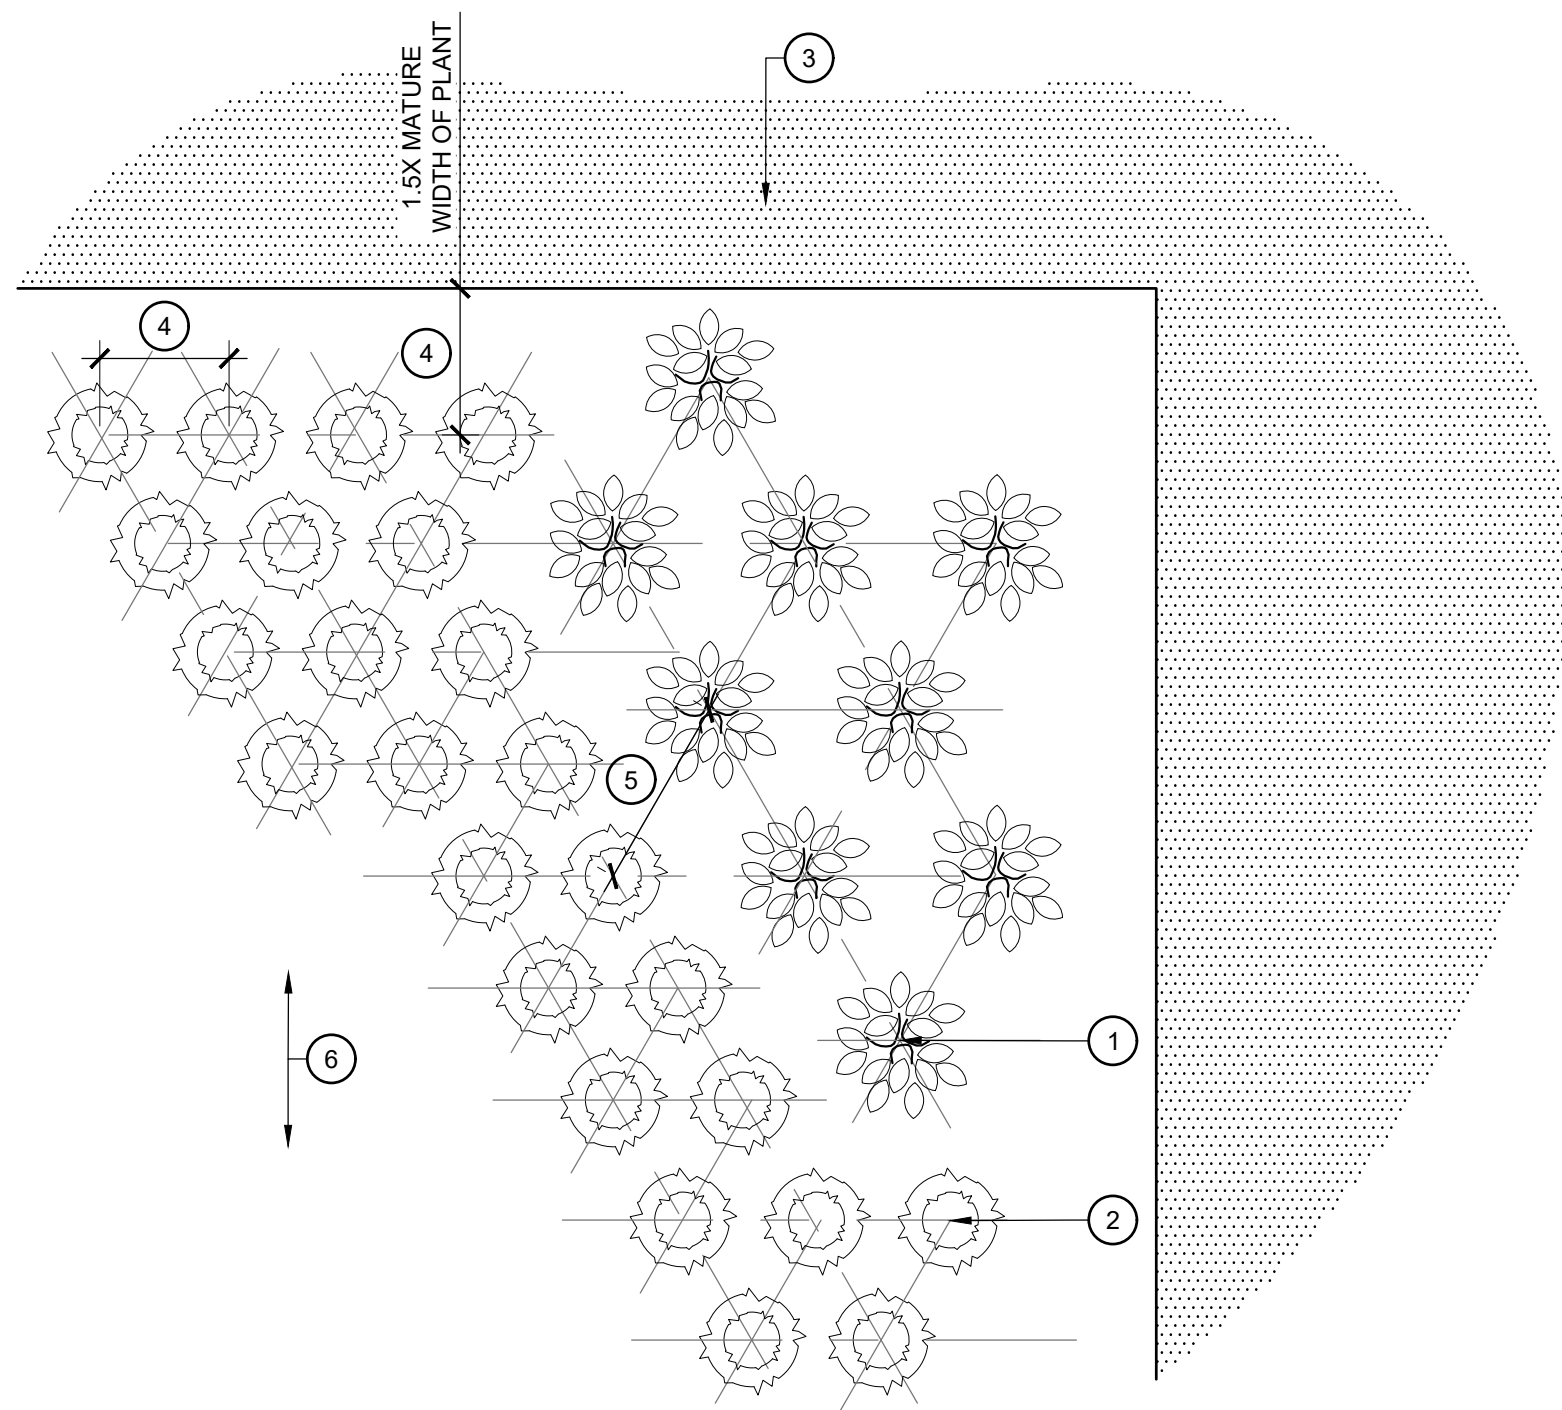

PLAN VIEW

- LEGEND**
1. PLANT TYPE 1
 2. PLANT TYPE 2
 3. ADJACENT PAVING, WALL, OR OTHER OBSTRUCTION
 4. ON CENTER SPACING BETWEEN INDIVIDUAL PLANTS; DISTANCE VARIES PER PLANT TYPE, REFER TO LEGEND
 5. WHERE DISTINCT PLANT TYPES ARE ADJACENT, PROVIDE THE GREATER O.C. SPACING DISTANCE
 6. ORIENTATION OF TRIANGULAR SPACING TO SLOPES

1 PLANT SPACING
SCALE: 1" = 1'-0"

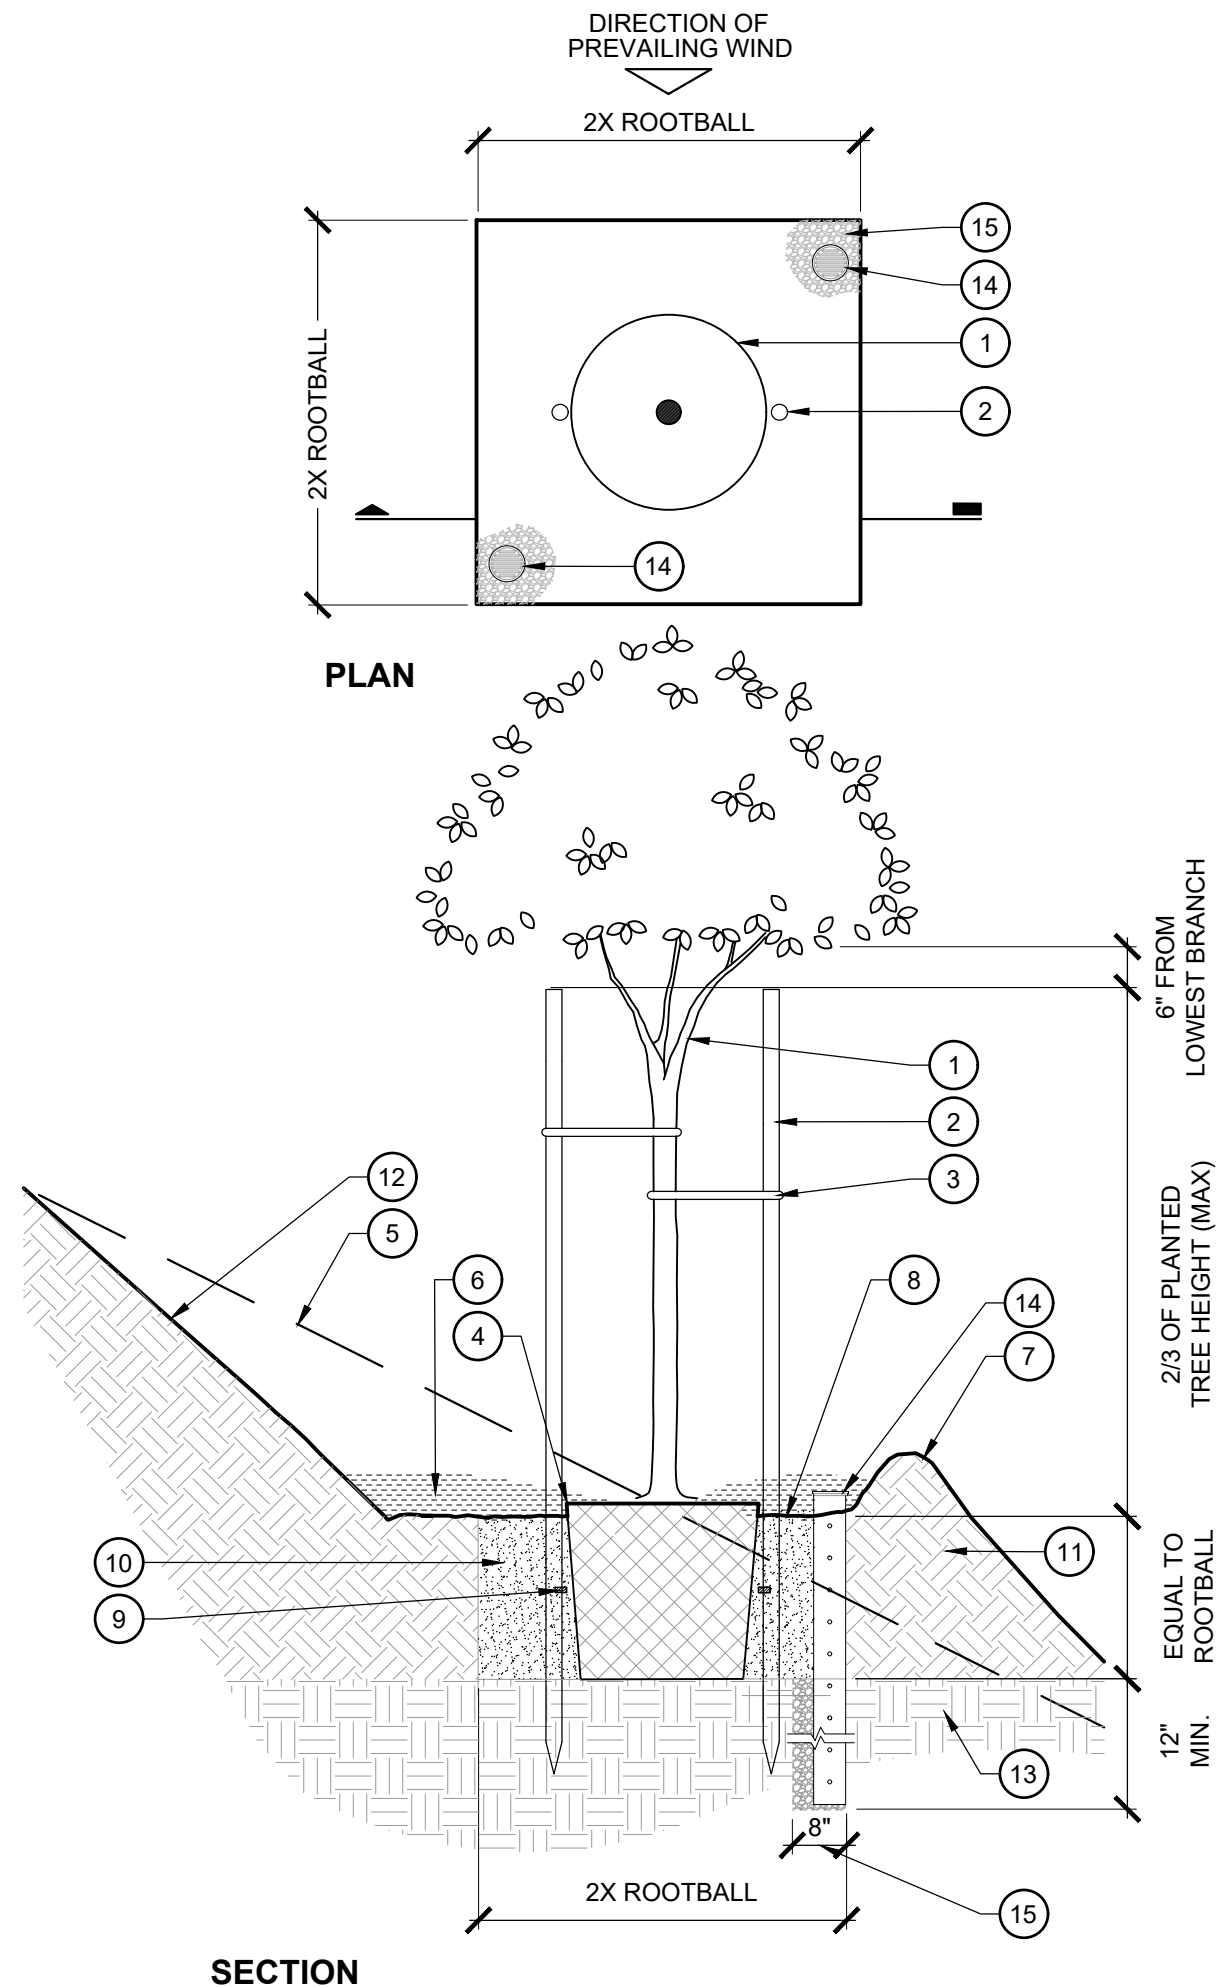


SECTION

2 SLOPE TREE PLANTING
SCALE: 1/2" = 1'-0"

- LEGEND**
1. TREE AND ROOTBALL PER PLAN
 2. TREE STAKES PER SPECIFICATIONS
 3. TREE TIES PER SPECIFICATIONS
 4. SET ROOTBALL AT 2" ABOVE FINISH GRADE AT EXISTING SLOPE LEVEL
 5. LINE OF SLOPE BEYOND/OR EXISTING SLOPE
 6. MULCH PER SPECIFICATIONS
 7. 4" HIGH EARTH BERM AT EDGE OF PLANT PIT, FIRMLY COMPACTED
 8. PLANT PIT, FIRMLY COMPACTED
 9. PLANT FERTILIZER PER SPECIFICATIONS. INSTALL SO THAT THEY DO NOT TOUCH ROOTBALL
 10. PLANTING BACKFILL MIX PER SPECIFICATIONS
 11. RIPPED AND RECOMPACTED SOIL AMENDED PER SPECIFICATIONS
 12. LAYBACK SLOPE BEHIND PLANT PIT AS NEEDED TO PREVENT SOIL SLUFFING.
 13. EXISTING UNDISTURBED SOIL
 14. 4" DIAMETER AERATION/BREATHER TUBES WITH GRATE CAPS PER SPECIFICATIONS. WRAP PIPE IN FILTER FABRIC SOCK, KNOTTED AT THE TOP. LEAVE AERATION TUBE HOLLOW. ONLY REQUIRED IF PERCOLATION TESTS FAIL - REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
 15. 8" DIA. AUGER DRAINAGE SUMP BACKFILLED WITH 3/4" CRUSHED ROCK ONLY REQUIRED IF PERCOLATION TESTS FAIL - REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION

- NOTES**
- A. THIS DETAIL USED FOR SLOPES AT 2:1 AND GREATER
 - B. REFER TO PLANTING SPECIFICATION FOR ADDITIONAL INFORMATION
 - C. KEEP MULCH 12" AWAY FROM STEMS AND TAPER AT ROOTBALL
 - D. TAPER MULCH TO 2" DEPTH AT FLATWORK
 - E. SET ROOTBALL ON COMPACTED SOIL

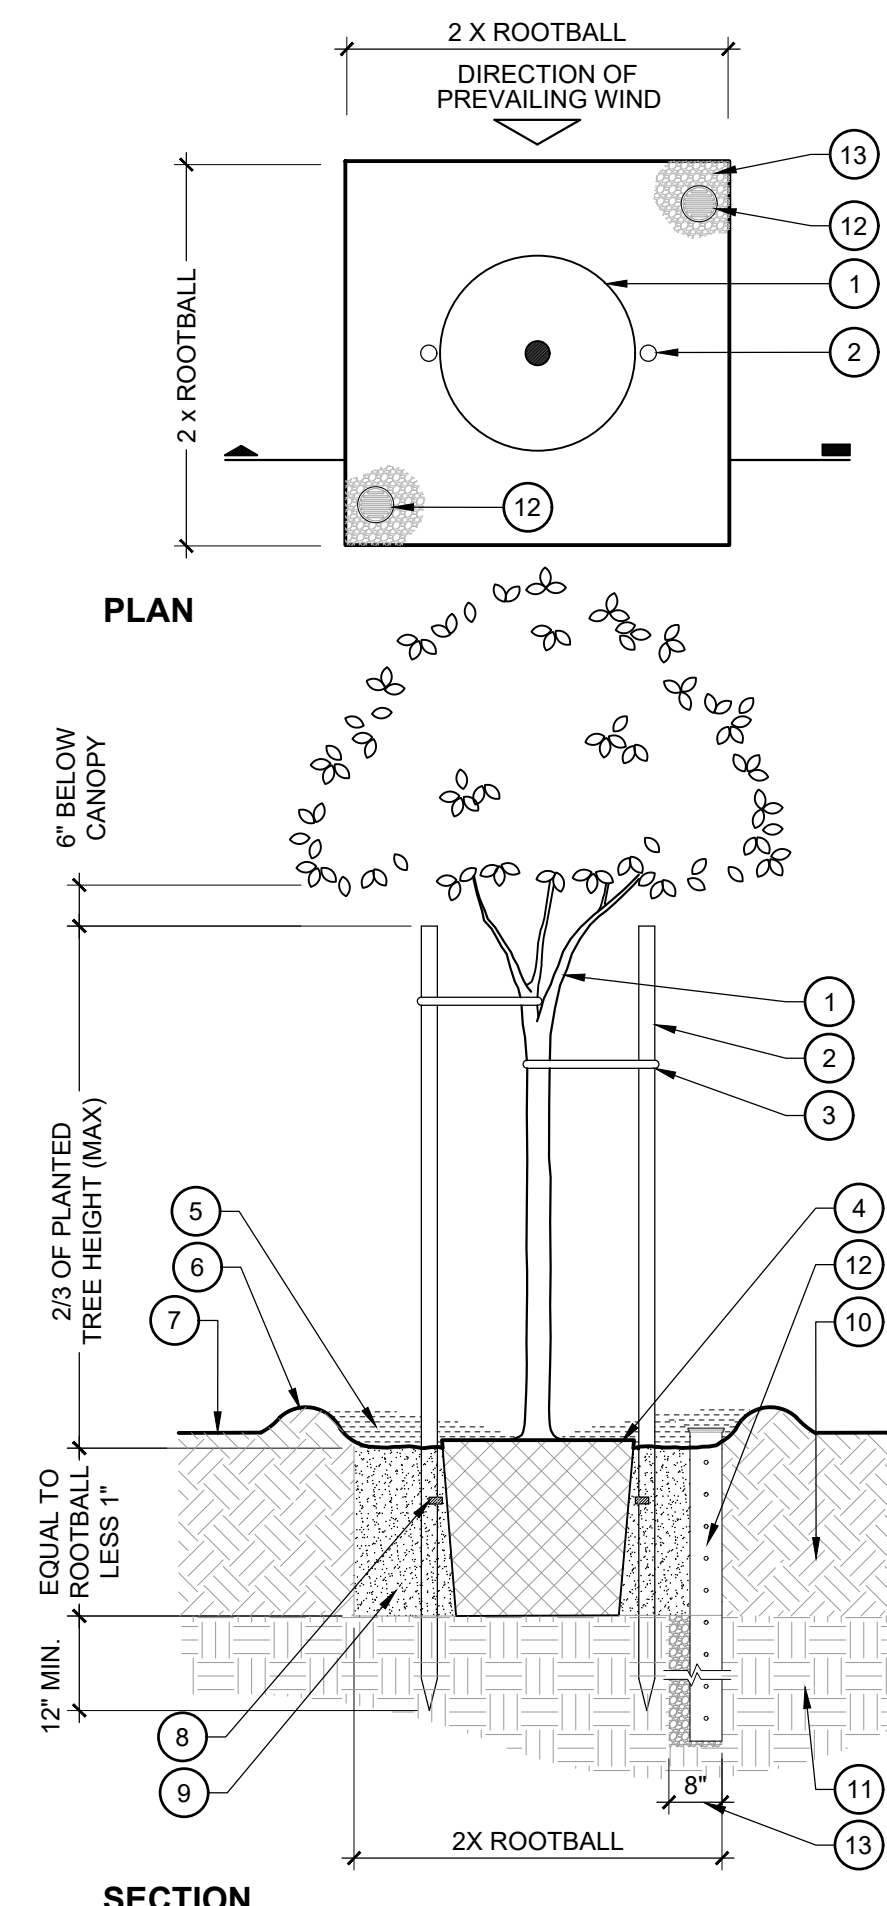


SECTION

3 LEVEL TREE PLANTING
SCALE: 1/2" = 1'-0"

- LEGEND**
1. TREE AND ROOTBALL PER PLAN
 2. TREE STAKES PER SPECIFICATIONS
 3. TREE TIES PER SPECIFICATIONS
 4. SET ROOTBALL AT 2" ABOVE FINISH GRADE AT EXISTING SLOPE LEVEL
 5. MULCH PER SPECIFICATIONS
 6. 4" HIGH EARTH BERM AT EDGE OF PLANT PIT, FIRMLY COMPACTED
 7. FINISHED GRADE
 8. PLANT FERTILIZER PER SPECIFICATIONS. INSTALL SO THAT THEY DO NOT TOUCH ROOTBALL
 9. PLANTING BACKFILL MIX PER SPECIFICATIONS
 10. RIPPED AND RECOMPACTED SOIL AMENDED PER SPECIFICATIONS
 11. EXISTING UNDISTURBED SOIL
 12. 4" DIAMETER AERATION/BREATHER TUBES WITH GRATE CAPS PER SPECIFICATIONS. WRAP PIPE IN FILTER FABRIC SOCK, KNOTTED AT THE TOP. LEAVE AERATION TUBE HOLLOW. ONLY REQUIRED IF PERCOLATION TESTS FAIL - REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION
 13. 8" DIA. AUGER DRAINAGE SUMP BACKFILLED WITH 3/4" CRUSHED ROCK ONLY REQUIRED IF PERCOLATION TESTS FAIL - REFER TO SPECIFICATIONS FOR ADDITIONAL INFORMATION


- NOTES**
- A. REFER TO PLANTING SPECIFICATION FOR ADDITIONAL INFORMATION
 - B. KEEP MULCH 12" AWAY FROM STEMS AND TAPER AT ROOTBALL
 - C. TAPER MULCH TO 2" DEPTH AT FLATWORK
 - D. SET ROOTBALL ON COMPACTED SOIL

- LEGEND**
1. GROUND COVER PLANT
 2. TRIANGULAR SPACING (TYP.), UNLESS OTHERWISE SPECIFIED
 3. SPACING INDICATED PER PLANTING LEGEND
 4. SET ROOTCROWN ABOVE FINISH GRADE
 5. MULCH PER SPECIFICATIONS
 6. ROOTBALL
 7. FINISH GRADE
 8. PLANT FERTILIZER PER SPECIFICATIONS. INSTALL SO THAT THEY DO NOT TOUCH ROOTBALL
 9. ADJACENT FINISHED SURFACE PER HARDSCAPE PLAN

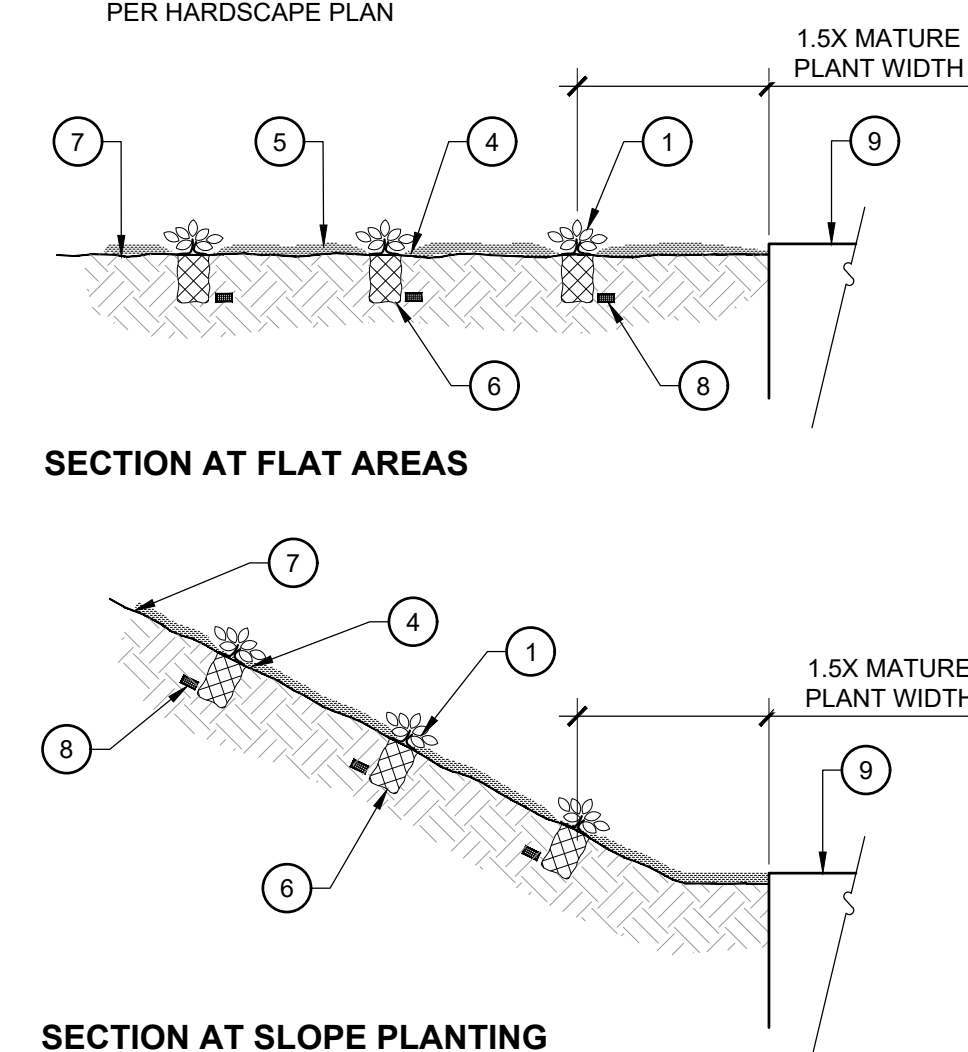


SECTION AT SLOPE PLANTING

4 GROUND COVER PLANTING
SCALE: 1" = 1'-0"

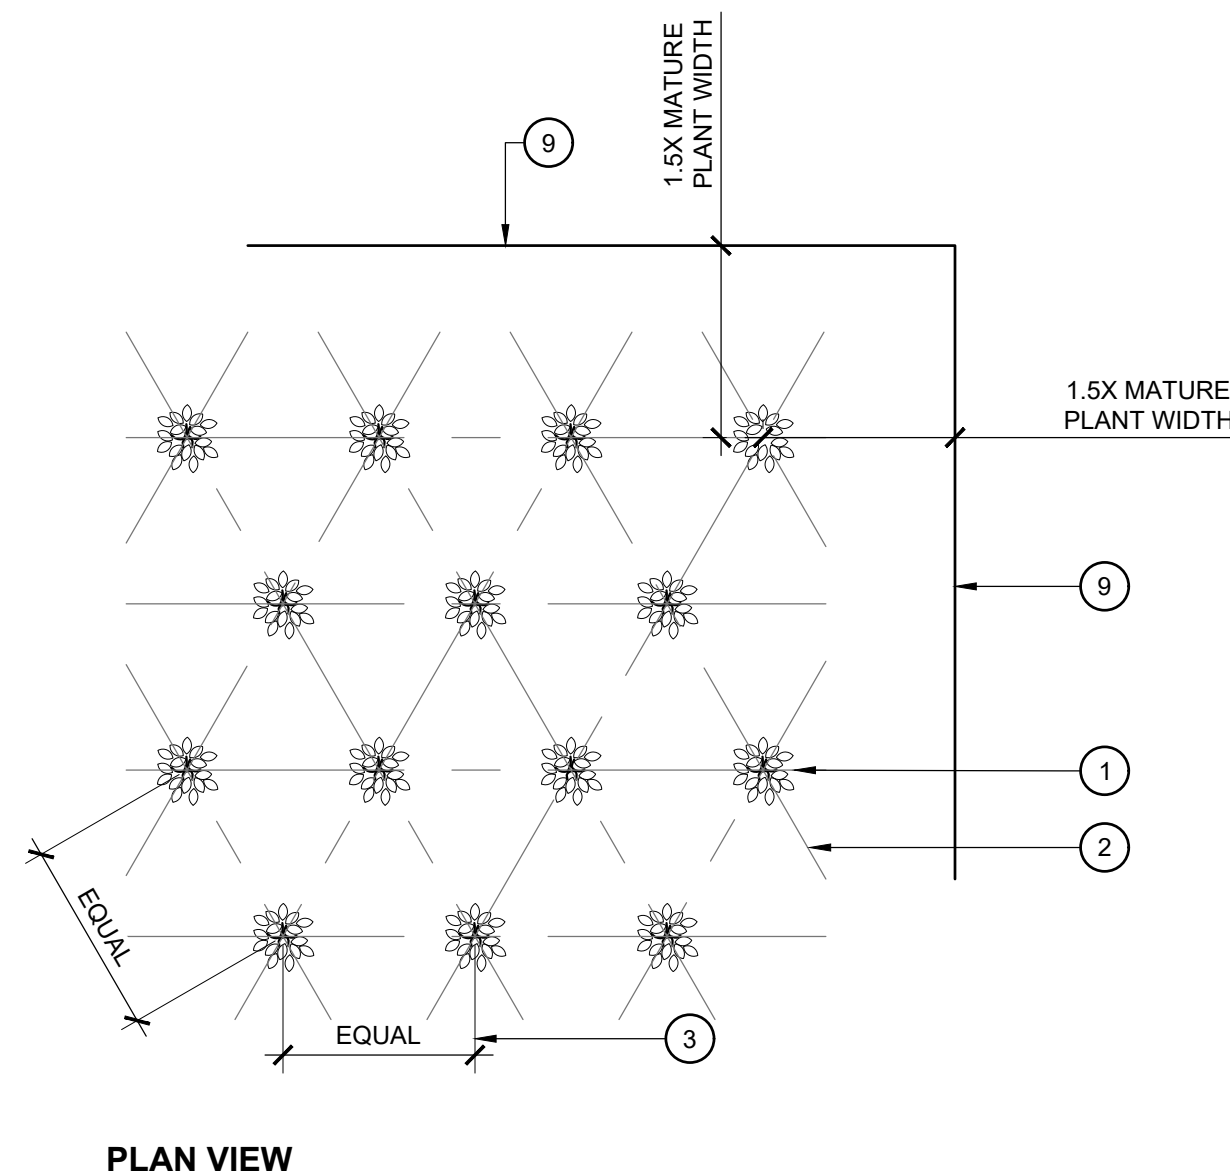


PLAN VIEW

- LEGEND**
1. SHRUB PER PLANS
 2. SET ROOTBALL CROWN 1" ABOVE FINISH GRADE
 3. 6" TALL EARTH BERM @ EDGE OF PLANT PIT
 4. FINISH GRADE
 5. PLANT FERTILIZER PER SPECIFICATIONS. INSTALL SO THAT THEY DO NOT TOUCH ROOTBALL
 6. AMENDED BACKFILL MIX PER SPECIFICATIONS
 7. LAYBACK SLOPE BEHIND PLANT PIT
 8. LINE OF SLOPE BEYOND COMPACTED SUBGRADE PER GEOTECHNICAL REPORT
 9. MULCH PER SPECIFICATIONS
 10. KEEP MULCH 4" - 6" FROM TRUNK, STEMS, AND TAPER AT ROOTBALL
 11. AMENDED PLANTING SOIL PER SPECIFICATIONS

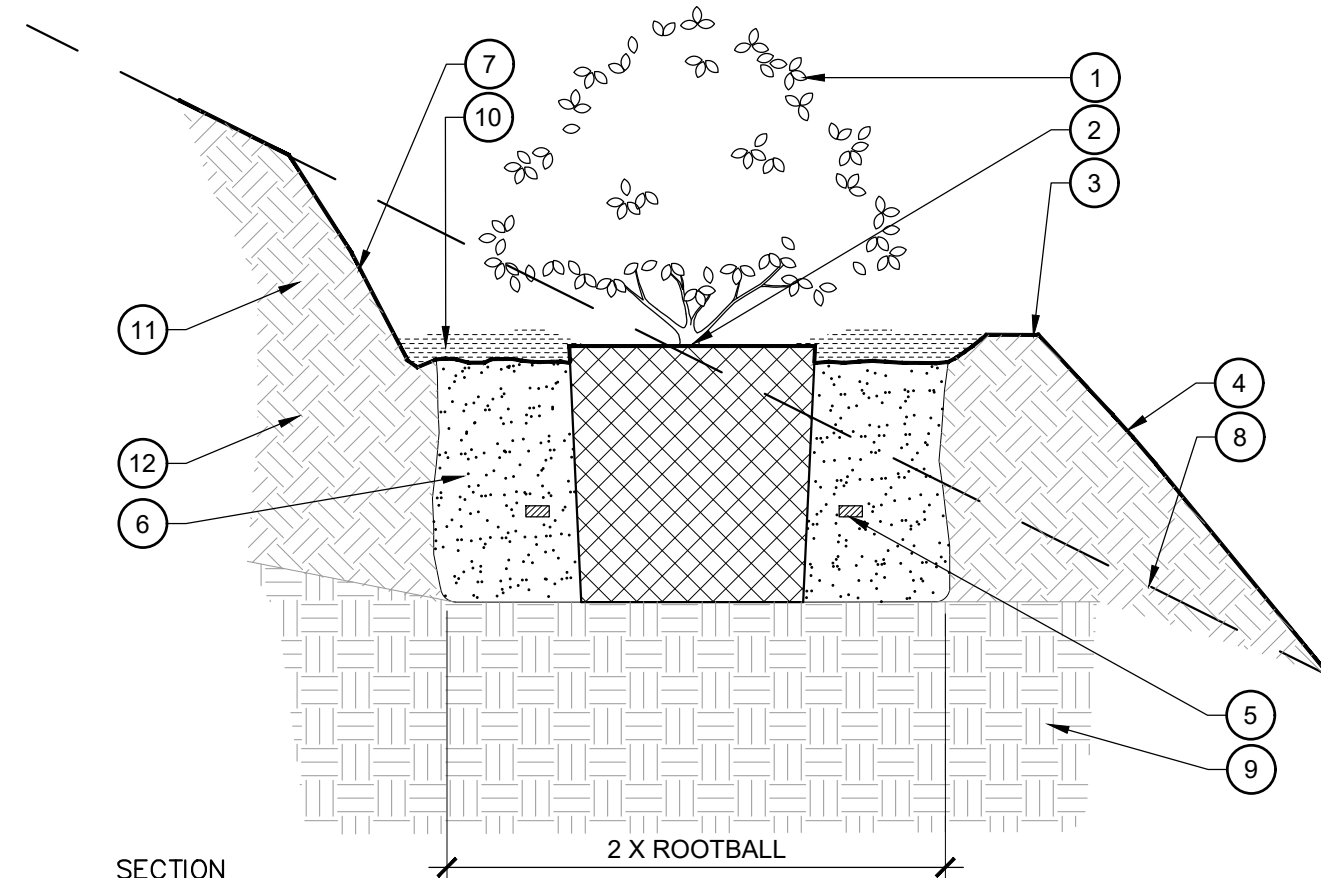

SECTION

5 SLOPE SHRUB PLANTING
SCALE: 1" = 1'-0"

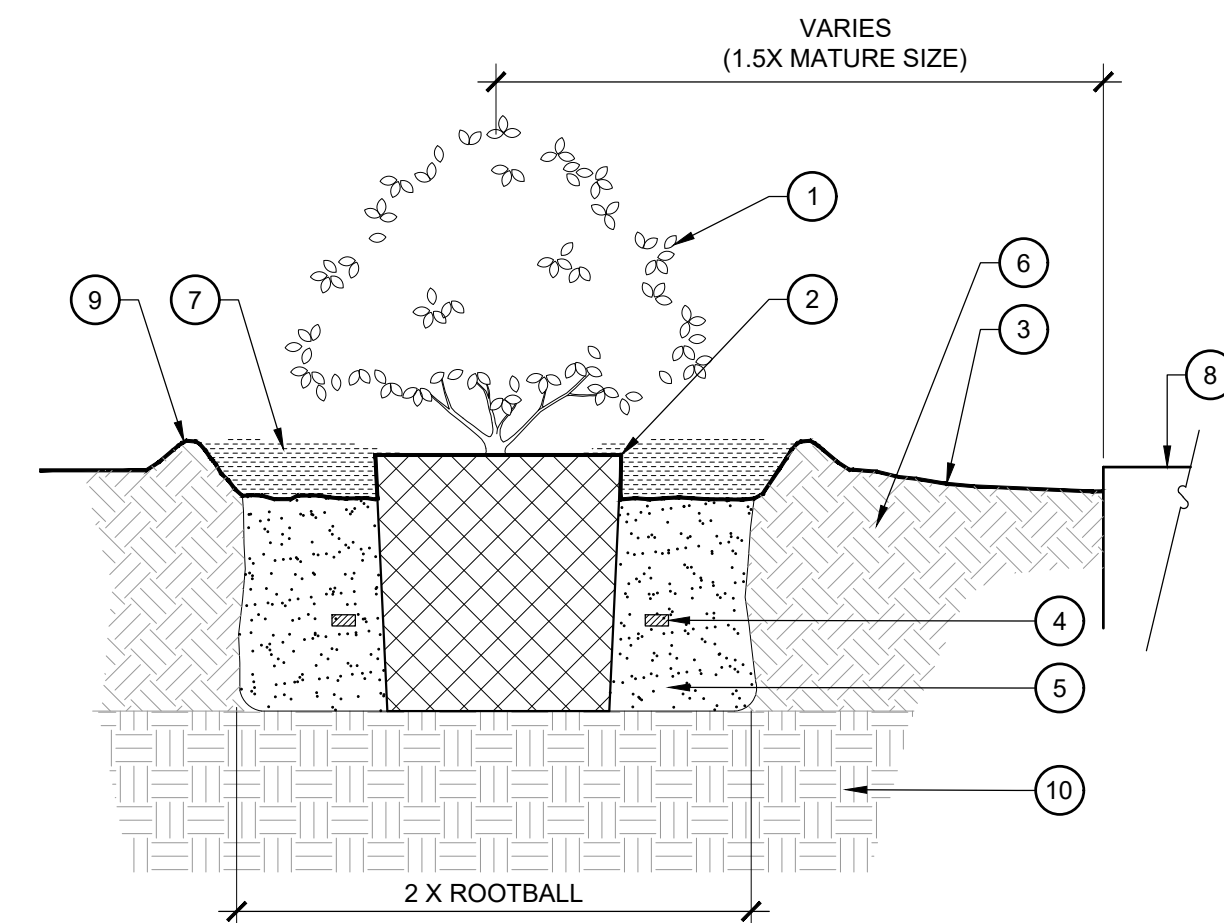

SECTION


6 LEVEL SHRUB PLANTING
SCALE: 1" = 1'-0"

- LEGEND**
1. SHRUB PER PLANS
 2. SET ROOTBALL CROWN 1" ABOVE FINISH GRADE
 3. FINISH GRADE
 4. PLANT FERTILIZER PER SPECIFICATIONS. INSTALL SO THAT THEY DO NOT TOUCH ROOTBALL
 5. AMENDED BACKFILL MIX PER SPECIFICATIONS
 6. COMPACTED SUBGRADE PER GEOTECHNICAL REPORT
 7. MULCH PER SPECIFICATIONS; KEEP MULCH 4" - 6" FROM TRUNK, STEMS, AND TAPER AT ROOTBALL
 8. ADJACENT FINISHED SURFACE PER HARDSCAPE PLAN
 9. 4" TALL EARTH BERM @ EDGE OF PLANT PIT, FIRMLY COMPACTED
 10. AMENDED PLANTING SOIL PER SPECIFICATIONS

IMPERVIOUS AREA BREAKDOWN

ON SITE - TOTAL IMPERVIOUS:
 TRANSPORTATION IMPERVIOUS: 16,802 SF± (0.39 AC±)
 BUILDING: 6,142 SF± (0.14 AC±)
 SIDEWALK: 2,332 SF± (0.05 AC±)

OFF SITE - ADDITIONAL IMPERVIOUS:
 TRANSPORTATION IMPERVIOUS: 5,018 SF± (0.12 AC±)
 SIDEWALK: 1,661 SF± (0.04 AC±)

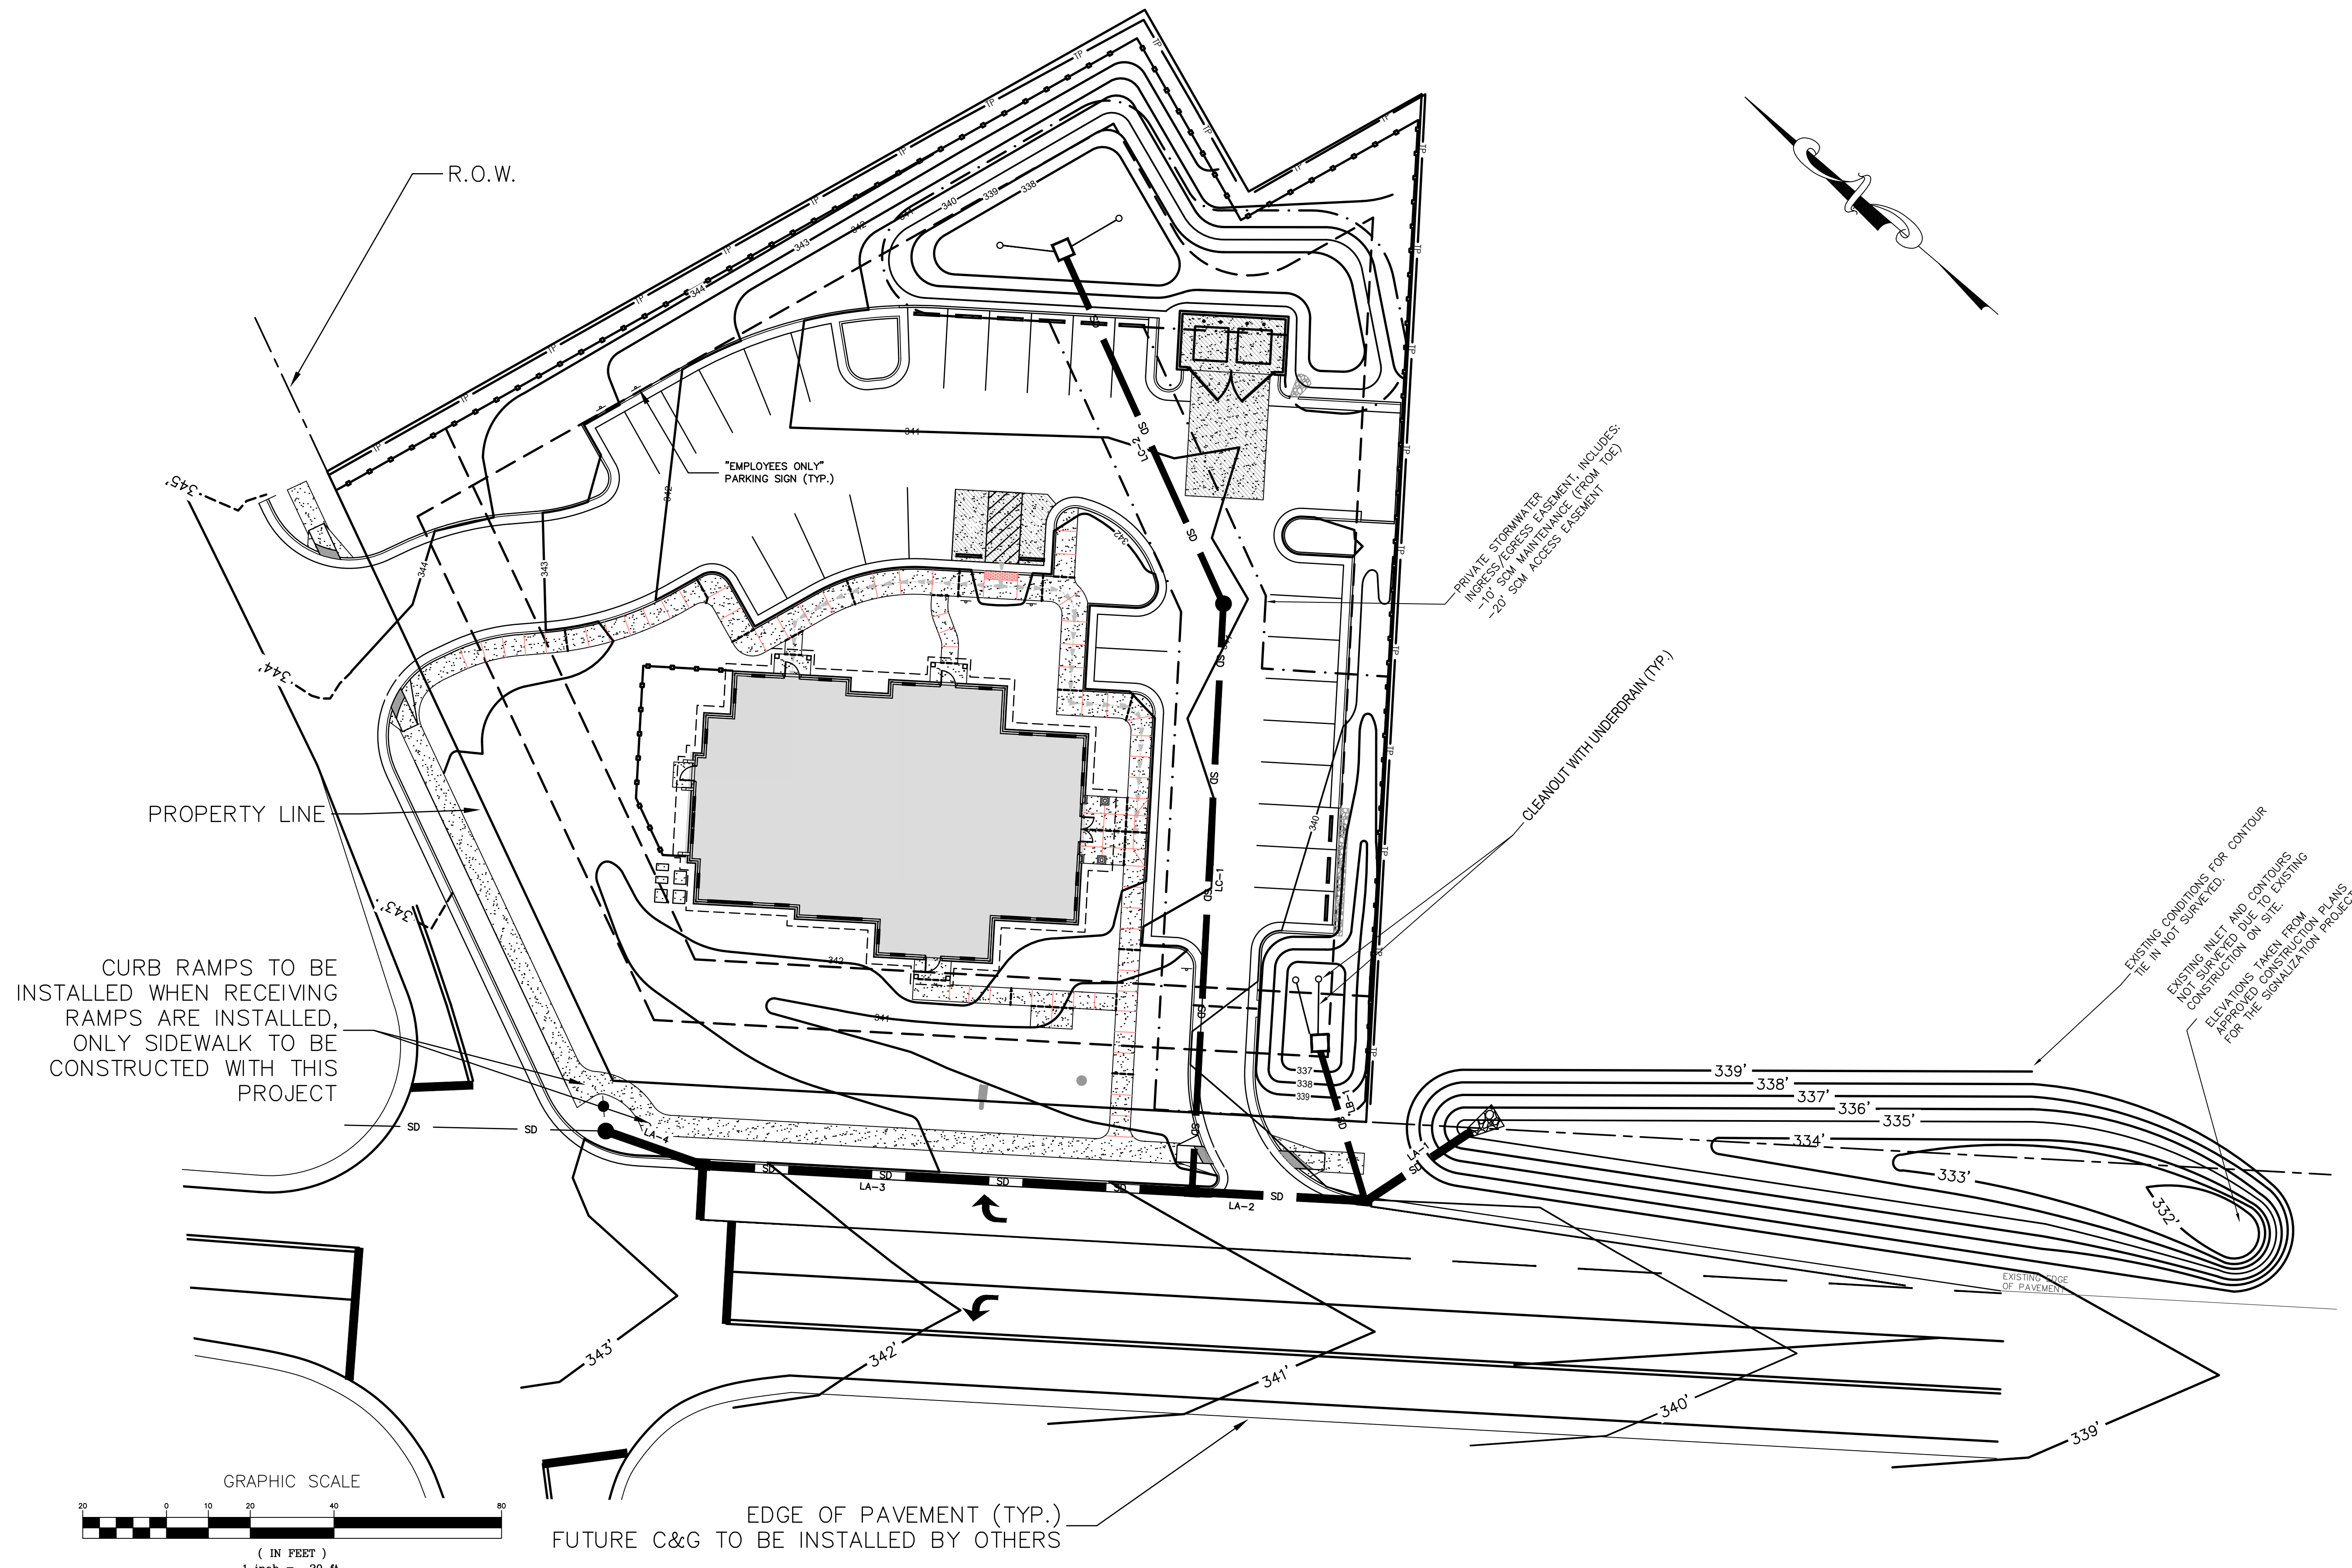

ZEBULON ANIMAL HOSPITAL
 DVM SERVICES REALTY, LLC

PROJECT NUMBER:

PROJECT PHASE:


DATE: 6/04/2024

SHEET TITLE:

OVERALL PLAN

SHEET NUMBER:

OV1

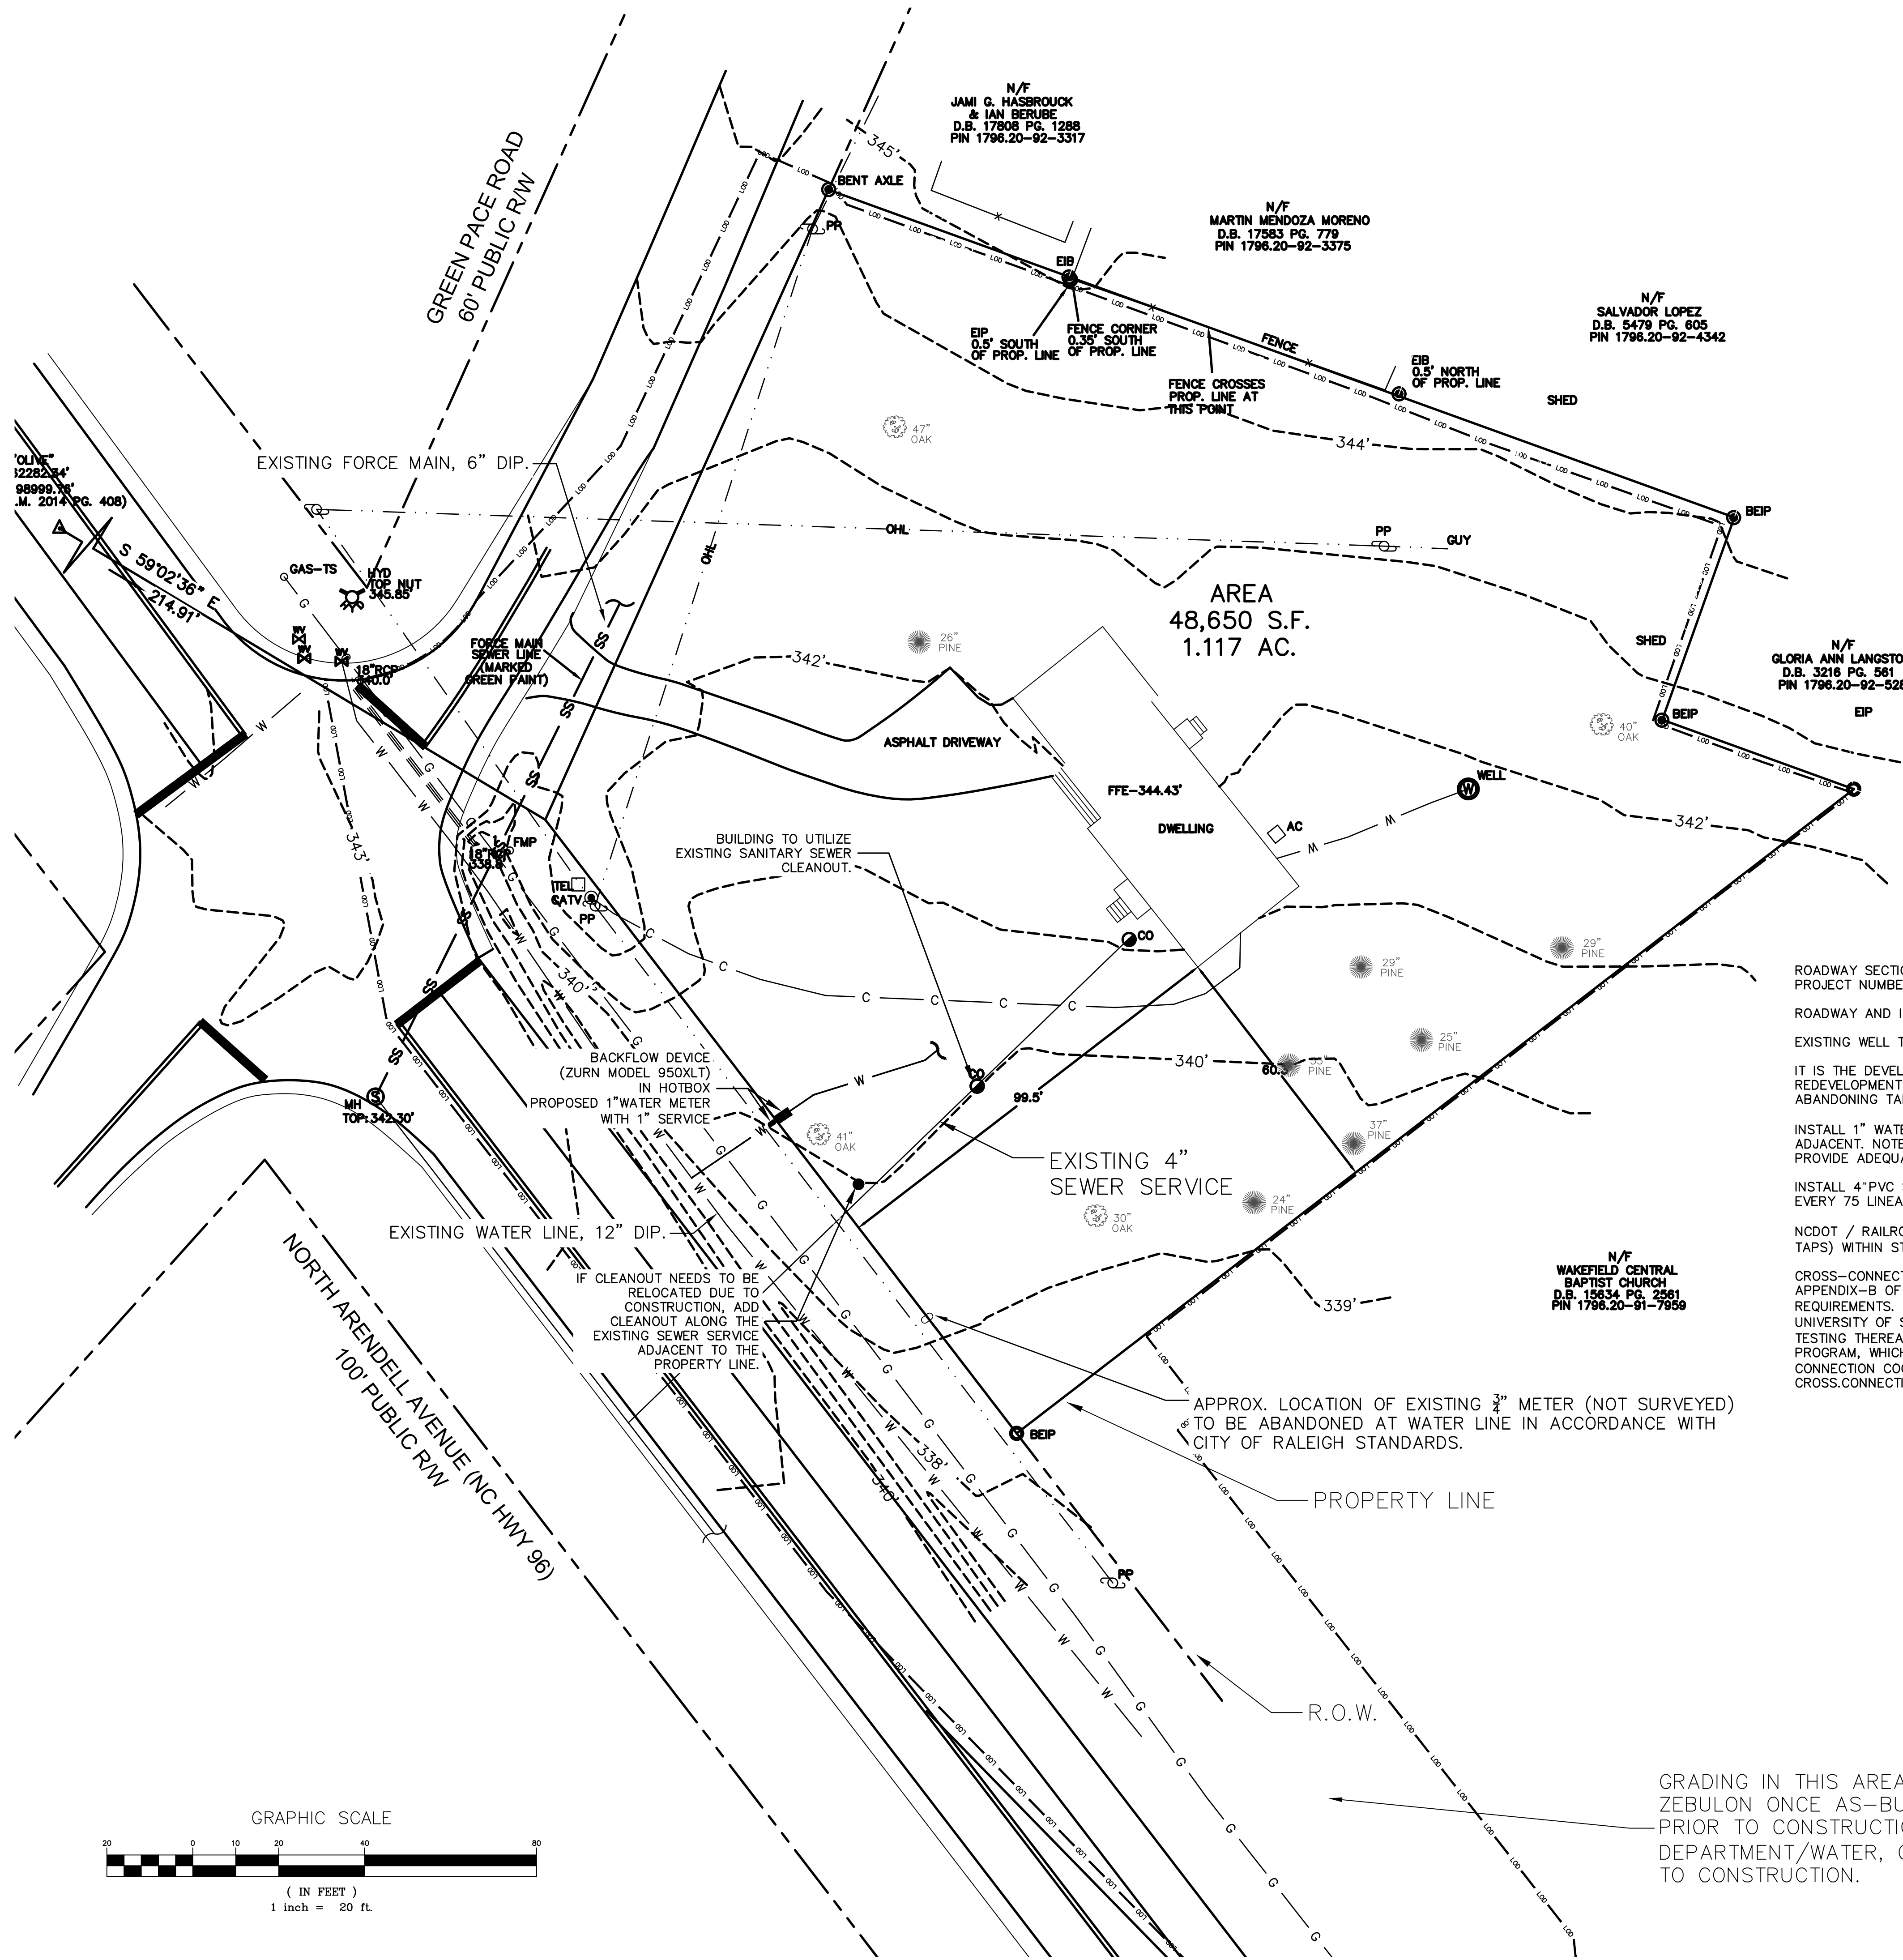

ATTENTION CONTRACTORS
 The Construction Contractor responsible for the extension of water, sewer, and/or reuse, as approved in these plans, is responsible for contacting the Public Utilities Department at (919) 996-4540 at least twenty four hours prior to beginning any of their construction.

Failure to notify both City Departments in advance of beginning construction, will result in the issuance of monetary fines, and require reinstallation of any water or sewer facilities not inspected as a result of this notification failure.

Failure to call for Inspection, Install a Downstream Plug, have Permitted Plans on the Jobsite, or any other Violation of City of Raleigh Standards will result in a Fine and Possible Exclusion from future work in the City of Raleigh.

ROADWAY SECTIONS, ELEVATIONS, AND STATIONS FOR THE ROADWAY EXISTING CONDITIONS DESIGNED BY VOLKERT INC. FOR STATE PROJECT NUMBER: 1086100.160.

ROADWAY AND INTERSECTION IMPROVEMENTS TO BE CONSTRUCTED BY OTHERS.

EXISTING WELL TO NOT BE CONNECTED TO BUILDING. WELL CAN BE USED FOR IRRIGATION.


IT IS THE DEVELOPER'S RESPONSIBILITY TO ABANDON OR REMOVE EXISTING WATER & SEWER SERVICES NOT BEING USED IN REDEVELOPMENT OF A SITE UNLESS OTHERWISE DIRECTED BY THE CITY OF RALEIGH PUBLIC UTILITIES DEPARTMENT. THIS INCLUDES ABANDONING TAP AT MAIN & REMOVAL OF SERVICE FROM R.O.W. OR EASEMENT PER CORPUD HANDBOOK PROCEDURE.

INSTALL 1" WATER SERVICES WITH METER LOCATED AT ROW OR WITHIN A 2'X2' WATERLINE EASEMENT IMMEDIATELY ADJACENT. NOTE: IT IS THE APPLICANT'S RESPONSIBILITY TO PROPERLY SIZE THE WATER SERVICE FOR EACH CONNECTION TO PROVIDE ADEQUATE FLOW & PRESSURE.



INSTALL 4" PVC SEWER SERVICE @ 1.0% MINIMUM GRADE WITH CLEANOUTS LOCATED AT R.O.W. OR EASEMENT LINE & SPACED EVERY 75 LINEAR FEET MAXIMUM.

NCDOT / RAILROAD ENCROACHMENT AGREEMENTS ARE REQUIRED FOR ANY UTILITY WORK (INCLUDING MAIN EXTENSIONS & SERVICE TAPS) WITHIN STATE OR RAILROAD R.O.W. PRIOR TO CONSTRUCTION

CROSS-CONNECTION CONTROL PROTECTION DEVICES ARE REQUIRED BASED ON DEGREE OF HEALTH HAZARD INVOLVED AS LISTED IN APPENDIX-B OF THE RULES GOVERNING PUBLIC WATER SYSTEMS IN NORTH CAROLINA. THESE GUIDELINES ARE THE MINIMUM REQUIREMENTS. THE DEVICES SHALL MEET AMERICAN SOCIETY OF SANITARY ENGINEERING (ASSE) STANDARDS OR BE ON THE UNIVERSITY OF SOUTHERN CALIFORNIA APPROVAL LIST. THE DEVICES SHALL BE INSTALLED AND TESTED (BOTH INITIAL AND PERIODIC TESTING THEREAFTER) IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS OR THE LOCAL CROSS-CONNECTION CONTROL PROGRAM, WHICHEVER IS MORE STRINGENT. A CERTIFICATE OF COMPLIANCE SHALL ALSO BE OBTAINED FROM THE RW CROSS-CONNECTION COORDINATOR FOR EACH DEVICE PRIOR TO ISSUANCE OF A UC / BLDG PERMIT. CONTACT (919) 996-5923 OR CROSS.CONNECTION@RALEIGHNC.GOV FOR MORE INFORMATION.



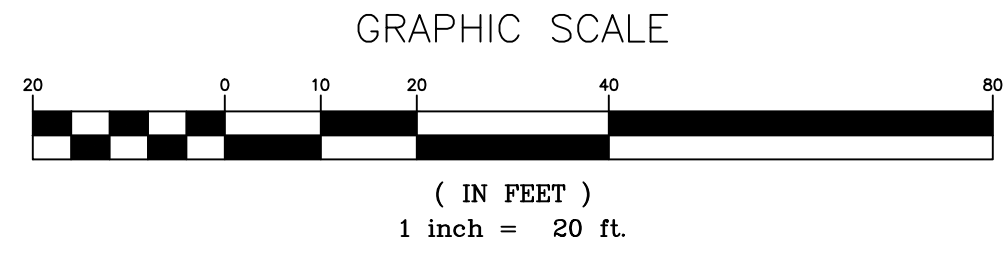



GRADING IN THIS AREA WILL BE UPDATED WITH INFORMATION FROM TOWN OF ZEBULON ONCE AS-BUILT INFORMATION IS RECEIVED AND COORDINATED PRIOR TO CONSTRUCTION WITH WAKE COUNTY ENVIRONMENTAL SERVICES DEPARTMENT/WATER, QUALITY DIVISION AND THE TOWN OF ZEBULON PRIOR TO CONSTRUCTION.

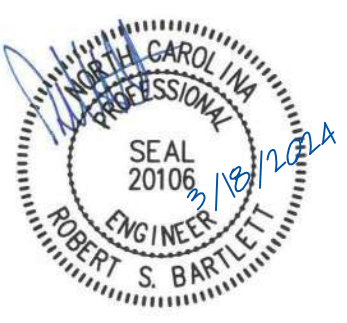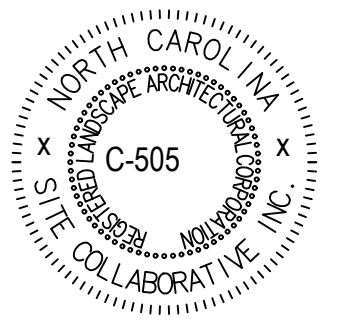

ZEBULON ANIMAL HOSPITAL
 DVM SERVICES REALTY, LLC

PROJECT NUMBER:
PROJECT PHASE:
DATE: 03.18.2024
SHEET TITLE: EXISTING CONDITIONS AND PROPOSED UTILITY PLAN
SHEET NUMBER:

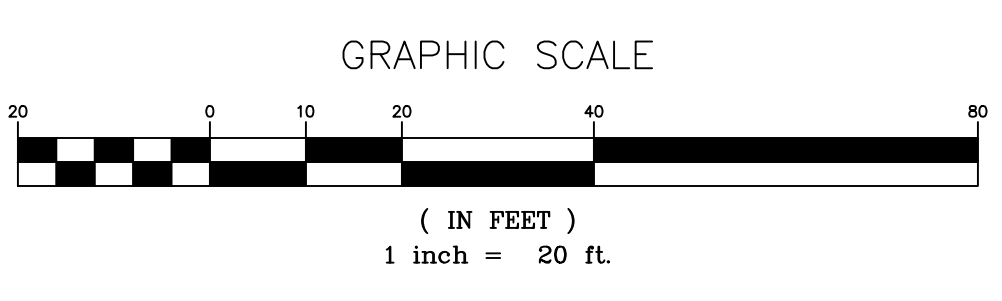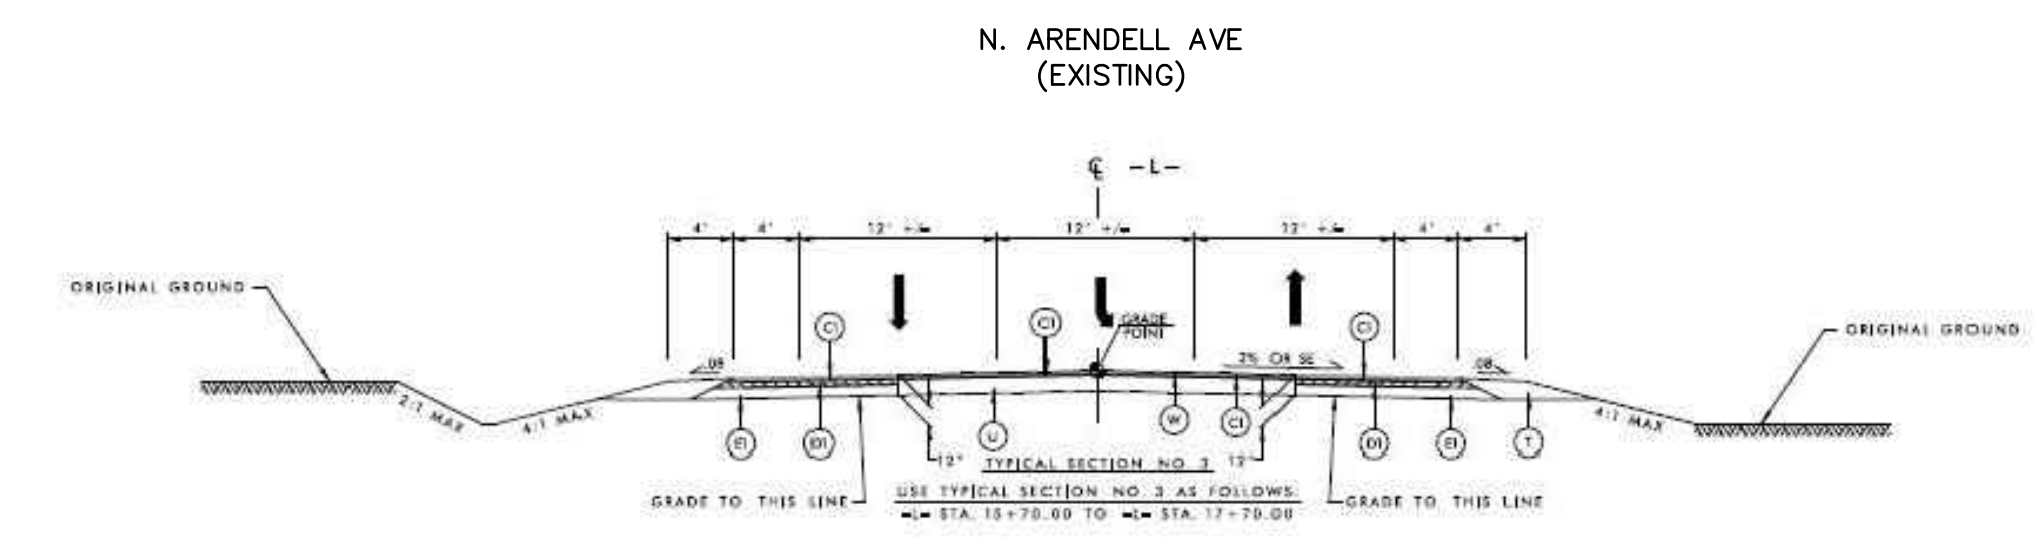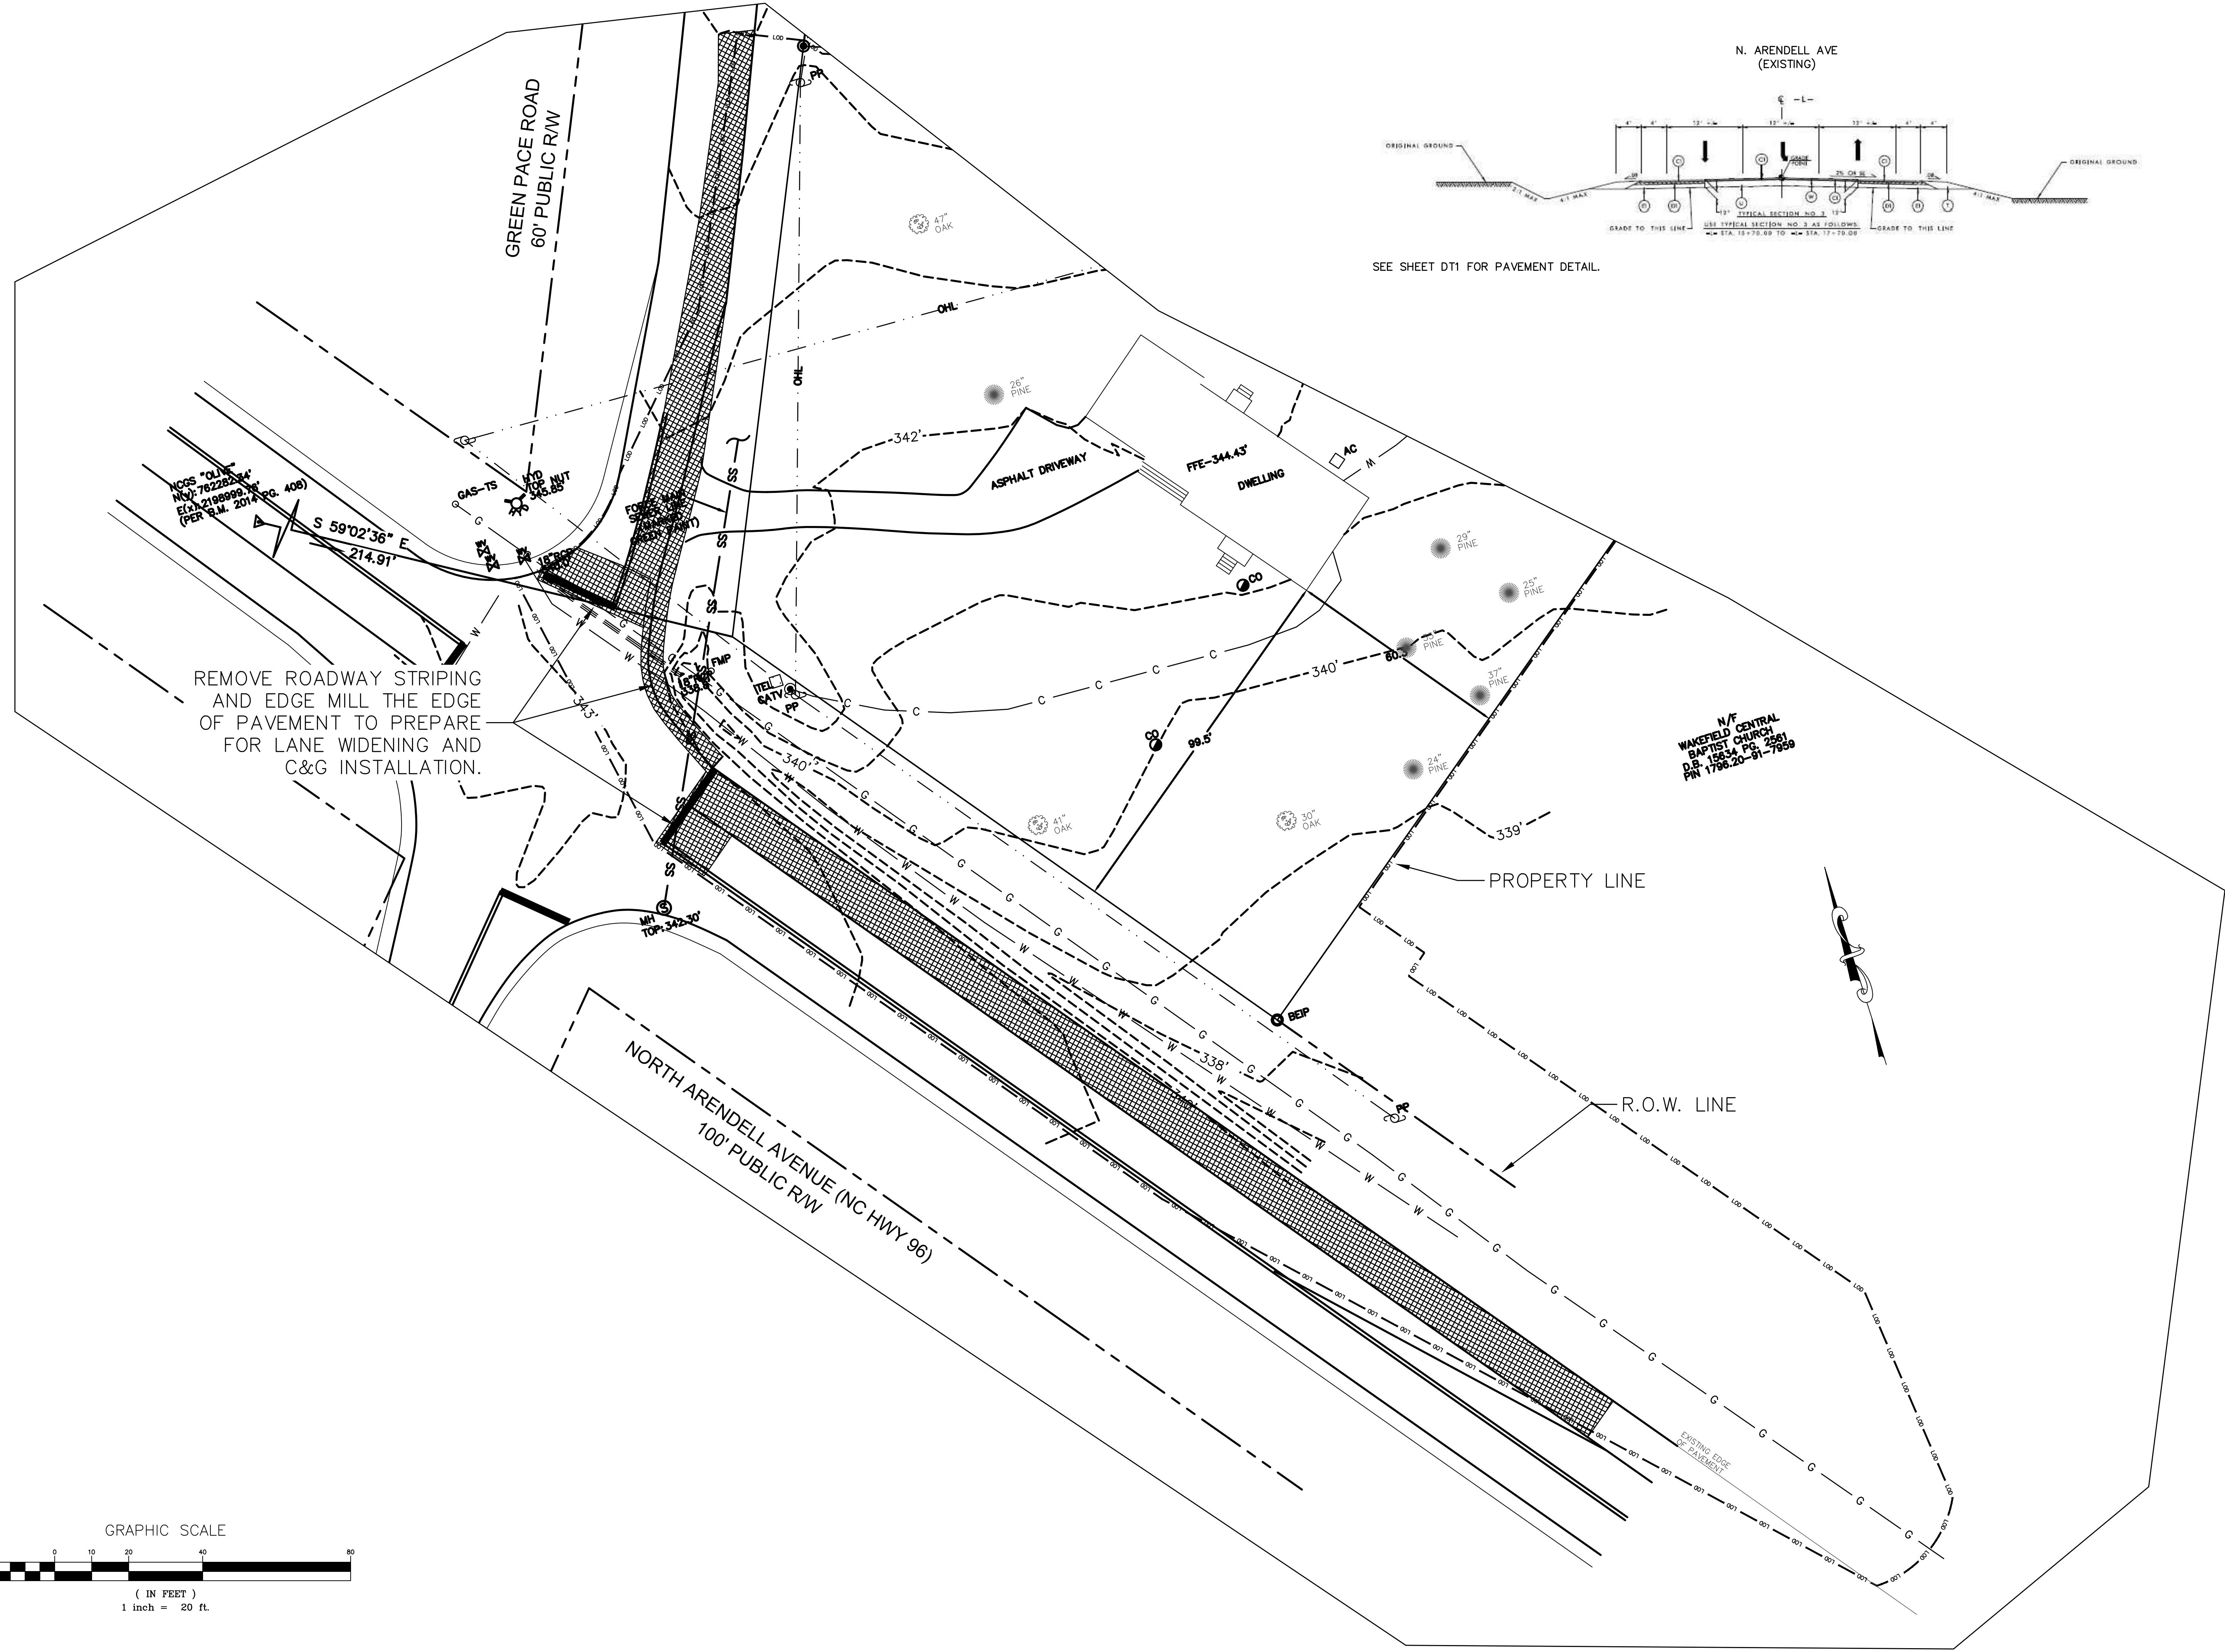

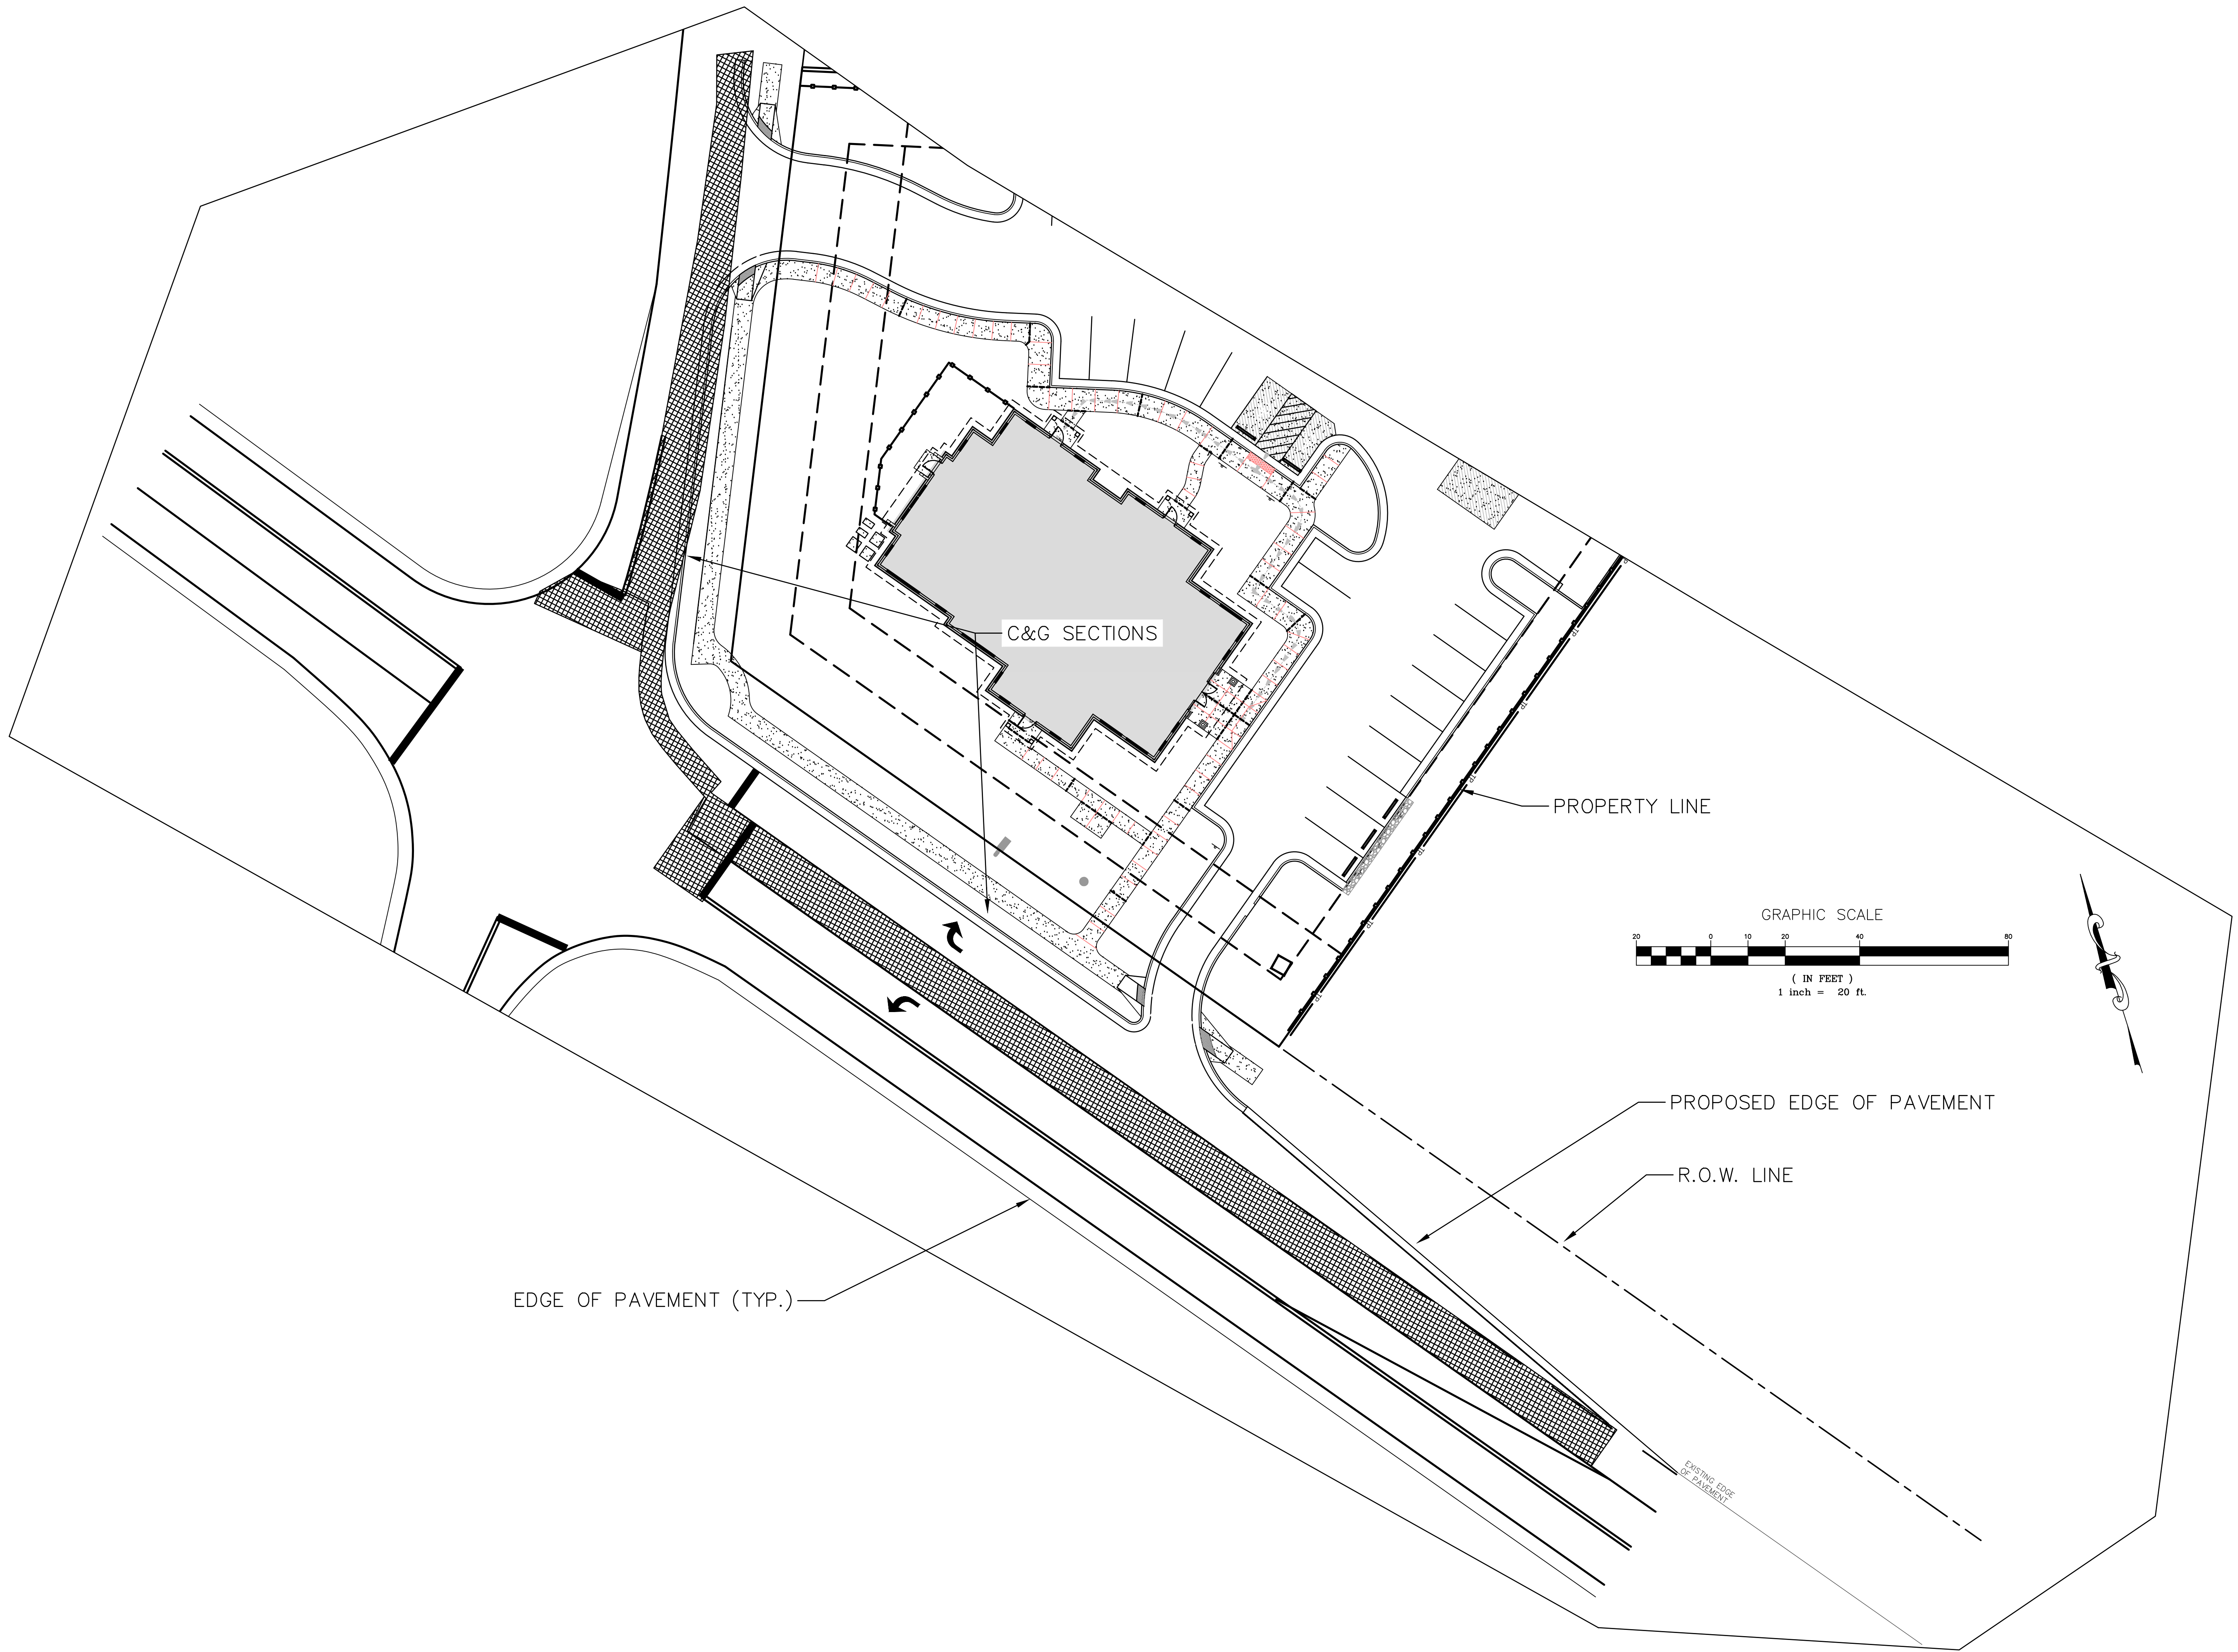

ZEBULON ANIMAL HOSPITAL
DVM SERVICES REALTY, LLC

PROJECT NUMBER:

PROJECT PHASE:

DATE: 06.04.2024

SHEET TITLE:

MILL OVERLAY

SHEET NUMBER:

NCDOT-2

**ZEBULON ANIMAL HOSPITAL
DVM SERVICES REALTY, LLC**

PROJECT NUMBER:

PROJECT PHASE:

DATE: 06.04.2024

SHEET TITLE:

STRIPING PLAN




SHEET NUMBER:

NCDOT-3



STRIPING TO BE IN ACCORDANCE WITH NCDOT DETAILS.

EXISTING STRIPING TO REMAIN IN PLACE OR BE REPAIRED AFTER CONSTRUCTION TO THE STANDARDS LAID OUT IN THE NCDOT STRIPING DETAILS.



FUTURE PEDESTRIAN CROSSWALKS TO BE INSTALLED AT A FUTURE DATE. SHOWN HERE FOR INFORMATIONAL PURPOSES ONLY. STOP BARS TO BE PAINTED AS SHOWN AS PART OF THIS PROJECT.

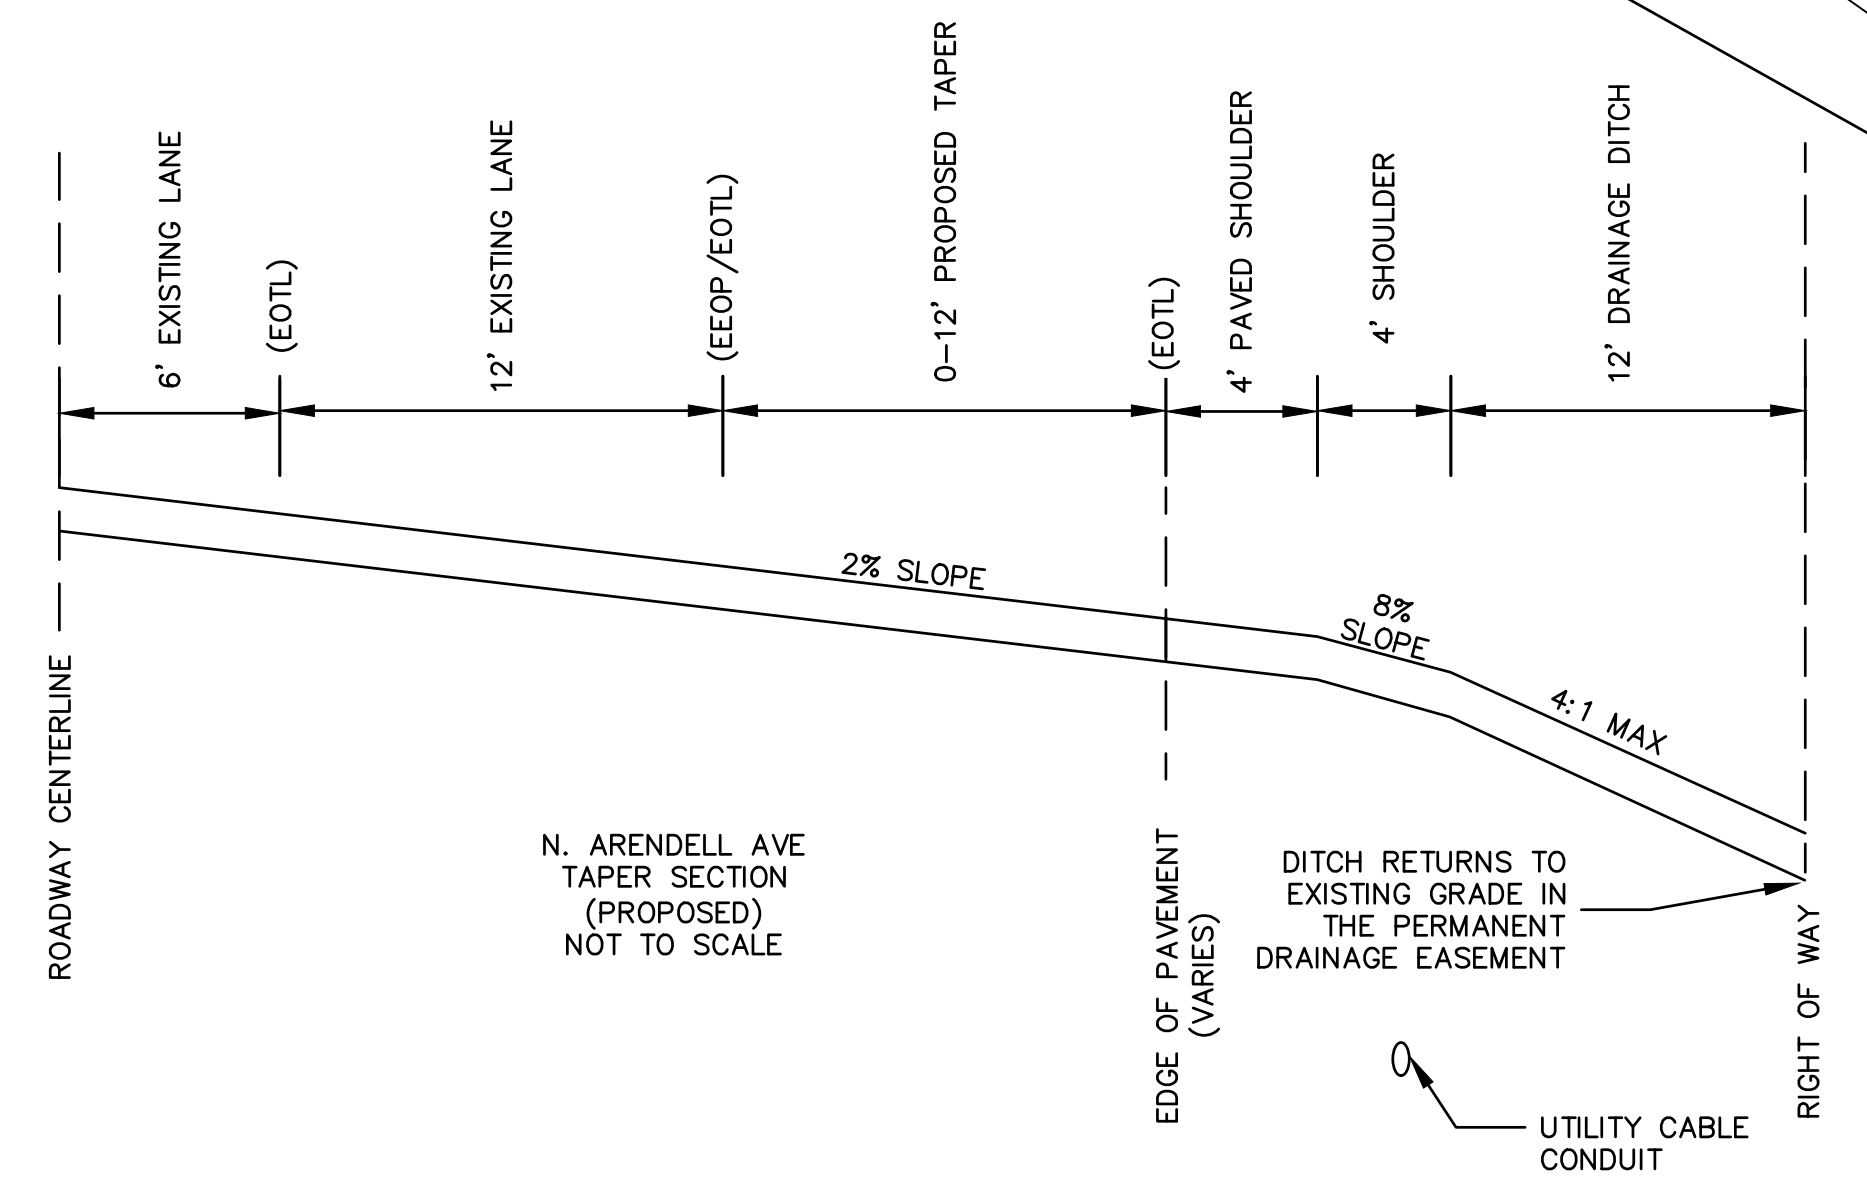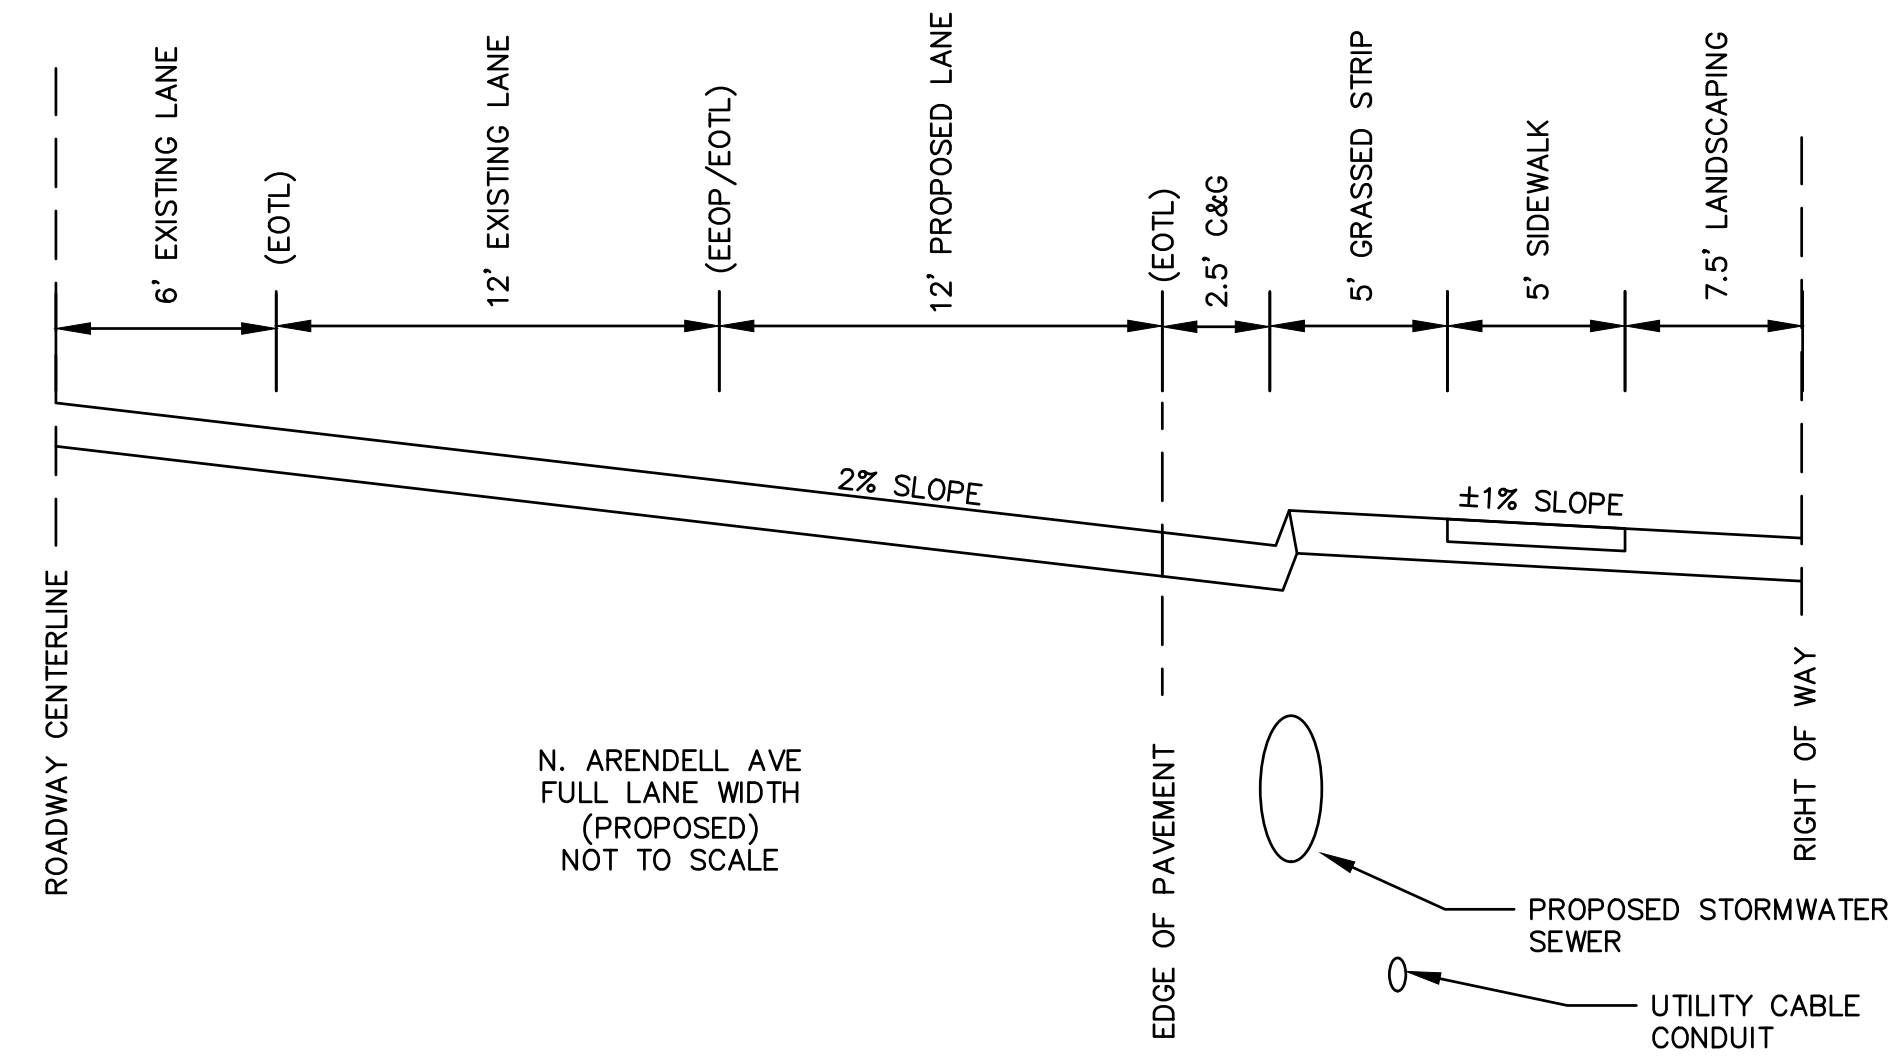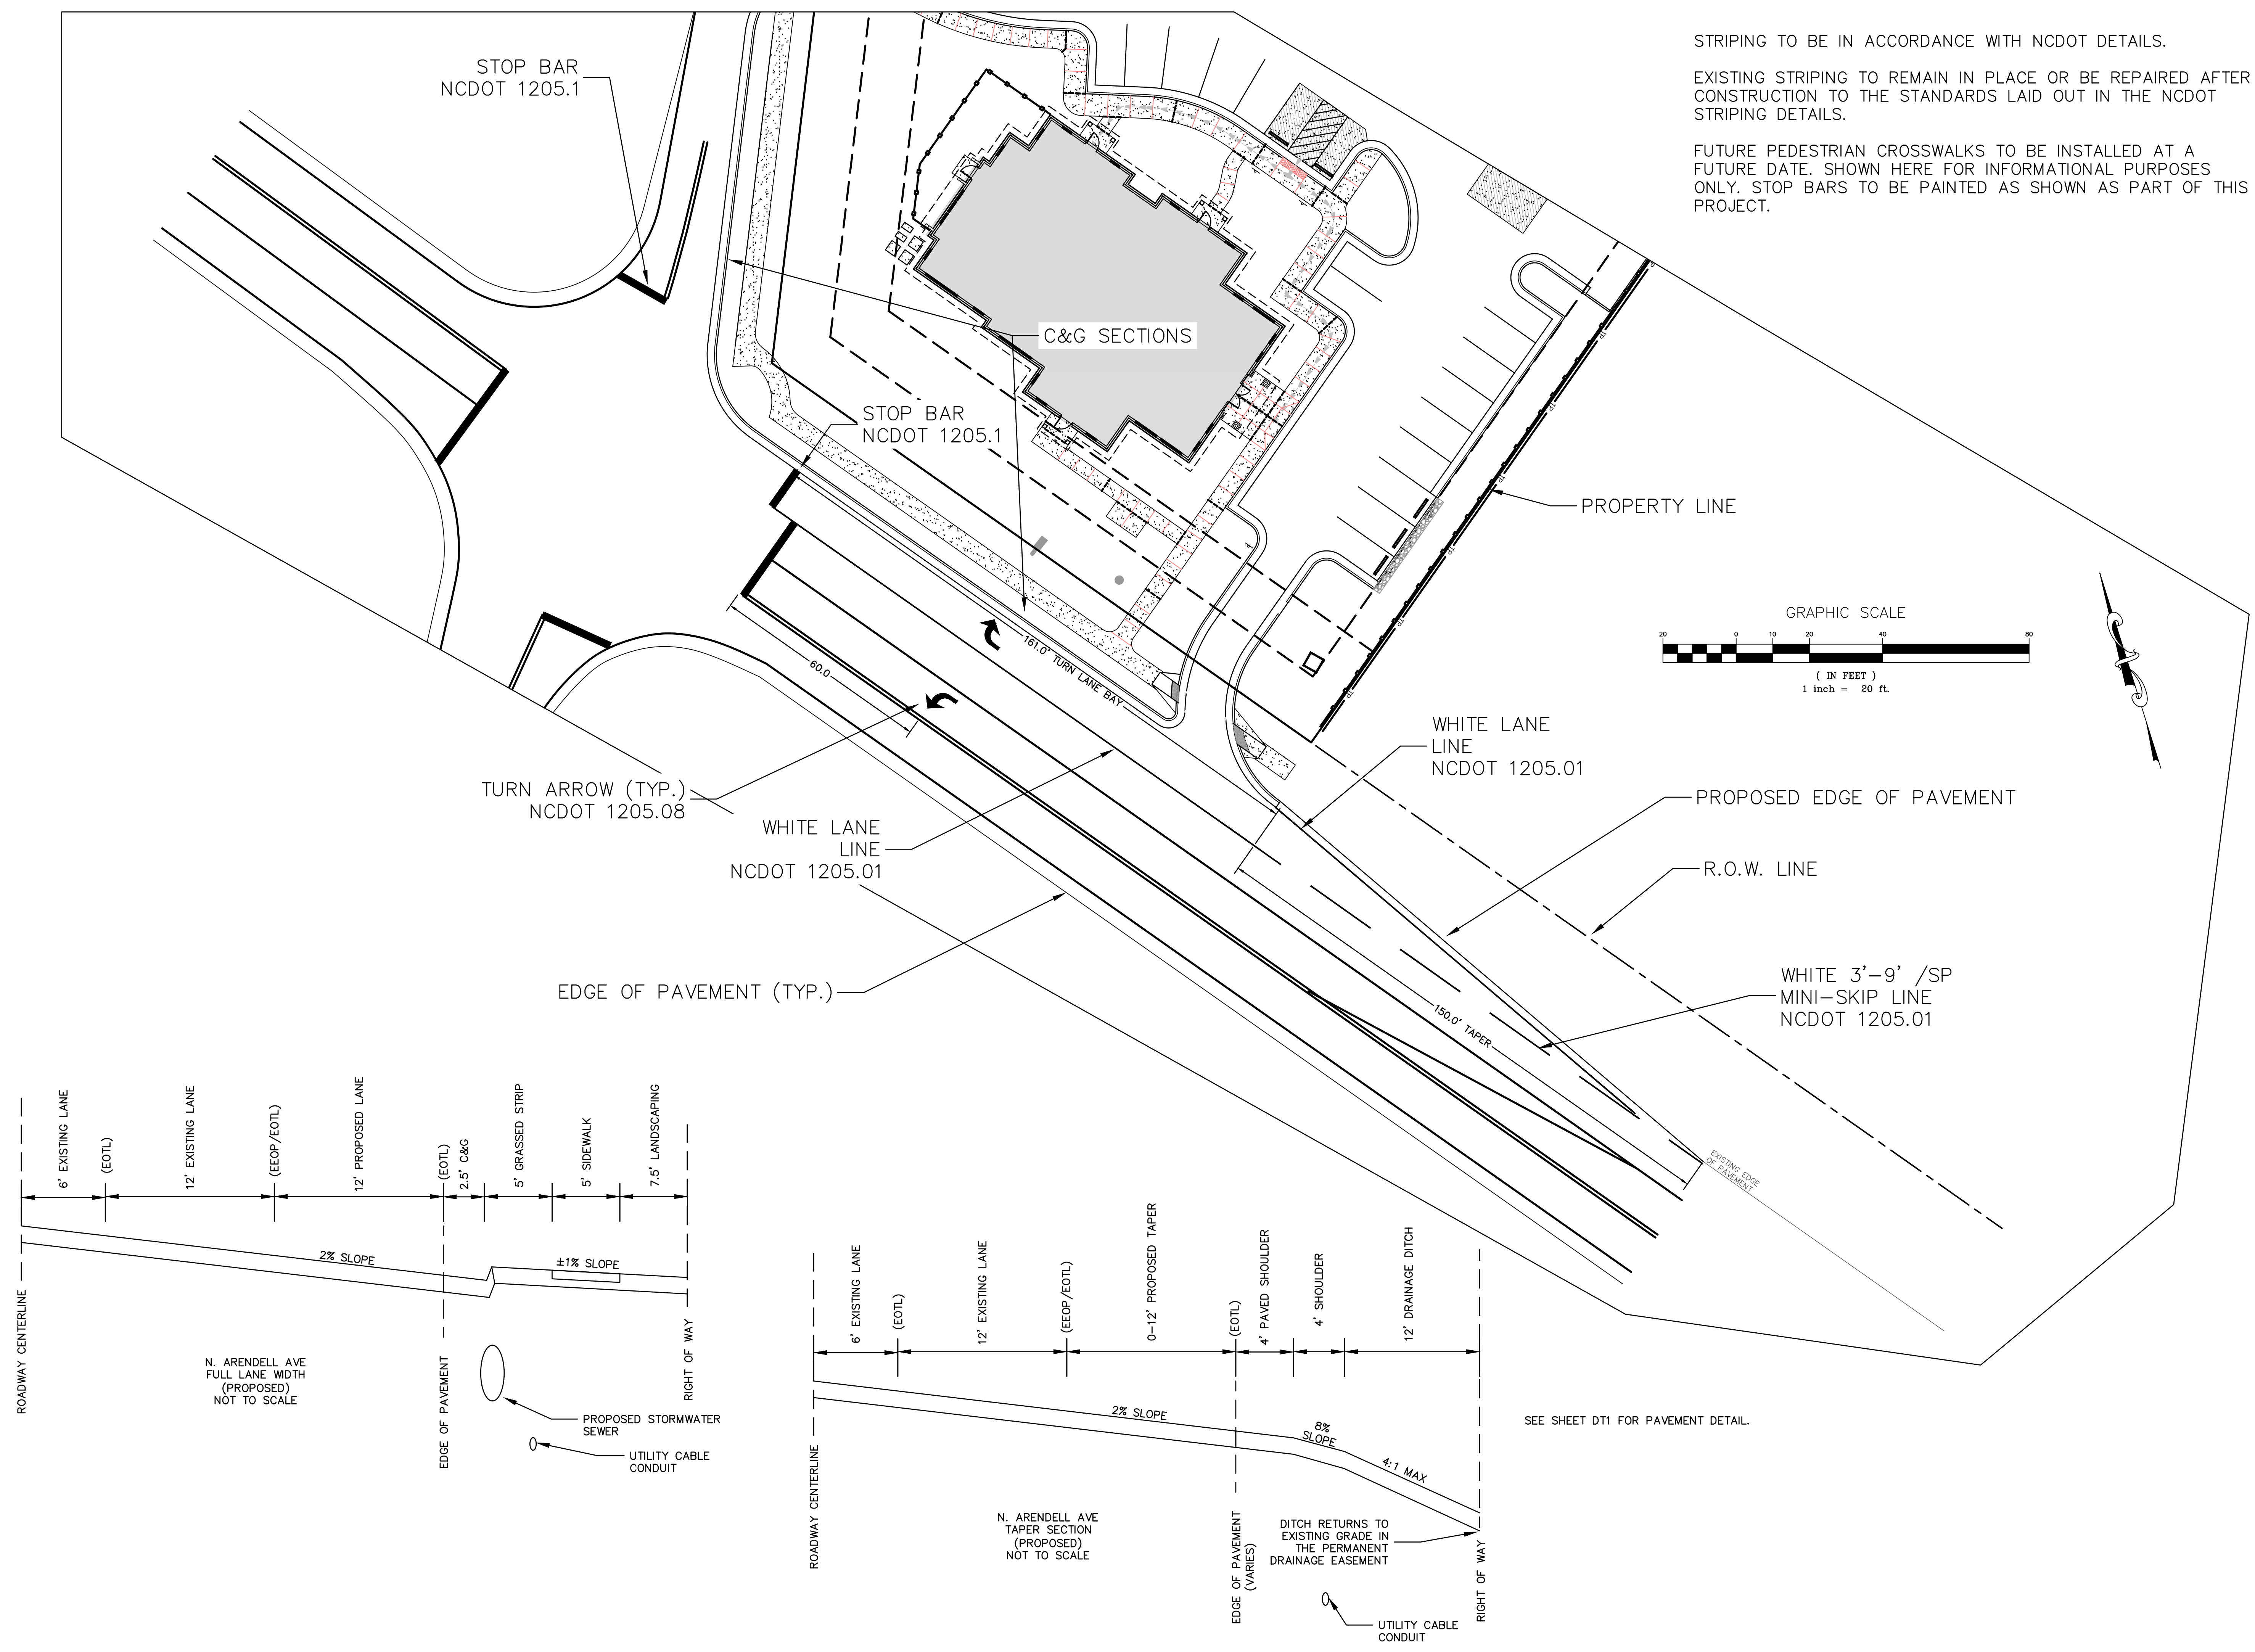


SEE SHEET DT1 FOR PAVEMENT DETAIL.

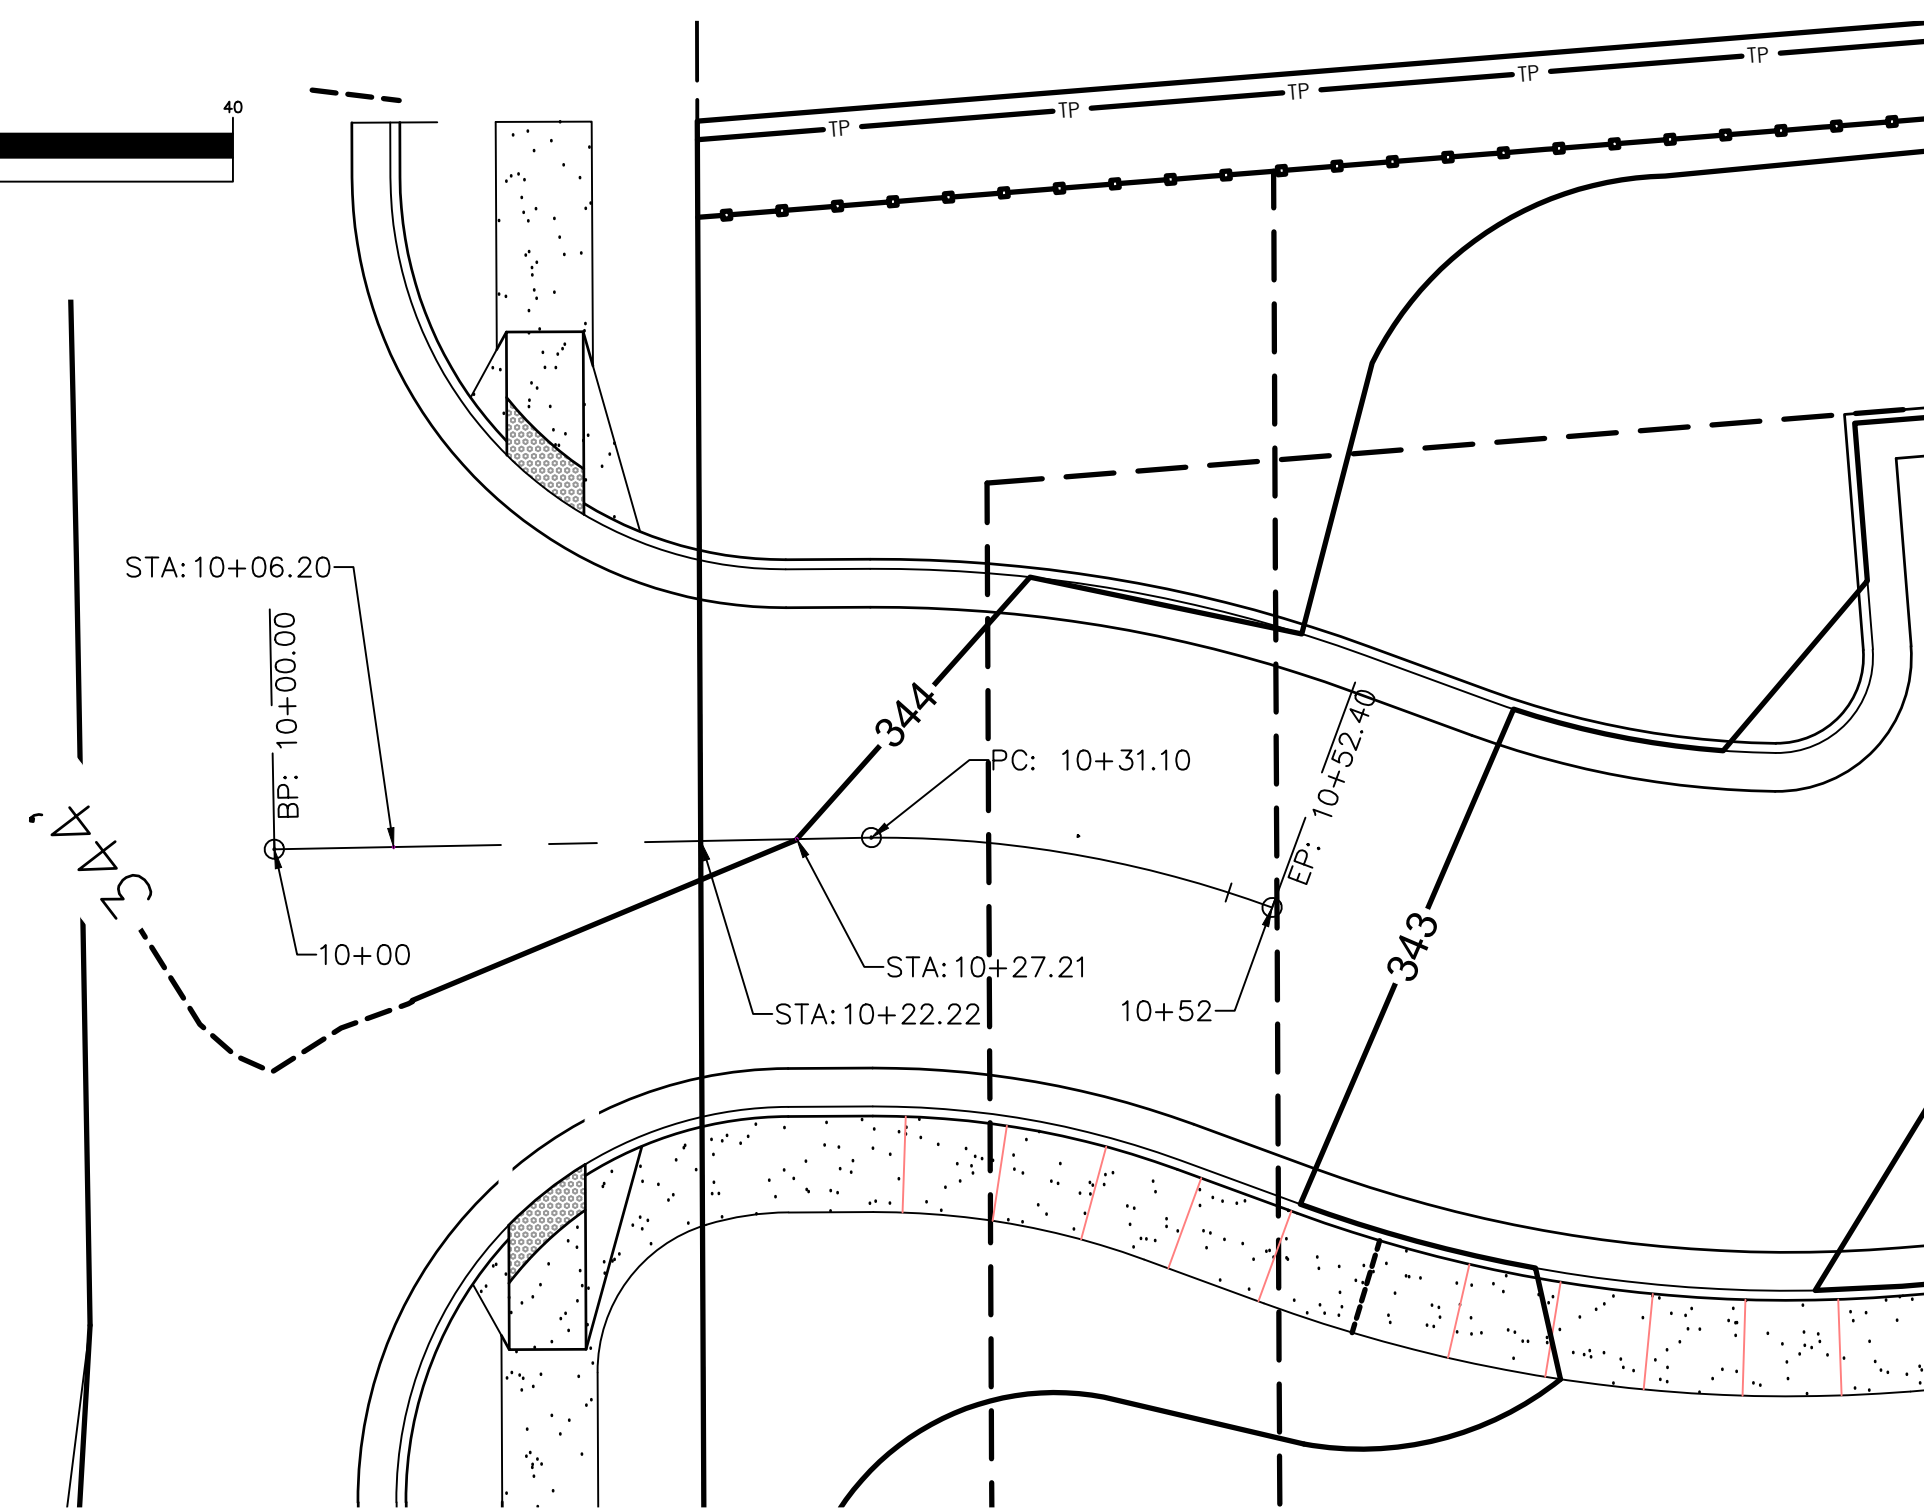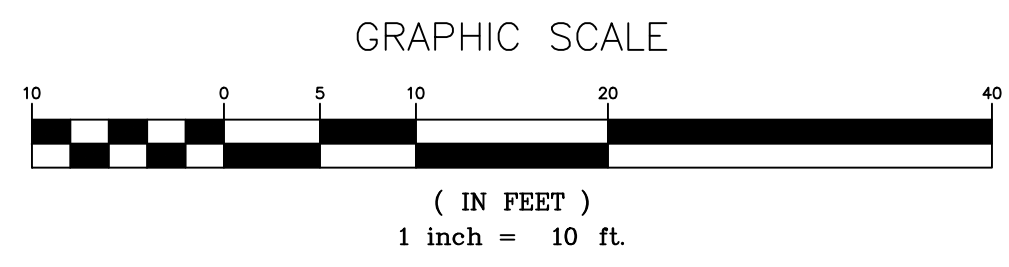


GREEN PACE DR. - DRIVEWAY
 60' PUBLIC R/W
PLAN VIEW STA. 10+00 - STA. 10+52

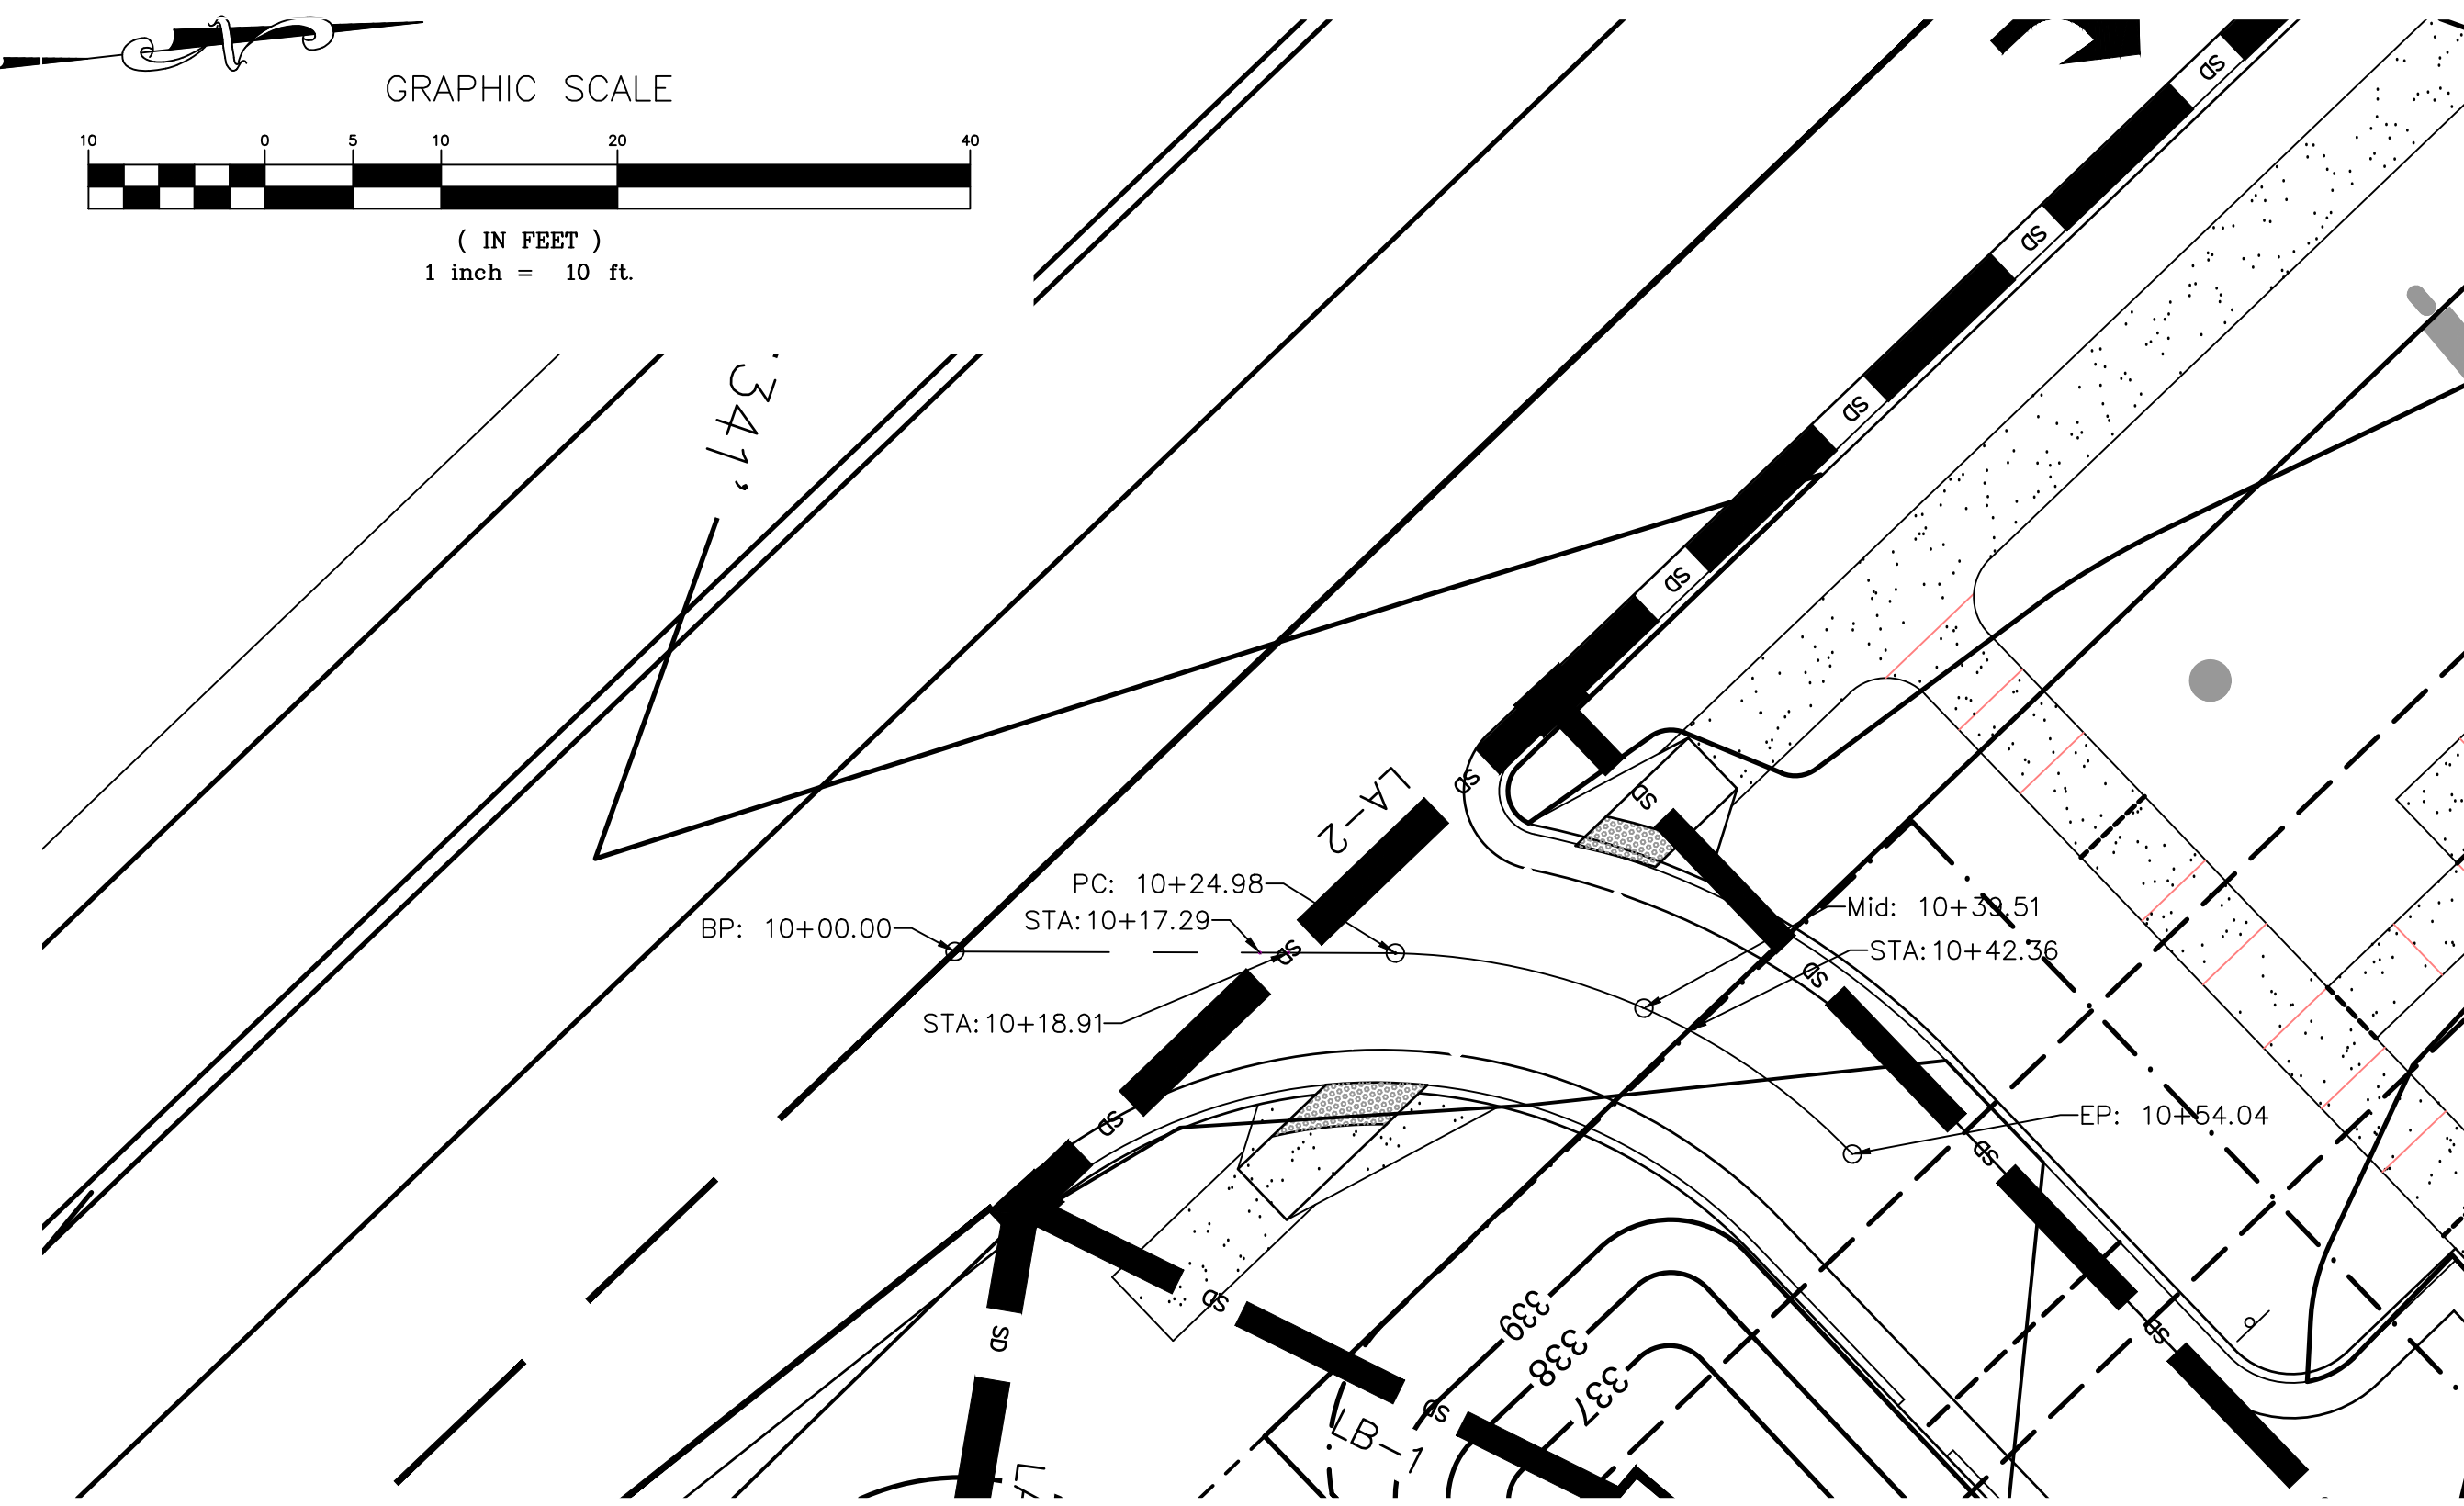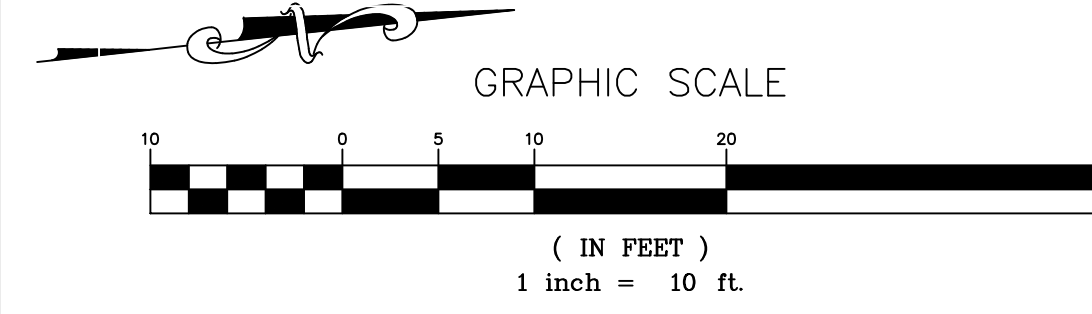


N. ARENDELL AVE. - DRIVEWAY
 100' PUBLIC R/W
PLAN VIEW STA. 10+00 - STA. 10+54

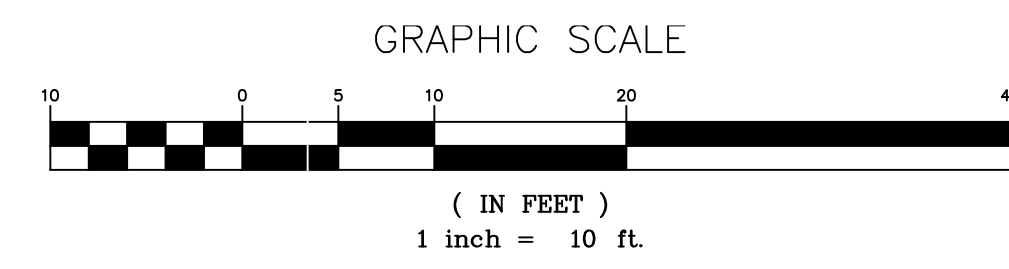


VERTICAL SCALE: 1 INCH = 1 FT.

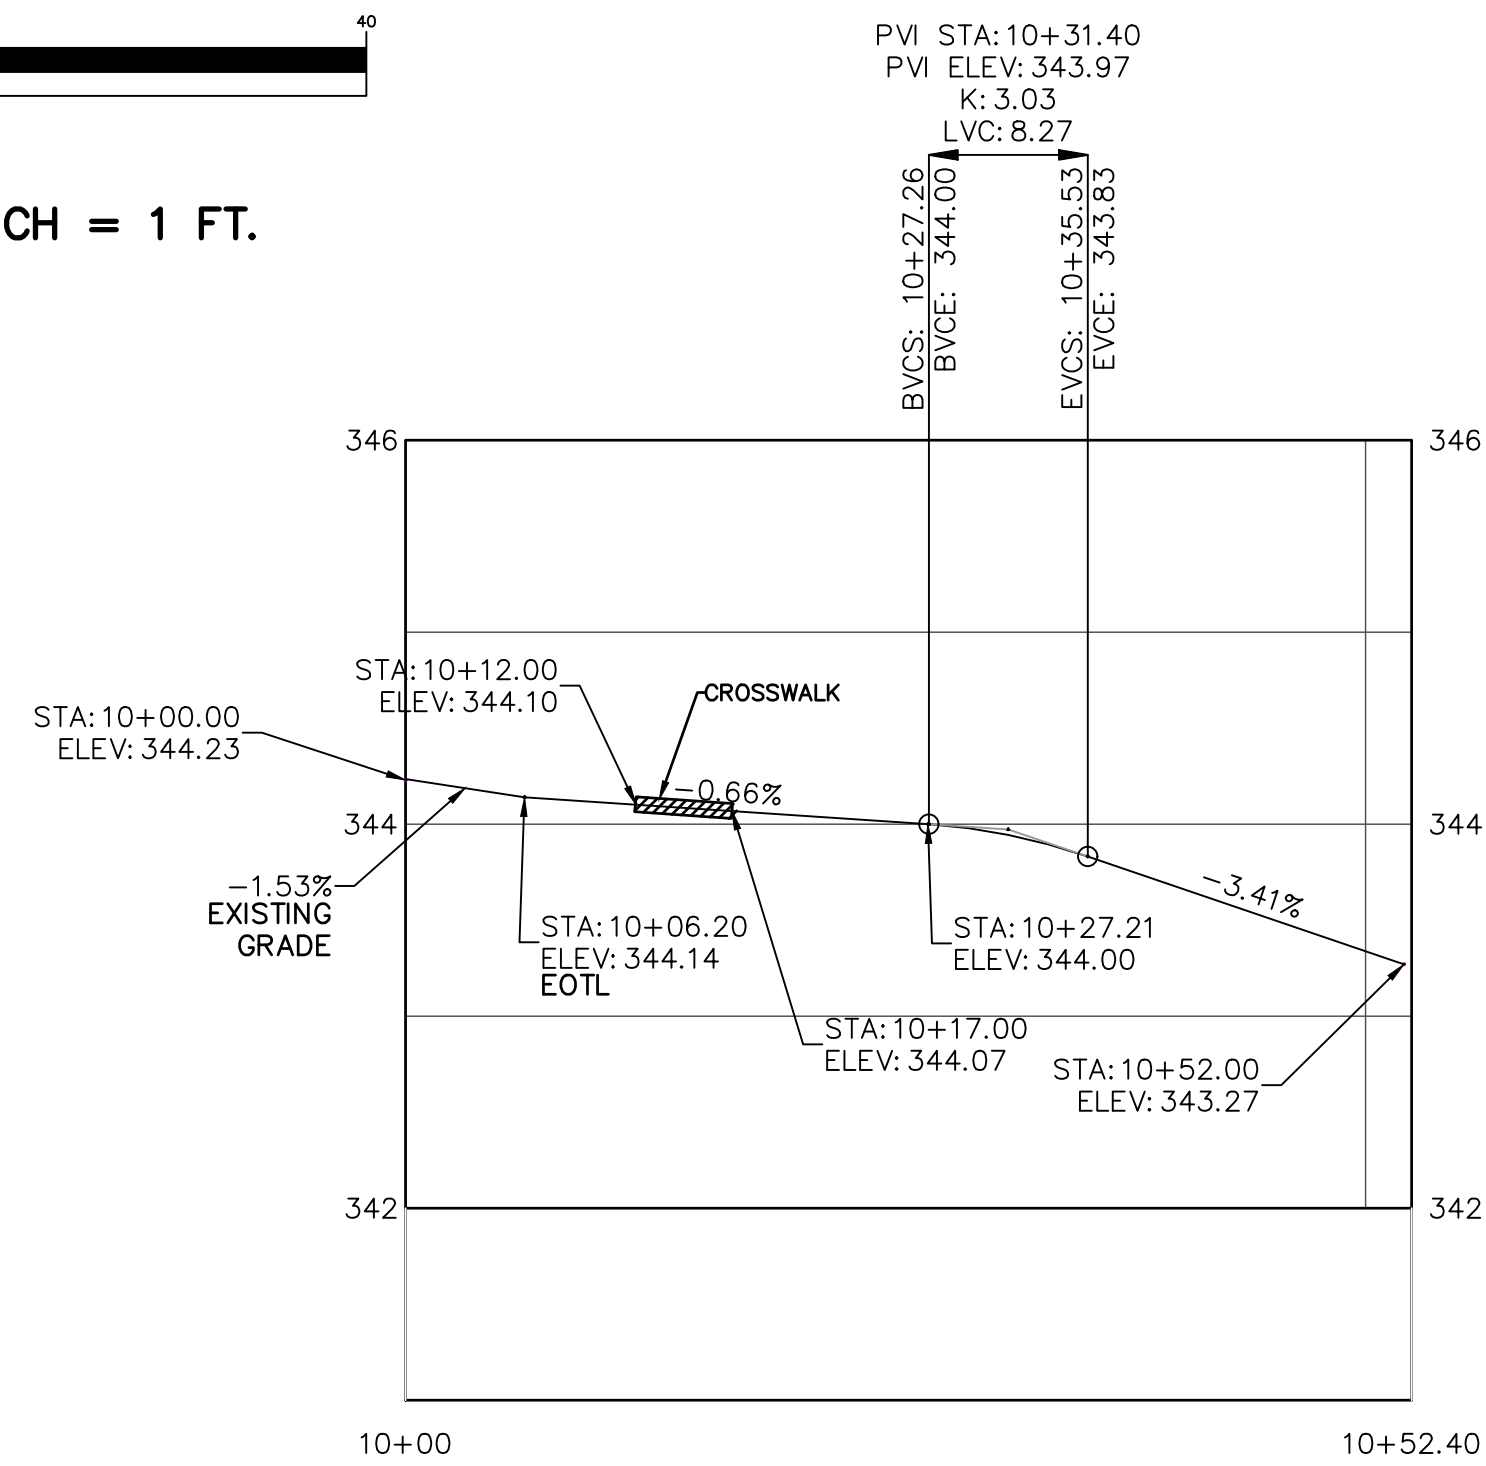

GREEN PACE - STEM PROFILE

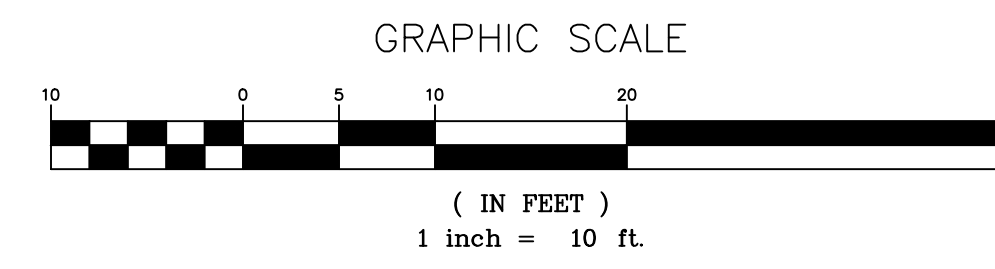

VERTICAL SCALE: 1 INCH = 1 FT.

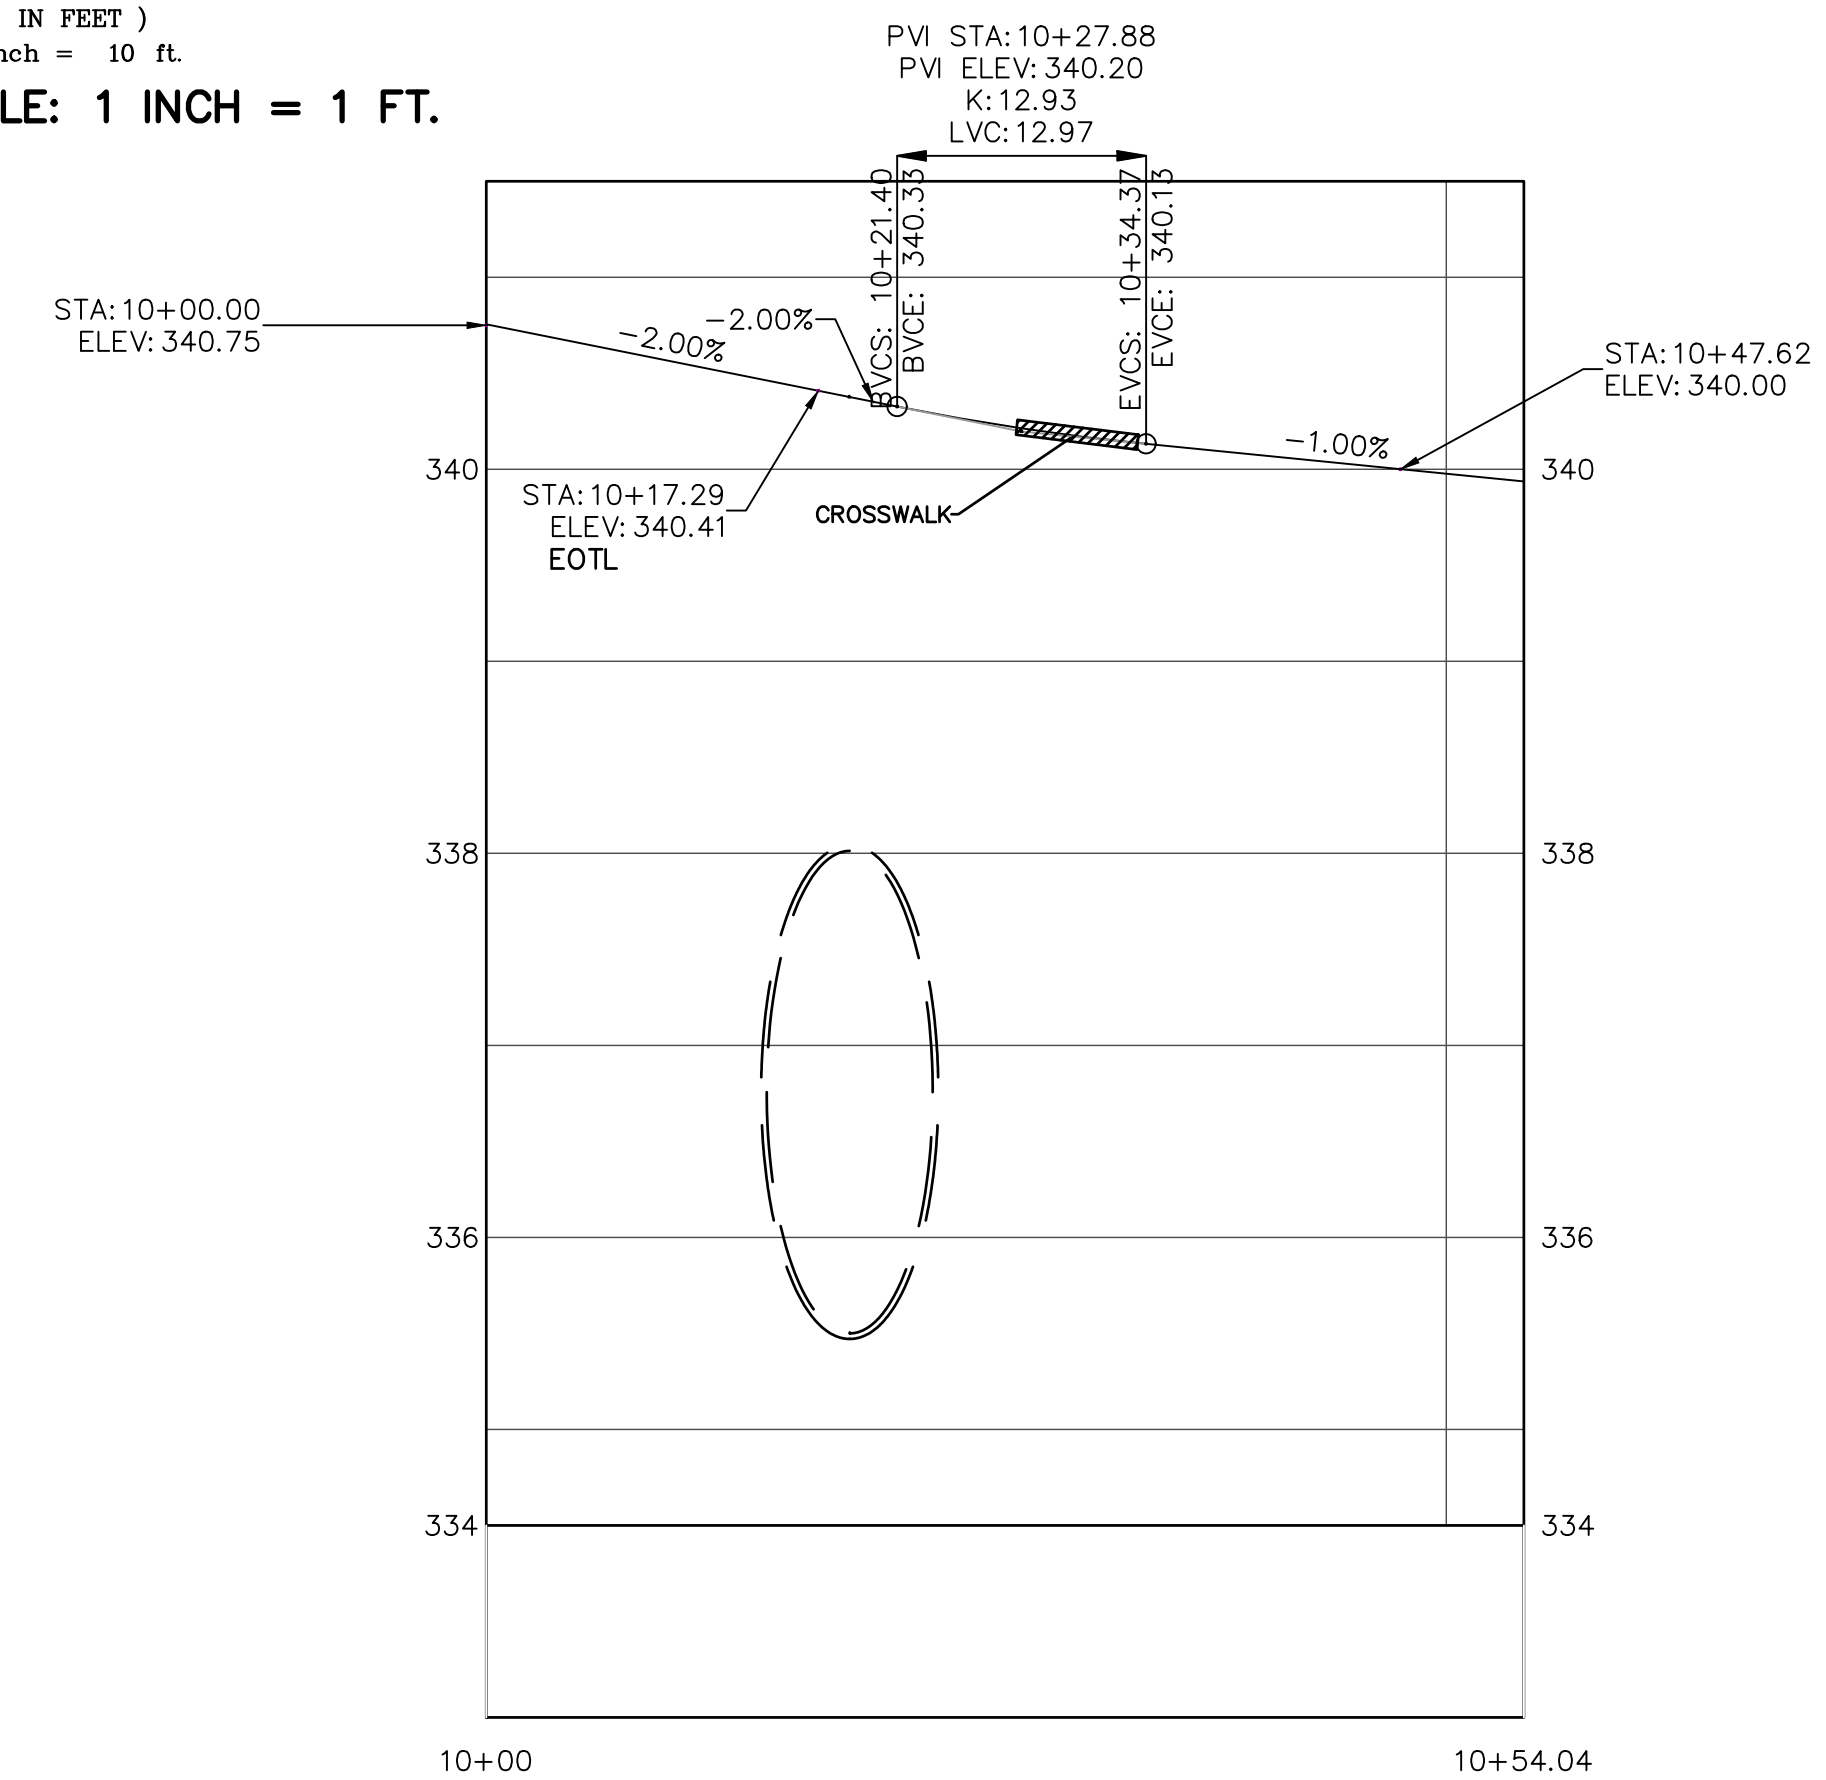

N. ARENDELL - STEM PROFILE

STORM DRAIN SCHEDULE (10-YEAR STORM)
n = 0.013

FROM	TO	PIPE RUN	INLET AREA (SF)	INLET AREA (ACRES)	A TOTAL AREA (ACRES)	INLET TIME (MIN)	PIPE TIME (MIN)	TIME OF CONC (MIN)	I INTENSITY (IN/HR)	Cc COEFF	Cc COEFF	Q10 DSHCRG (CFS)	SLOPE (FT/FT)	D _{theo} (INCHES)	SIZE (INCHES)	V _{ull} (FT/SEC)	Q _{full} (CFS)	LENGTH PIPE (FT)	SEGMENT TIME (MIN)	UPPER INVERT	LOWER INVERT
LINE A																					
MH-2	CB-3	LA-4	112007	2.53	2.53	5.0	0.0	5.0	8.03	0.50	0.50	10.2	0.0102	17.7	24	7.3	22.8	24.5	0.1	339.50	339.25
CB-3	CB-2	LA-3	3833	0.09	2.62	5.0	0.0	5.0	8.03	0.90	0.90	18.9	0.0171	20.3	24	9.4	29.6	117.0	0.2	339.25	337.25
CB-2	CB-1	LA-2	3920	0.09	2.71	5.0	0.0	5.0	8.03	0.90	0.90	19.6	0.0048	26.1	30	5.8	28.4	42.0	0.1	335.60	335.40
CB-1	FES-1	LA-1	1220	0.03	2.74	5.0	0.0	5.0	8.03	0.90	0.90	19.8	0.0080	23.8	24	6.4	20.2	25.0	0.1	335.40	335.20
LINE B																					
S. BIO	CB-1	LB-1	14310	0.33	0.33	5.0	0.0	5.0	7.20	0.73	0.73	1.7	0.0129	8.7	18	6.7	11.9	31.0	0.1	335.50	335.10
LINE C																					
N. BIO	MH-1	LC-2	33360	0.77	1.09	5.0	0.0	5.0	7.20	0.76	0.75	5.9	0.0044	16.9	18	3.9	7.0	91.0	0.4	336.51	336.11
MH-1	CB-2	LC-1	0	0.00	1.09	5.0	0.0	5.0	7.20	0.90	0.75	5.9	0.0037	17.5	18	3.6	6.4	136.5	0.6	336.11	335.60

*LA-1, LA-2, LA-3, AND LA-4 ARE CLASS V RCP. ALL OTHER PIPES CLASS III RCP.
*LINE A SIZED FOR 25YR STORM.
*UPSTREAM DRAINAGE AREAS FOR PIPE LA-4 PROVIDED BY VOLKERT ENGINEERING VIA "DRAINAGE AND HYDROLOGY & HYDRAULICS REPORT" PREPARED BY VOLKERT FOR N.C.D.O.T.
*LINES B & C PIPES SIZED BY 'Q' VALUES OF BIORETENTION CELL OUTFLOWS. SEE STORMWATER REPORT FOR MORE DATA.

PRELIMINARY PEAK FLOW REDUCTION

RETURN EVENT (YEARS)	PREDEVELOPED PEAK RUN-OFF (CFS)	POST DEVELOPED PEAK RUN-OFF (CFS)	REDUCTION (%)
1	1.12	0.25	77.7%
2	0.81	0.18	52.4%
10	3.91	3.14	19.7%
25	4.98	4.37	12.2%

Note - 1 year post dev. peak run-off must not exceed 1 year pre-dev. peak run-off and 10 year and 25 year post dev. peak run-off must be 10% less than 10 year and 25 year pre-dev. peak run-off

STAGE-STORAGE (NORTH BIORETENTION CELL)

ELEVATION (FEET)	AREA (FT ²)	VOLUME (FT ³)
338	1200.0	0.0
339	2305.0	1752.5
340	3420.0	4615.0

STAGE-STORAGE (SOUTH BIORETENTION CELL)

ELEVATION (FEET)	AREA (FT ²)	VOLUME (FT ³)
337	355.0	0.0
338	694.0	524.5
339	1167.0	1451.3


NOAA Atlas 14, Volume 2, Version 3
Location name: Zebulon, North Carolina, USA
Latitude: 35.8424° Longitude: -78.3275°
Elevation: 342.0'
Source: ERI Topo
Event: 100yr

POINT PRECIPITATION FREQUENCY ESTIMATES
G.M. Bonn, D. Marin, B. Liu, T. Przybylo, M. Yeh, and D. Riley
NOAA, National Weather Service, Silver Spring, Maryland
PF: tabular | PE: graphical | Maps: & aerials

PF tabular




PDS-based point precipitation frequency estimates with 90% confidence intervals (in inches/hour)

Duration	Average recurrence interval (years)									
	1	2	5	10	25	50	100	200	500	1000
5-min	4.35	5.60	6.56	7.20	8.03	8.72	9.34	9.90	10.5	11.1
10-min	3.38	4.48	5.09	5.76	6.40	6.95	7.42	7.85	8.33	8.77
15-min	3.23	3.76	4.30	4.86	5.41	5.86	6.25	6.60	6.99	7.34
30-min	2.81	3.60	3.95	4.32	4.69	4.99	5.24	5.44	5.66	5.84
60-min	1.38	1.63	1.96	2.29	2.67	2.99	3.30	3.60	3.89	4.14
2-hr	0.807	0.956	1.16	1.38	1.63	1.87	2.09	2.32	2.63	2.92
3-hr	0.669	0.674	0.823	0.984	1.19	1.36	1.53	1.72	1.98	2.22
6-hr	0.342	0.405	0.495	0.592	0.715	0.803	0.925	1.06	1.22	1.38
12-hr	0.269	0.267	0.291	0.309	0.325	0.363	0.384	0.441	0.469	0.562
24-hr	0.118	0.143	0.192	0.213	0.257	0.293	0.332	0.372	0.431	0.479
2-day	0.068	0.082	0.104	0.121	0.145	0.165	0.186	0.208	0.240	0.266
3-day	0.048	0.058	0.073	0.085	0.101	0.115	0.129	0.144	0.165	0.183
4-day	0.038	0.046	0.057	0.066	0.079	0.090	0.101	0.112	0.129	0.144
7-day	0.028	0.030	0.037	0.043	0.051	0.057	0.064	0.071	0.080	0.088
10-day	0.020	0.024	0.029	0.033	0.039	0.043	0.046	0.053	0.059	0.065
20-day	0.013	0.016	0.019	0.021	0.025	0.028	0.030	0.033	0.037	0.040
30-day	0.011	0.013	0.015	0.017	0.019	0.021	0.022	0.025	0.028	0.030
45-day	0.009	0.011	0.013	0.014	0.016	0.017	0.018	0.022	0.022	0.023
60-day	0.008	0.010	0.011	0.012	0.014	0.015	0.016	0.017	0.018	0.019

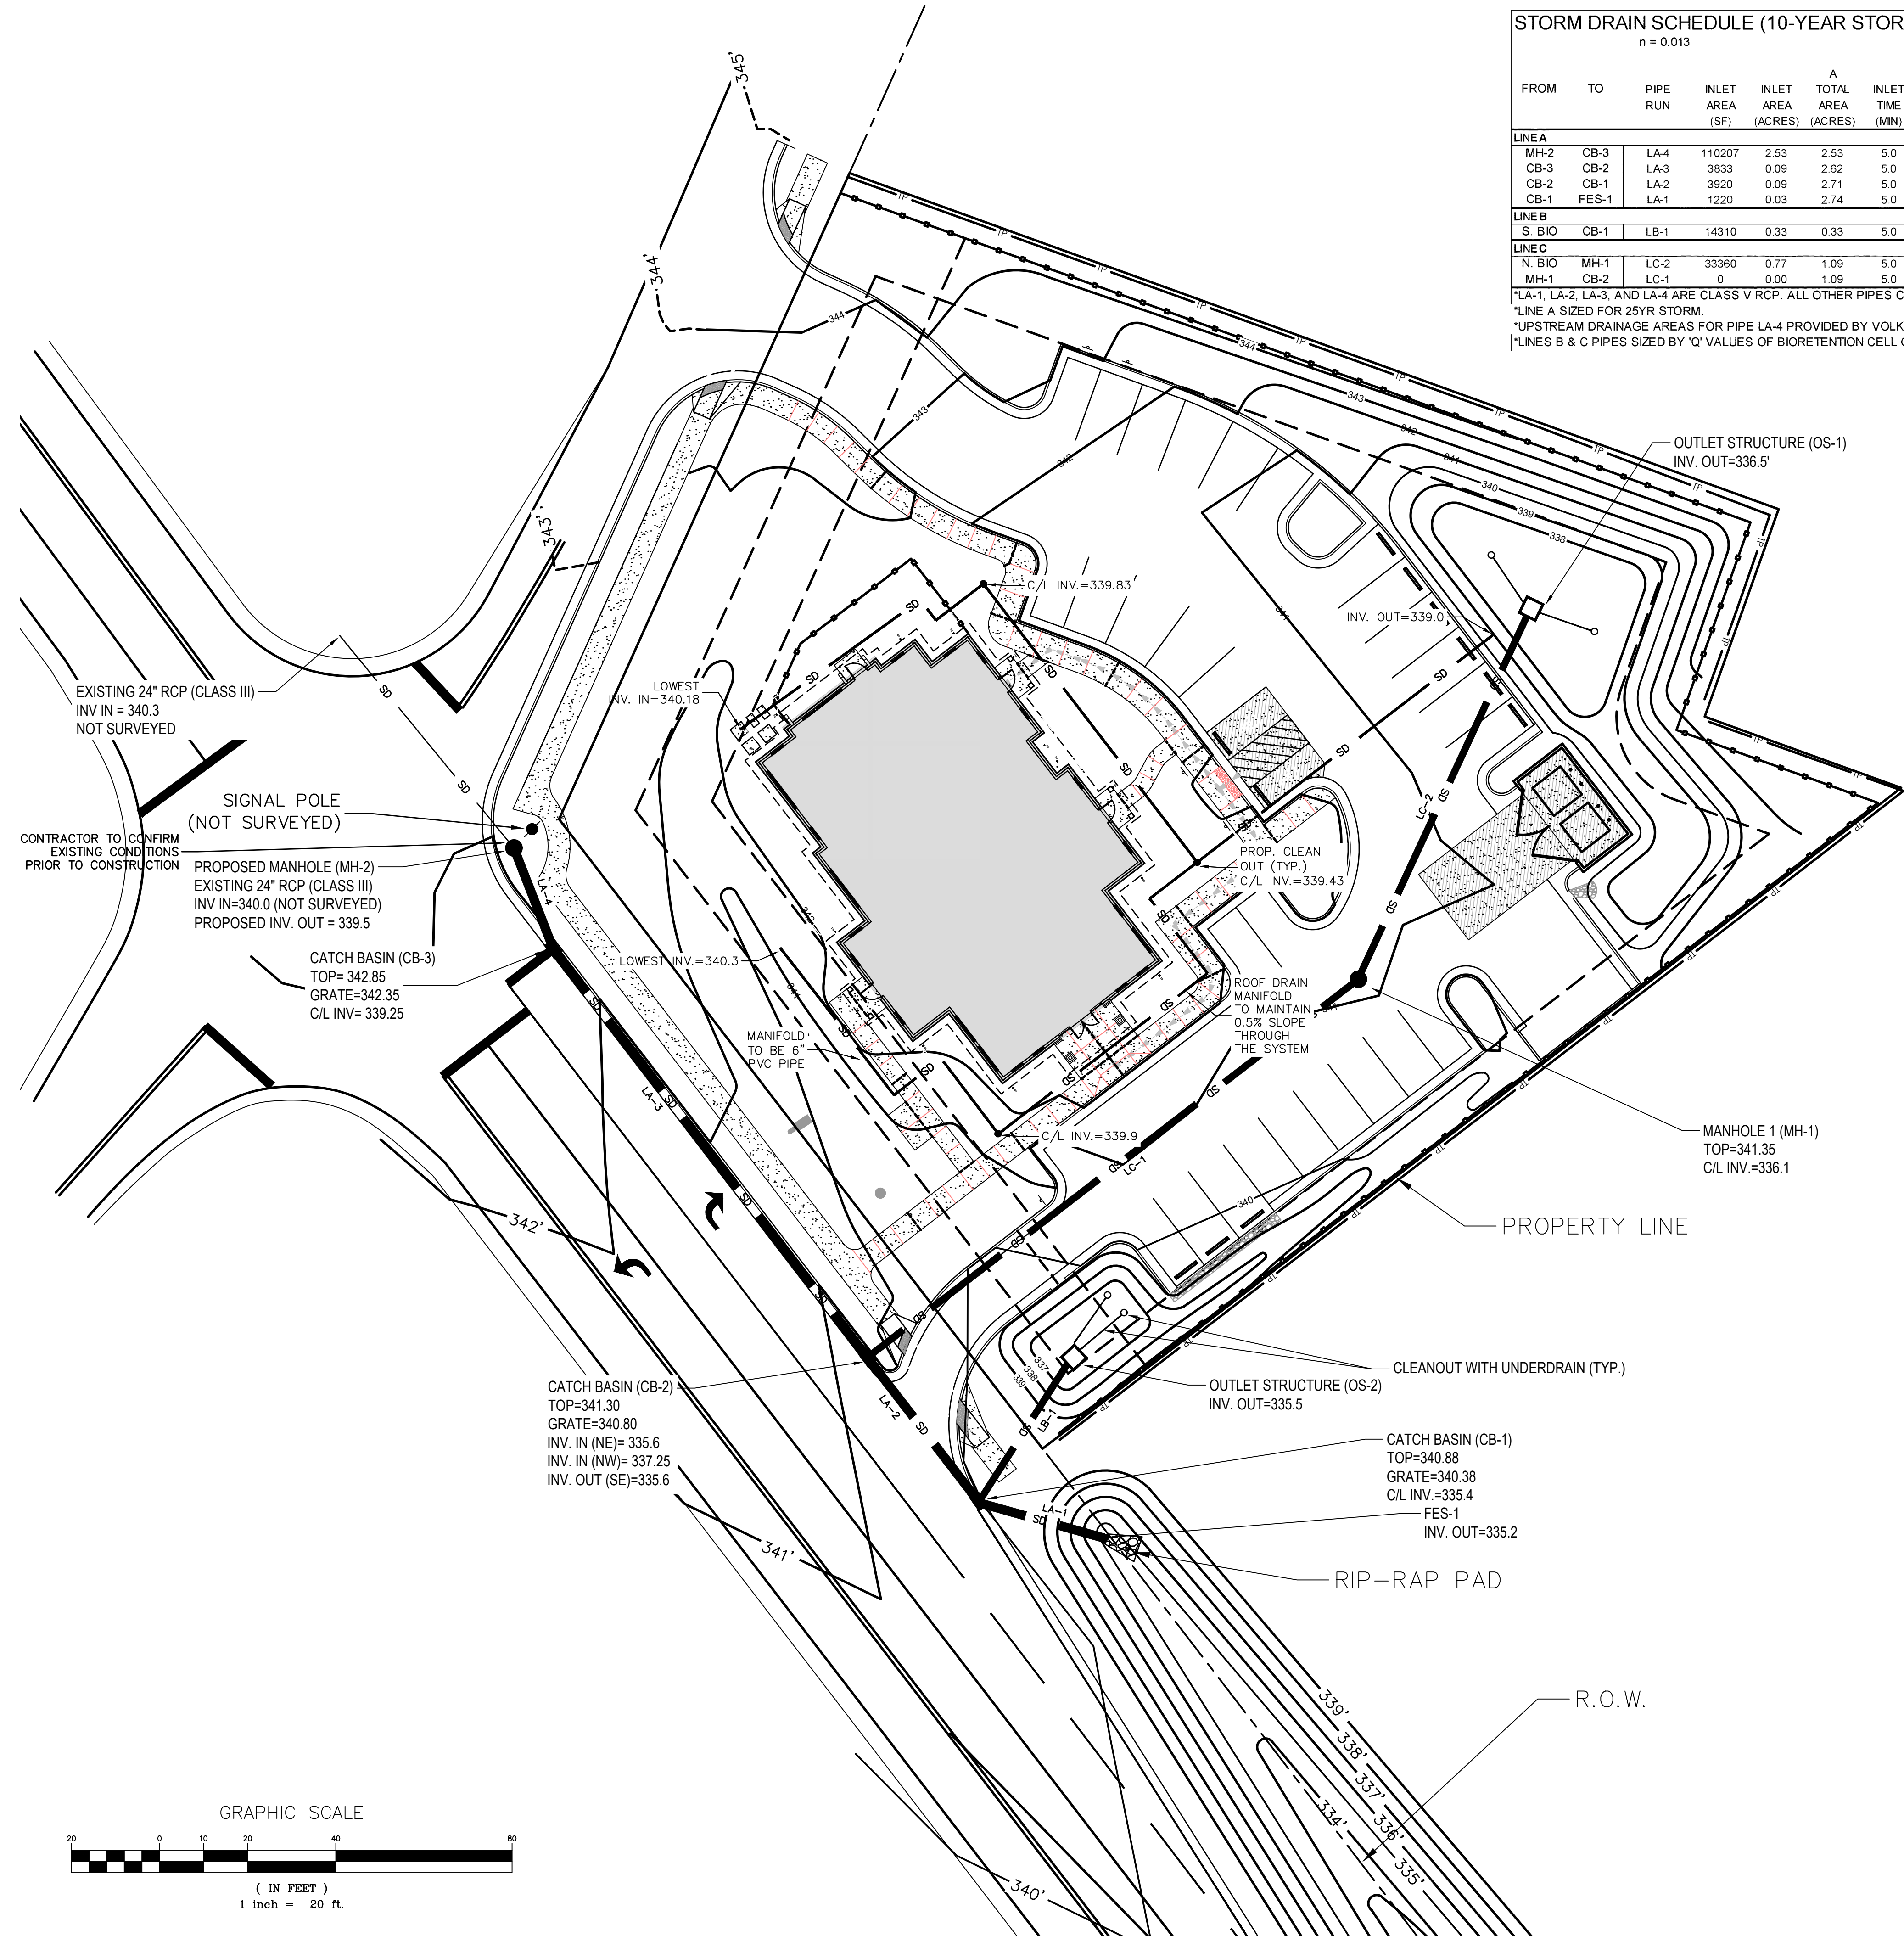

ZEBULON ANIMAL HOSPITAL
DVM SERVICES REALTY, LLC

PROJECT NUMBER:
PROJECT PHASE:
DATE: 6/04/2024
SHEET TITLE:
STORMWATER PLAN
SHEET NUMBER:
SW1

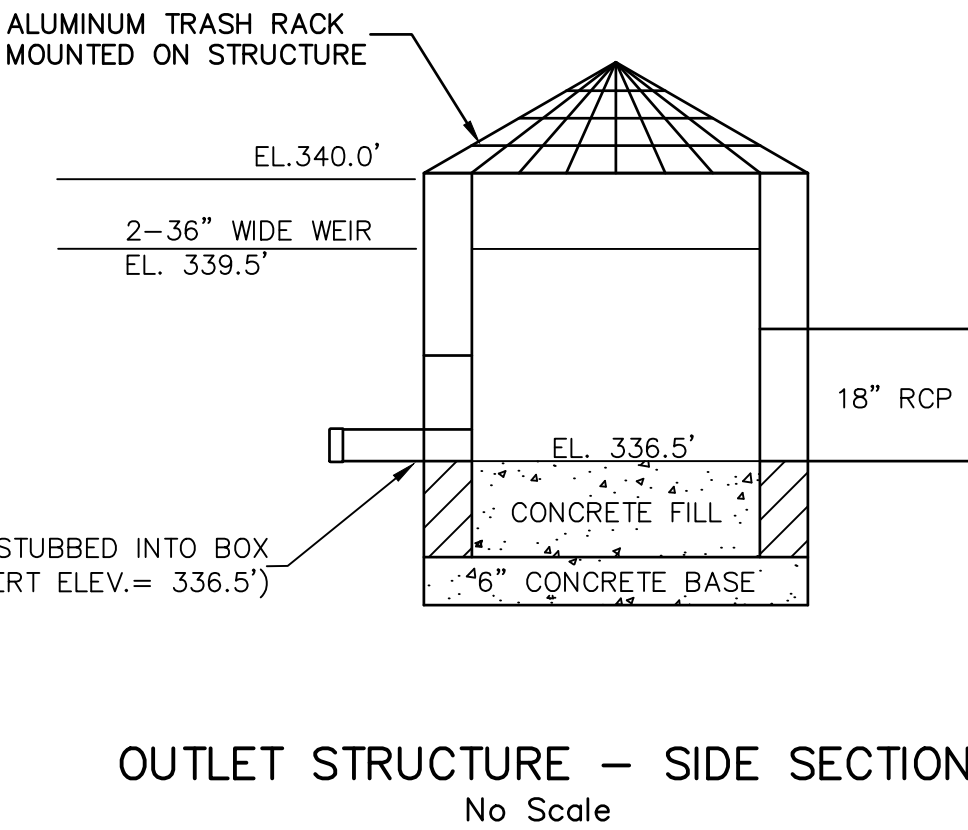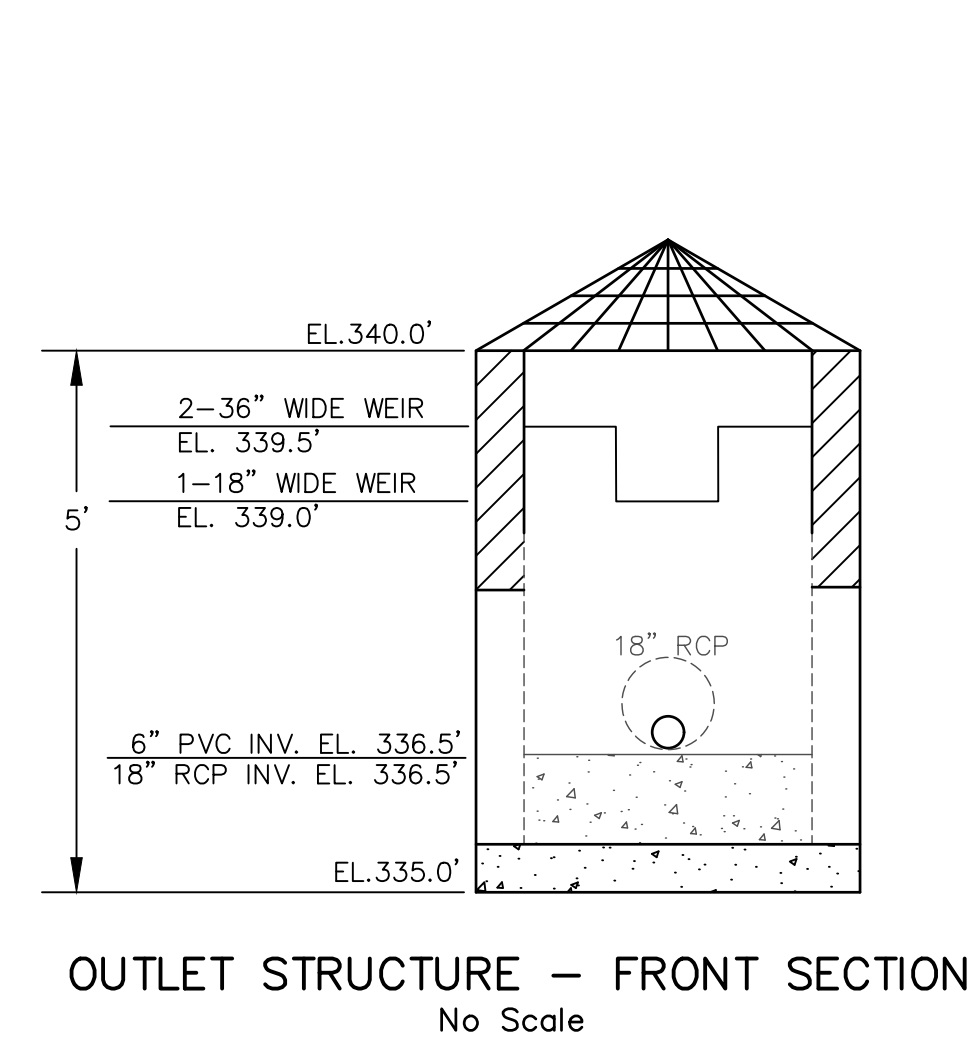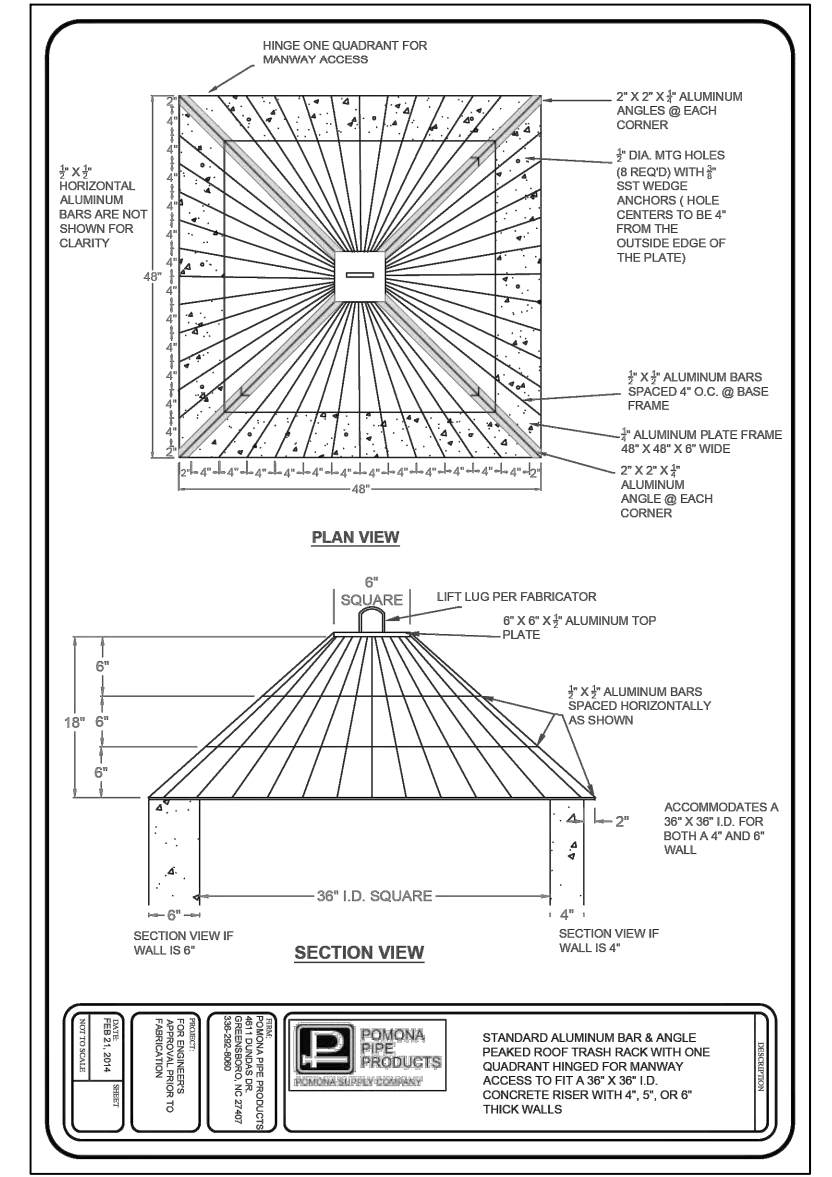





PRELIMINARY PEAK FLOW REDUCTION

RETURN EVENT (YEARS)	PREDEVELOPED PEAK RUN-OFF (CFS)	POST DEVELOPED PEAK RUN-OFF (CFS)	REDUCTION (%)
1	1.12	0.25	77.7%
2	1.70	0.81	52.4%
10	3.91	3.14	19.7%
25	4.98	4.37	12.2%

* Note - 1 year post dev. peak run-off must not exceed 1 year pre-dev. peak run-off and 10 year and 25 year post dev. peak run-off must be 10% less than 10 year and 25 year pre-dev. peak run-off

UNDERDRAIN CALCULATIONS
n=0.011

CELL I.D.	DRAIN DIA. IN.	SLOPE FT/FT	DESIGN FLOW CFS	D VALUE	# OF DRAINS REQUIRED
N. Bio	4	0.01	0.28	4.338	2
S. Bio	4	0.01	0.08	2.712	2

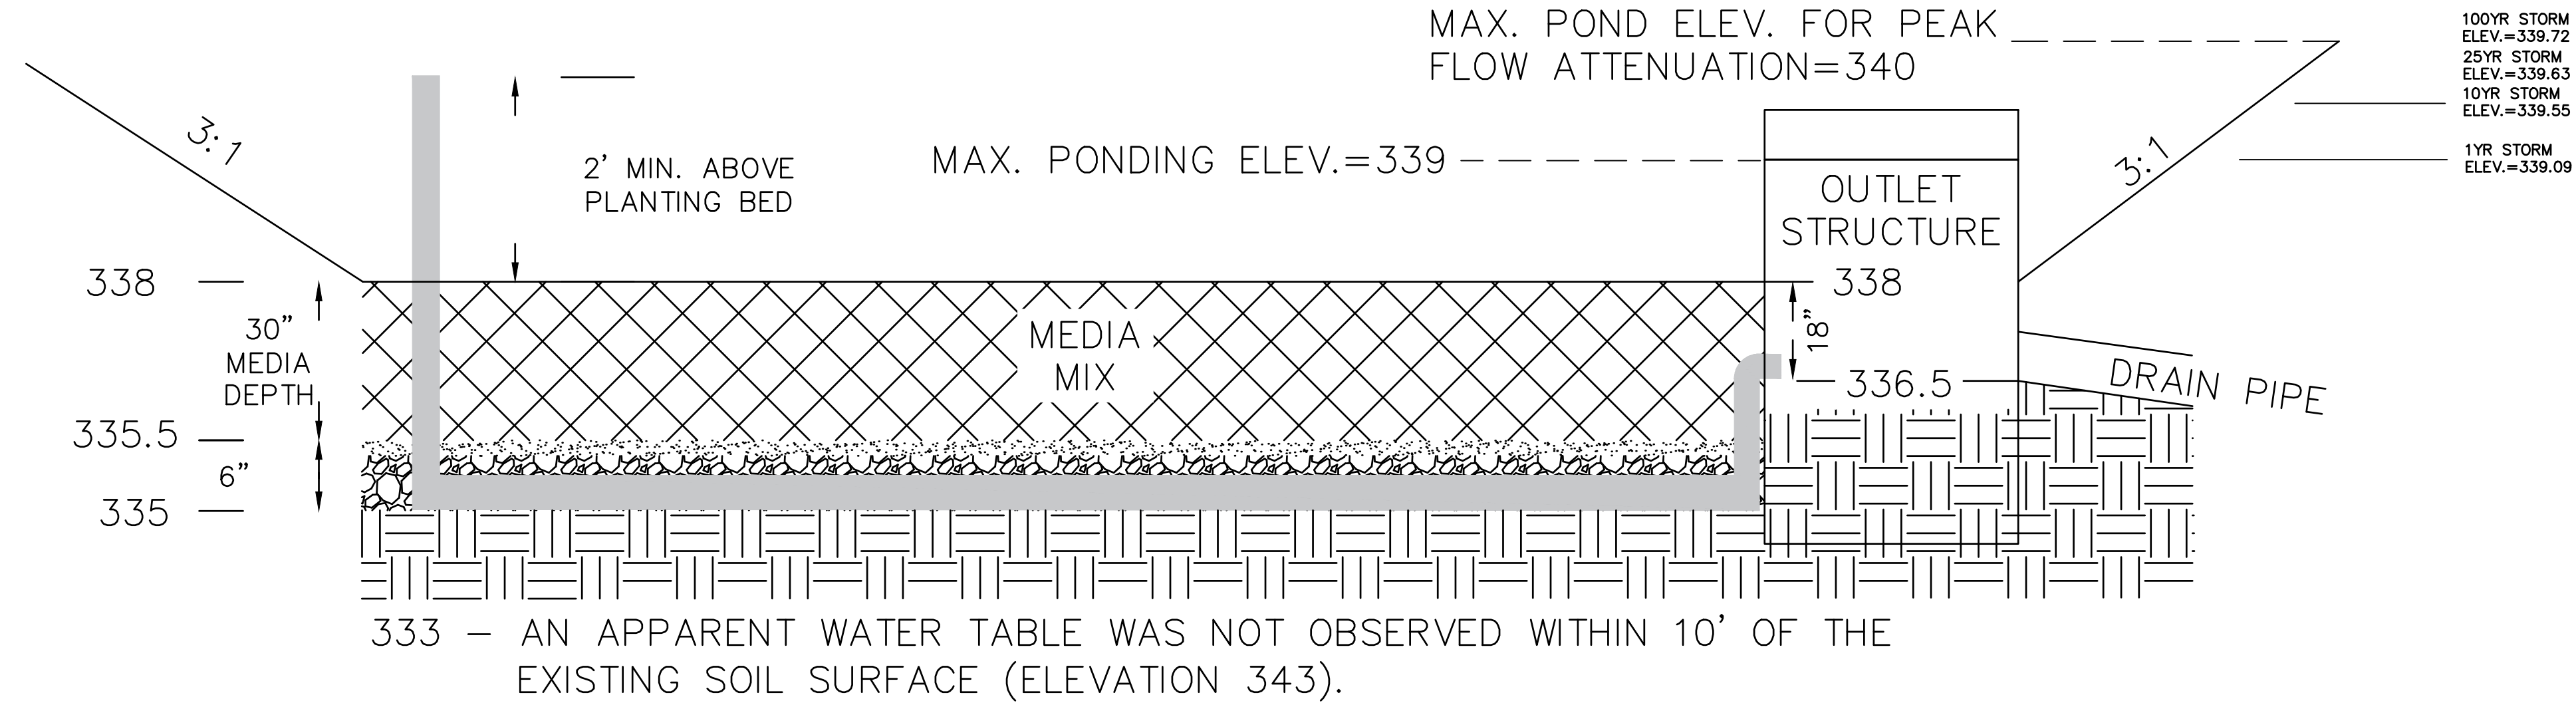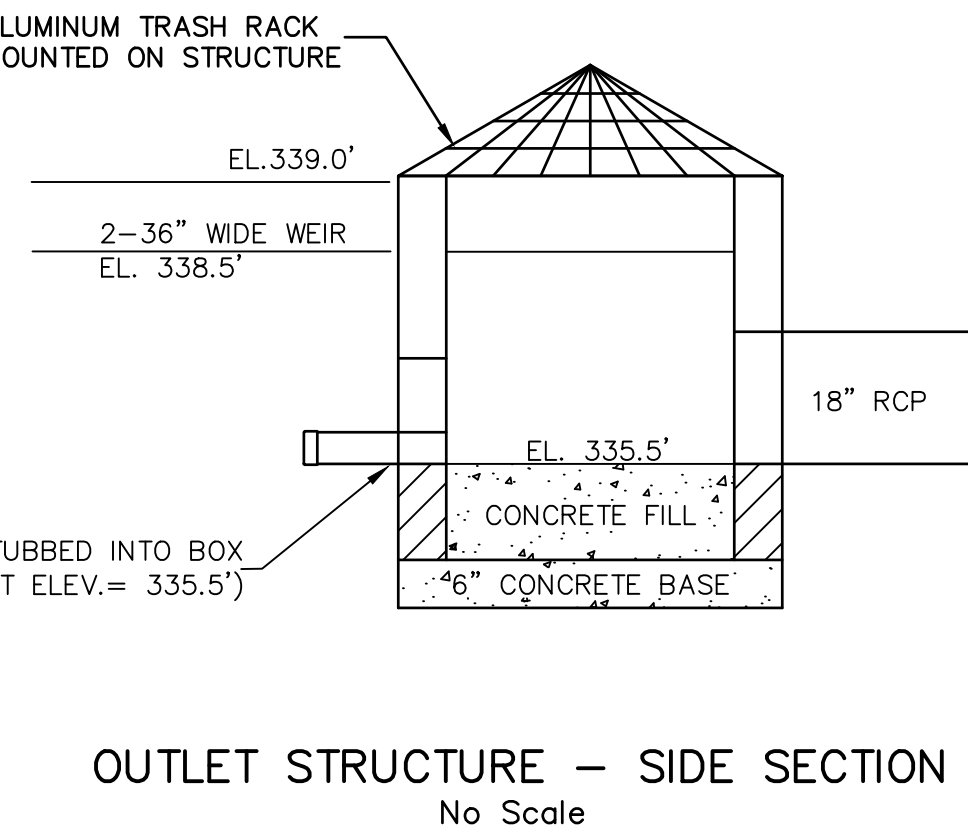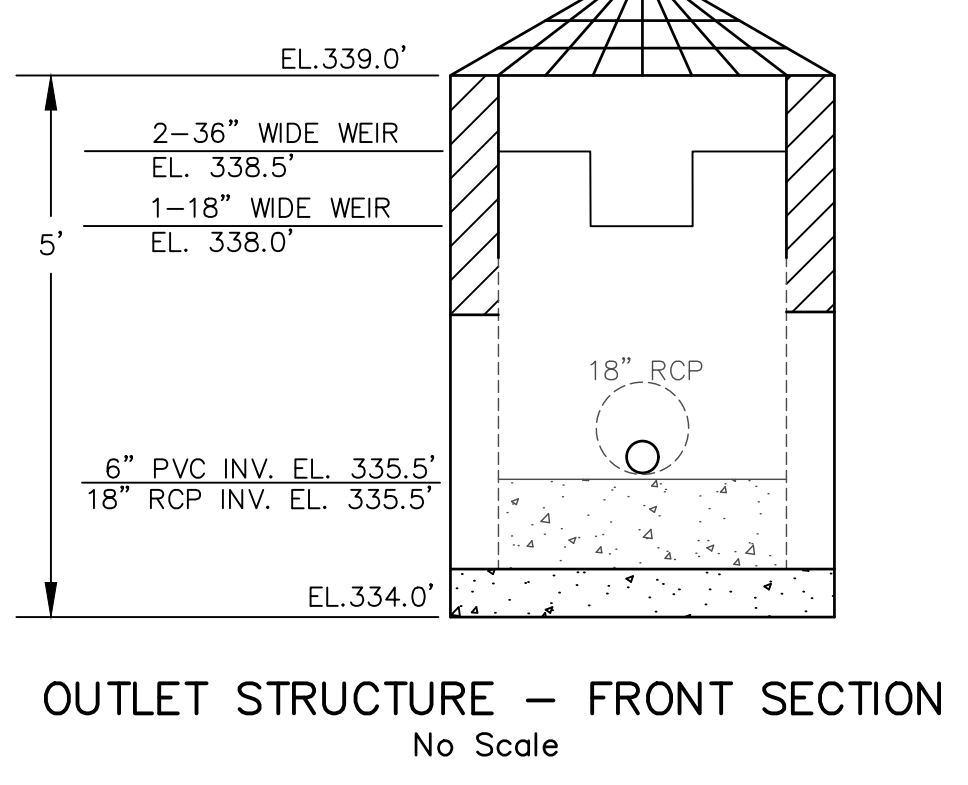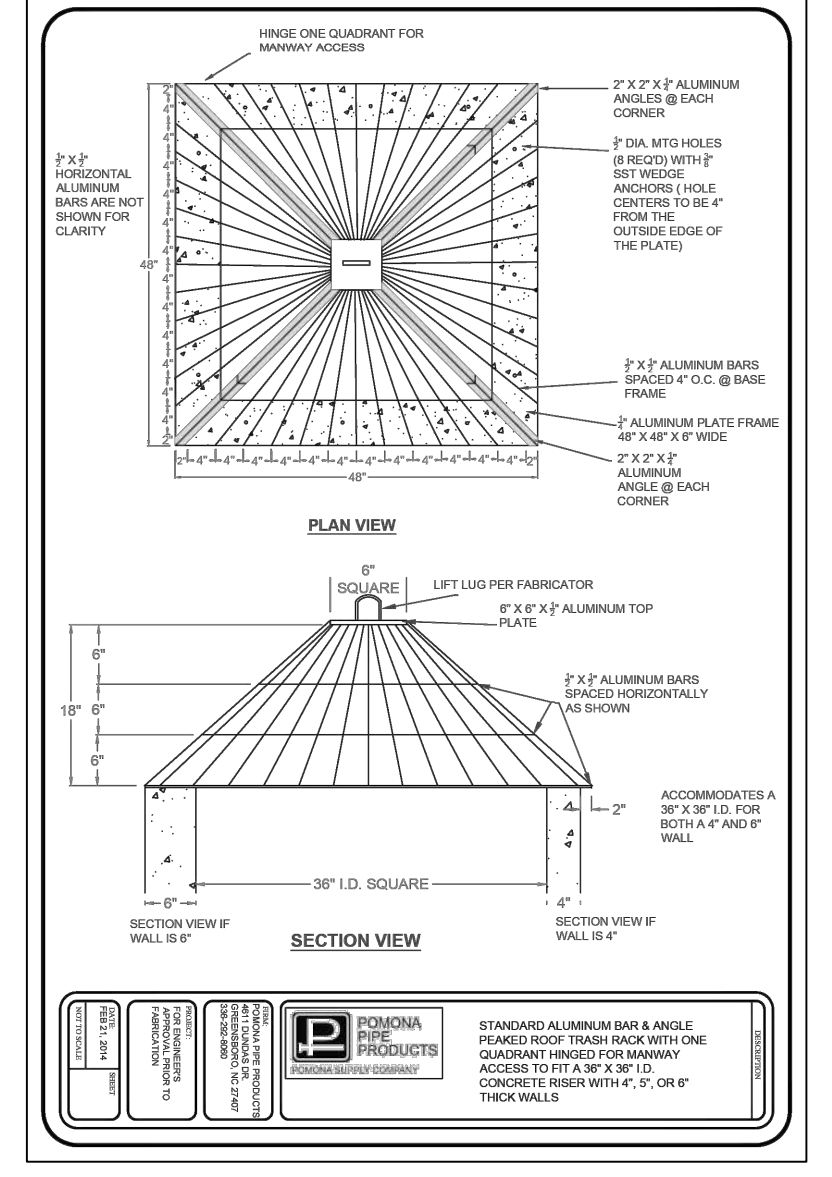

RISER BOUANCY CALCULATION - N. BIORETENTION CELL

RISER BOX (Precast Concrete)				ANTI-FLOTATION FILL				TOTAL		
LENGTH	WIDTH	THICKNS	DEPTH	WEIGHT	DISPLACD	LENGTH	WIDTH	THICKNS	PROP. WT	REQ. WT
INCH	INCH	INCH	FT	LBS	H2O LBS	FT	FT	INCH	LBS	LBS
48	48	6	5	8625.00	8580.00	3	3	12	9975.00	9438.00

* REQUIRED WEIGHT MUST BE 110% OF THE WEIGHT OF DISPLACED WATER

N. BIORETENTION POND SECTION
NO SCALE

NOTE: BIORETENTION CELL DRAWDOWN IN ACCORDANCE WITH N.C.D.E.Q. M.D.C. FOR MEDIA MIX, MIN: 1 IN/HR.

4" OF WASHED #57 STONE ABOVE AND ON EACH SIDE OF THE PIPE. ABOVE THE STONE, INSTALL FILTER FABRIC. ABOVE THE FILTER FABRIC, INSTALL 2" OF WASHED SAND.

328 - AN APPARENT WATER TABLE WAS NOT OBSERVED WITHIN 10' OF THE EXISTING SOIL SURFACE (ELEVATION 338).

4" OF WASHED #57 STONE ABOVE AND ON EACH SIDE OF THE PIPE. ABOVE THE STONE, INSTALL FILTER FABRIC. ABOVE THE FILTER FABRIC, INSTALL 2" OF WASHED SAND.

RISER BOUANCY CALCULATION - S. BIORETENTION CELL

RISER BOX (Precast Concrete)				ANTI-FLOTATION FILL				TOTAL		
LENGTH	WIDTH	THICKNS	DEPTH	WEIGHT	DISPLACD	LENGTH	WIDTH	THICKNS	PROP. WT	REQ. WT
INCH	INCH	INCH	FT	LBS	H2O LBS	FT	FT	INCH	LBS	LBS
48	48	6	5	8625.00	8580.00	3	3	12	9975.00	9438.00


* REQUIRED WEIGHT MUST BE 110% OF THE WEIGHT OF DISPLACED WATER

S. BIORETENTION POND SECTION
NO SCALE

NOTE: MEDIA MIX SHALL BE A HOMOGENEOUS SOIL MIX ENGINEERED MEDIA BLEND WITH APPROXIMATE VOLUMES OF:

- (A) 75-85 PERCENT MEDIUM TO COARSE WASHED SAND (ASTM C33, AASHTO M 6/M 80, ASTM C330, AASHTO M195, OR EQUIVALENT)
- (B) 8-15 PERCENT FINES (SILT AND CLAY)
- (C) 5-15 PERCENT ORGANIC MATTER (SUCH AS PINE BARK FINES)

NOTE: PLANTINGS FOR THE BIORETENTION CELLS SHALL ACHIEVE A MINIMUM OF 75 PERCENT PLANT COVERAGE AT FIVE YEARS AFTER PLANTING. IF SOD IS USED, THEN IT SHALL BE A NON-CLUMPING, DEEP-ROOTED SPECIES.

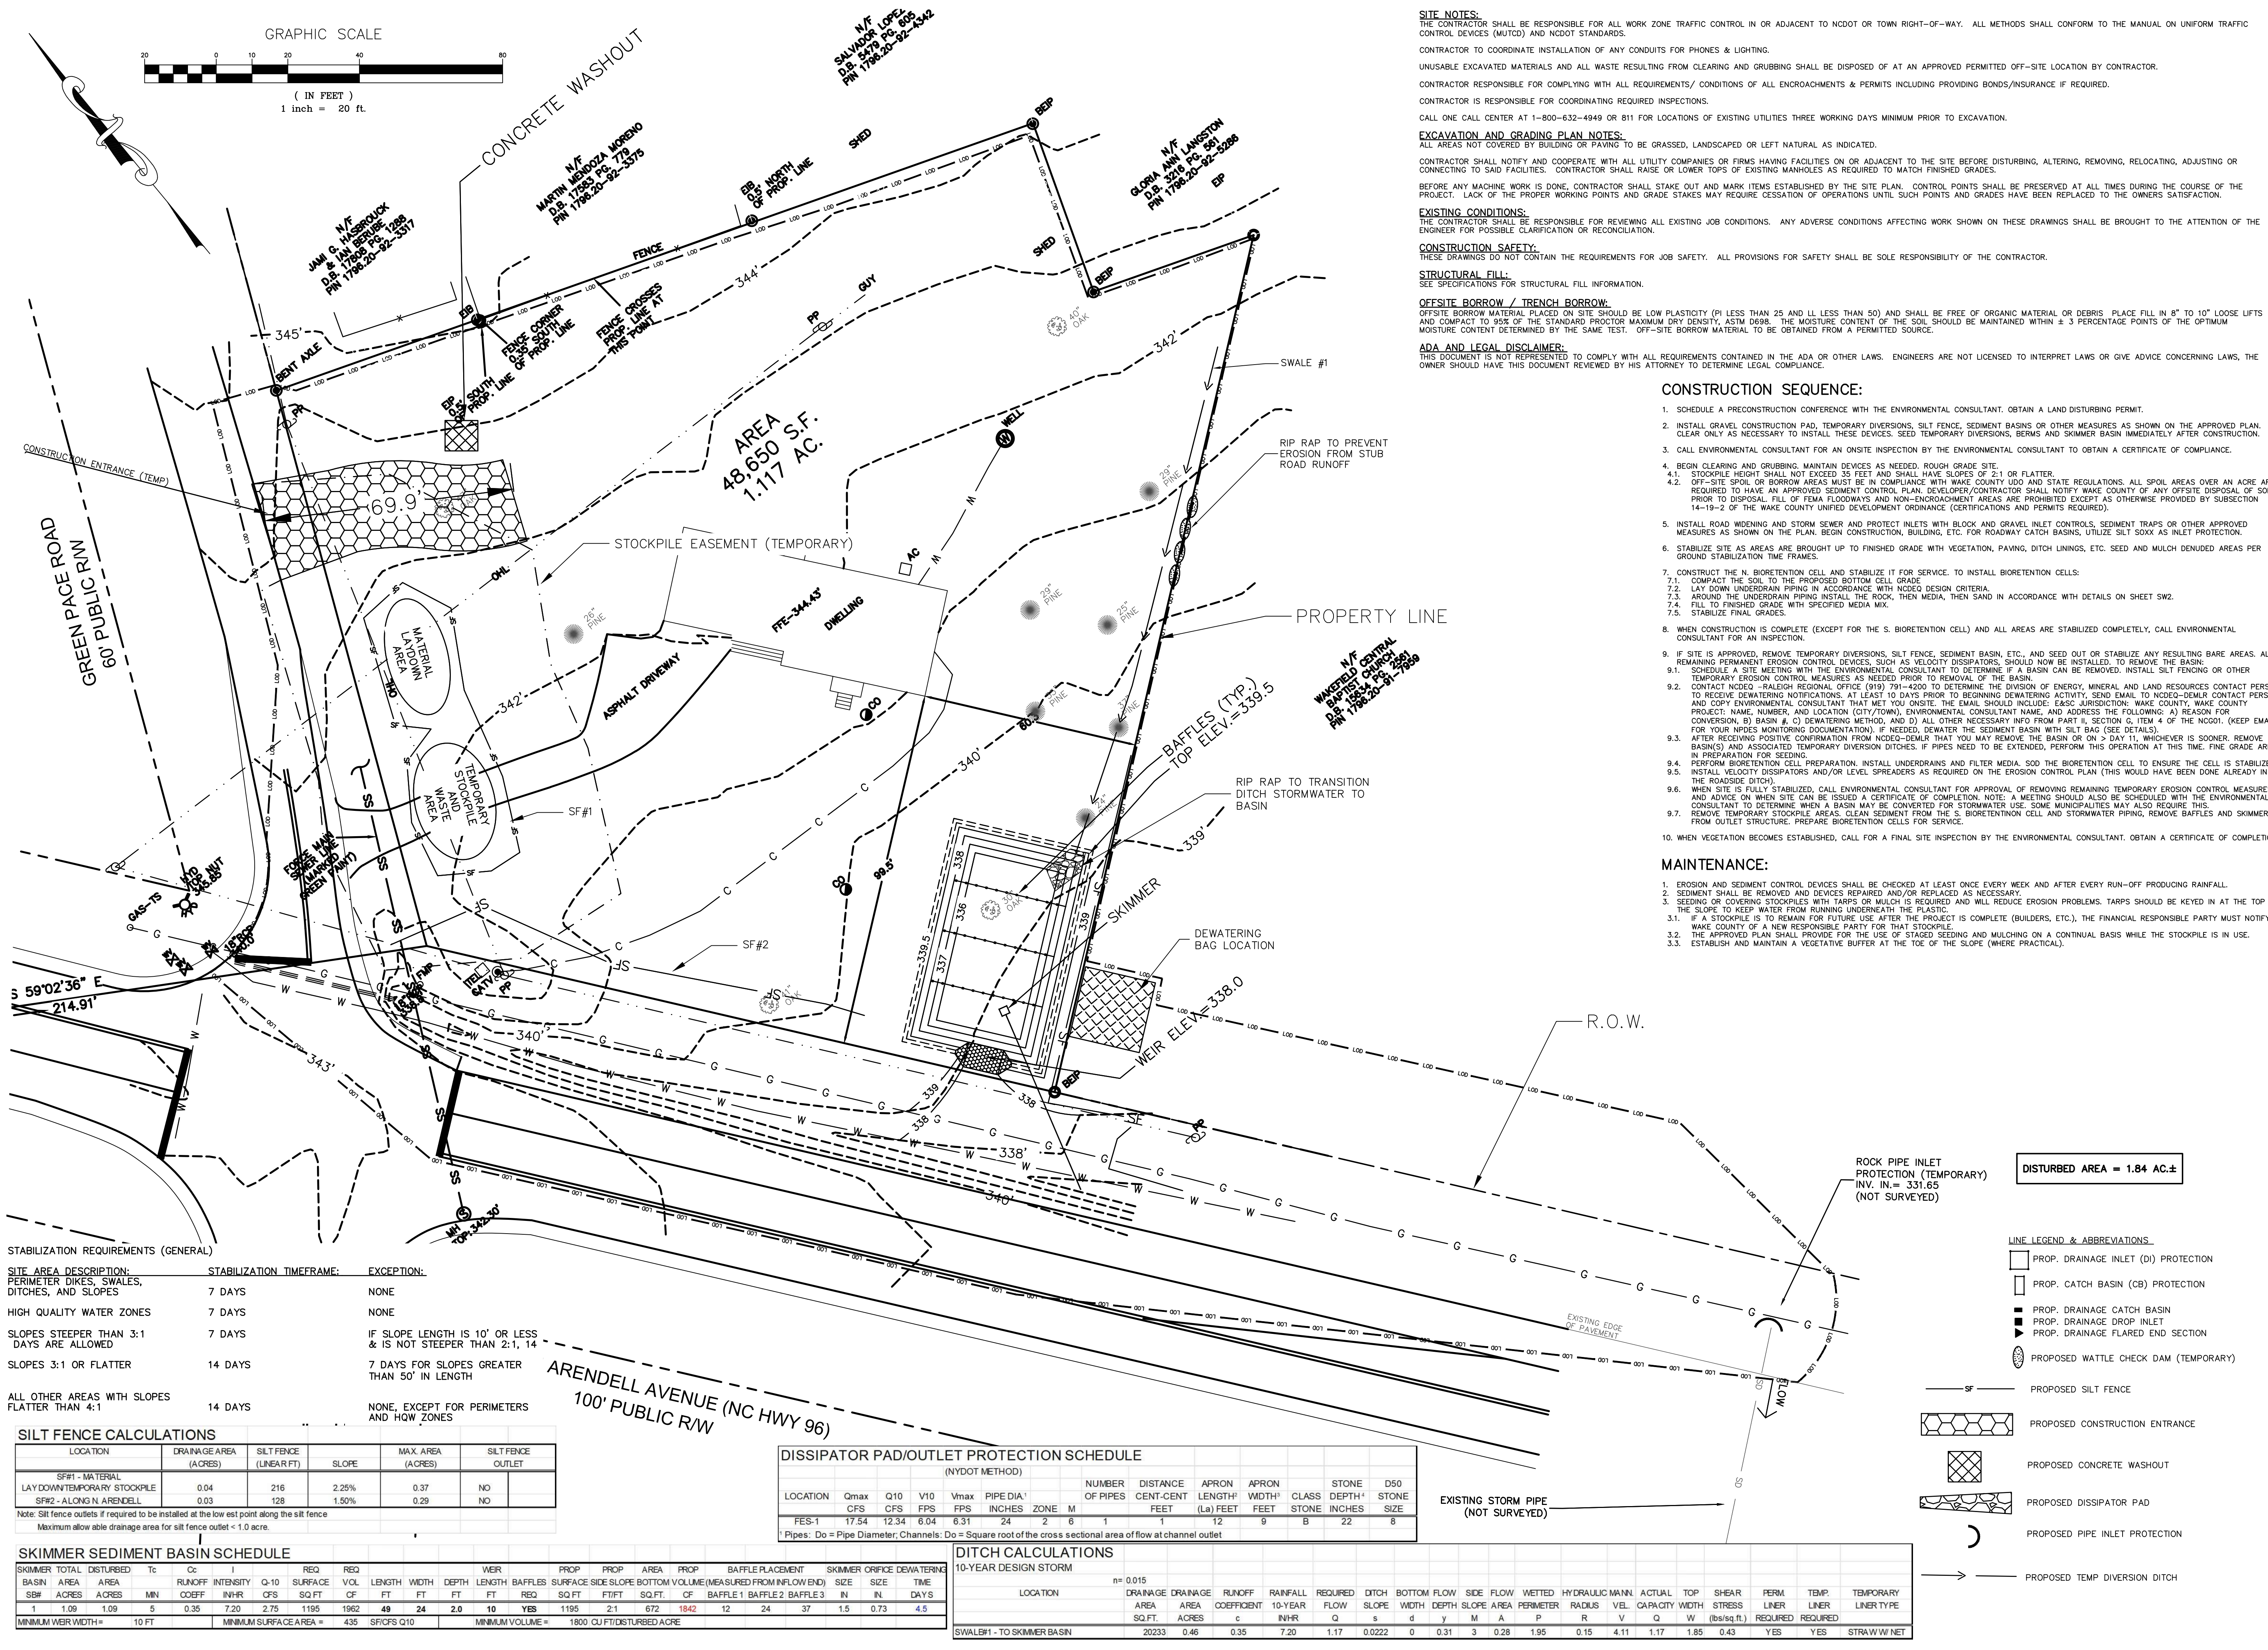

SITE NOTES:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL WORK ZONE TRAFFIC CONTROL IN OR ADJACENT TO NCDOT OR TOWN RIGHT-OF-WAY. ALL METHODS SHALL CONFORM TO THE MANUAL ON UNIFORM TRAFFIC CONTROL DEVICES (MUTCD) AND NCDOT STANDARDS.
CONTRACTOR TO COORDINATE INSTALLATION OF ANY CONDUITS FOR PHONES & LIGHTING.
UNUSABLE EXCAVATED MATERIALS AND ALL WASTE RESULTING FROM CLEARING AND GRUBBING SHALL BE DISPOSED OF AT AN APPROVED PERMITTED OFF-SITE LOCATION BY CONTRACTOR.
CONTRACTOR RESPONSIBLE FOR COMPLYING WITH ALL REQUIREMENTS/ CONDITIONS OF ALL ENCROACHMENTS & PERMITS INCLUDING PROVIDING BONDS/INSURANCE IF REQUIRED.
CONTRACTOR IS RESPONSIBLE FOR COORDINATING REQUIRED INSPECTIONS.
CALL ONE CALL CENTER AT 1-800-632-4949 OR 811 FOR LOCATIONS OF EXISTING UTILITIES THREE WORKING DAYS MINIMUM PRIOR TO EXCAVATION.
EXCAVATION AND GRADING PLAN NOTES:
ALL AREAS NOT COVERED BY BUILDING OR PAVING TO BE GRASSED, LANDSCAPED OR LEFT NATURAL AS INDICATED.
CONTRACTOR SHALL NOTIFY AND COOPERATE WITH ALL UTILITY COMPANIES OR FIRMS HAVING FACILITIES ON OR ADJACENT TO THE SITE BEFORE DISTURBING, ALTERING, REMOVING, RELOCATING, ADJUSTING OR CONNECTING TO SAID FACILITIES. CONTRACTOR SHALL RAISE OR LOWER TOPS OF EXISTING MANHOLES AS REQUIRED TO MATCH FINISHED GRADES.
BEFORE ANY MACHINE WORK IS DONE, CONTRACTOR SHALL STAKE OUT AND MARK ITEMS ESTABLISHED BY THE SITE PLAN. CONTROL POINTS SHALL BE PRESERVED AT ALL TIMES DURING THE COURSE OF THE PROJECT. LACK OF THE PROPER WORKING POINTS AND GRADE STAKES MAY REQUIRE CESSATION OF OPERATIONS UNTIL SUCH POINTS AND GRADES HAVE BEEN REPLACED TO THE OWNERS SATISFACTION.
EXISTING CONDITIONS:
THE CONTRACTOR SHALL BE RESPONSIBLE FOR REVIEWING ALL EXISTING JOB CONDITIONS. ANY ADVERSE CONDITIONS AFFECTING WORK SHOWN ON THESE DRAWINGS SHALL BE BROUGHT TO THE ATTENTION OF THE ENGINEER FOR POSSIBLE CLARIFICATION OR RECONCILIATION.
CONSTRUCTION SAFETY:
THESE DRAWINGS DO NOT CONTAIN THE REQUIREMENTS FOR JOB SAFETY. ALL PROVISIONS FOR SAFETY SHALL BE SOLE RESPONSIBILITY OF THE CONTRACTOR.
STRUCTURAL FILL:
SEE SPECIFICATIONS FOR STRUCTURAL FILL INFORMATION.
OFFSITE BORROW / TRENCH BORROW:
OFFSITE BORROW MATERIAL PLACED ON SITE SHOULD BE LOW PLASTICITY (PI LESS THAN 25 AND LL LESS THAN 50) AND SHALL BE FREE OF ORGANIC MATERIAL OR DEBRIS. PLACE FILL IN 8" TO 10" LOOSE LIFTS AND COMPACT TO 95% OF THE STANDARD PROCTOR MAXIMUM DRY DENSITY, ASTM D698. THE MOISTURE CONTENT OF THE SOIL SHOULD BE MAINTAINED WITHIN ± 3 PERCENTAGE POINTS OF THE OPTIMUM MOISTURE CONTENT DETERMINED BY THE SAME TEST. OFF-SITE BORROW MATERIAL TO BE OBTAINED FROM A PERMITTED SOURCE.
ADA AND LEGAL DISCLAIMER:
THIS DOCUMENT IS NOT REPRESENTED TO COMPLY WITH ALL REQUIREMENTS CONTAINED IN THE ADA OR OTHER LAWS. ENGINEERS ARE NOT LICENSED TO INTERPRET LAWS OR GIVE ADVICE CONCERNING LAWS, THE OWNER SHOULD HAVE THIS DOCUMENT REVIEWED BY HIS ATTORNEY TO DETERMINE LEGAL COMPLIANCE.

- CONSTRUCTION SEQUENCE:**
- SCHEDULE A PRECONSTRUCTION CONFERENCE WITH THE ENVIRONMENTAL CONSULTANT. OBTAIN A LAND DISTURBING PERMIT.
 - INSTALL GRAVEL CONSTRUCTION PAD, TEMPORARY DIVERSIONS, SILT FENCE, SEDIMENT BASINS OR OTHER MEASURES AS SHOWN ON THE APPROVED PLAN. CLEAR ONLY AS NECESSARY TO INSTALL THESE DEVICES. SEED TEMPORARY DIVERSIONS, BEAMS AND SKIMMER BASIN IMMEDIATELY AFTER CONSTRUCTION.
 - CALL ENVIRONMENTAL CONSULTANT FOR AN ONSITE INSPECTION BY THE ENVIRONMENTAL CONSULTANT TO OBTAIN A CERTIFICATE OF COMPLIANCE.
 - BEGIN CLEARING AND GRUBBING. MAINTAIN DEVICES AS NEEDED. ROUGH GRADE SITE.
 - STOCKPILE HEIGHT SHALL NOT EXCEED 35 FEET AND SHALL MAINTAIN SLOPES OF 2:1 OR FLATTER.
 - OFF-SITE SPOIL OR BORROW AREAS MUST BE IN COMPLIANCE WITH WAKE COUNTY UDD AND STATE REGULATIONS. ALL SPOIL AREAS OVER AN ACRE ARE REQUIRED TO HAVE AN APPROVED SEDIMENT CONTROL PLAN. DEVELOPER/CONTRACTOR SHALL NOTIFY WAKE COUNTY OF ANY OFFSITE DISPOSAL OF SOIL PRIOR TO DISPOSAL. FILL OF FEMA FLOODWAYS AND NON-ENCROACHMENT AREAS ARE PROHIBITED EXCEPT AS OTHERWISE PROVIDED BY SUBSECTION 14-19-2 OF THE WAKE COUNTY UNIFIED DEVELOPMENT ORDINANCE (CERTIFICATIONS AND PERMITS REQUIRED).
 - INSTALL ROAD WIDENING AND STORM SEWER AND PROTECT INLETS WITH BLOCK AND GRAVEL INLET CONTROL, SEDIMENT TRAPS OR OTHER APPROVED MEASURES AS SHOWN ON THE PLAN. BEGIN CONSTRUCTION, BUILDING, ETC. FOR ROADWAY CATCH BASINS, UTILIZE SILT SOXK AS INLET PROTECTION.
 - STABILIZE SITE AS AREAS ARE BROUGHT UP TO FINISHED GRADE WITH VEGETATION, PAVING, DITCH LININGS, ETC. SEED AND MULCH DENUDED AREAS PER GROUND STABILIZATION TIME FRAMES.
 - CONSTRUCT THE N. BIORETENTION CELL AND STABILIZE IT FOR SERVICE. TO INSTALL BIORETENTION CELLS:
 - COMPACT THE SOIL TO THE PROPOSED BOTTOM CELL GRADE.
 - LAY DOWN UNDERDRAIN PIPING IN ACCORDANCE WITH NCDOT DESIGN CRITERIA.
 - AROUND THE UNDERDRAIN PIPING INSTALL THE ROCK, THEN MEDIA, THEN SAND IN ACCORDANCE WITH DETAILS ON SHEET SW2.
 - FILL TO FINISHED GRADE WITH SPECIFIED MEDIA MIX.
 - STABILIZE FINAL GRADES.
 - WHEN CONSTRUCTION IS COMPLETE (EXCEPT FOR THE S. BIORETENTION CELL) AND ALL AREAS ARE STABILIZED COMPLETELY, CALL ENVIRONMENTAL CONSULTANT FOR AN INSPECTION.
 - IF SITE IS APPROVED, REMOVE TEMPORARY DIVERSIONS, SILT FENCE, SEDIMENT BASIN, ETC., AND SEED OUT OR STABILIZE ANY RESULTING BARE AREAS. ALL REMAINING PERMANENT EROSION CONTROL DEVICES, SUCH AS VELOCITY DISSIPATORS, SHOULD NOW BE INSTALLED. TO REMOVE THE BASIN:
 - SCHEDULE A SITE MEETING WITH THE ENVIRONMENTAL CONSULTANT TO DETERMINE IF A BASIN CAN BE REMOVED. INSTALL SILT FENCING OR OTHER TEMPORARY EROSION CONTROL MEASURES AS NEEDED PRIOR TO REMOVAL OF THE BASIN.
 - CONTACT NCDOT - RALEIGH REGIONAL OFFICE (919) 791-4200 TO DETERMINE THE DIVISION OF ENERGY, MINERAL AND LAND RESOURCES CONTACT PERSON TO RECEIVE DEWATERING NOTIFICATIONS. AT LEAST 10 DAYS PRIOR TO BEGINNING DEWATERING ACTIVITY, SEND EMAIL TO NCDOT-DEMUR CONTACT PERSON AND COPY ENVIRONMENTAL CONSULTANT THAT MET YOU ON SITE. THE EMAIL SHOULD INCLUDE: E&S JURISDICTION; WAKE COUNTY; WAKE COUNTY PROJECT; NAME, NUMBER, AND LOCATION (CITY/TOWN), ENVIRONMENTAL CONSULTANT NAME, AND ADDRESS THE FOLLOWING: A) REASON FOR CONVERSION, B) BASIN #, C) DEWATERING METHOD, AND D) ALL OTHER NECESSARY INFO FROM PART II, SECTION G, ITEM 4 OF THE NCGO1. (KEEP EMAIL FOR YOUR FILES MONITORING DOCUMENTATION). IF NEEDED, DEWATER THE SEDIMENT BASIN WITH SILT BAG (SEE DETAILS).
 - AFTER RECEIVING POSITIVE CONFIRMATION FROM NCDOT-DEMUR THAT YOU MAY REMOVE THE BASIN OR ON > DAY 11, WHICHEVER IS SOONER, REMOVE BASIN(S) AND ASSOCIATED TEMPORARY DIVERSION DITCHES. IF PIPES NEED TO BE EXTENDED, PERFORM THIS OPERATION AT THIS TIME. FINE GRADE AREA IN PREPARATION FOR SEEDING.
 - PERFORM BIORETENTION CELL PREPARATION. INSTALL UNDERDRAINS AND FILTER MEDIA. SOD THE BIORETENTION CELL TO ENSURE THE CELL IS STABILIZED.
 - INSTALL VELOCITY DISSIPATORS AND/OR LEVEL SPREADERS AS REQUIRED ON THE EROSION CONTROL PLAN (THIS WOULD HAVE BEEN DONE ALREADY IN THE ROADSIDE DITCH).
 - WHEN SITE IS FULLY STABILIZED, CALL ENVIRONMENTAL CONSULTANT FOR APPROVAL OF REMOVING REMAINING TEMPORARY EROSION CONTROL MEASURES AND ADVISE ON WHEN SITE CAN BE ISSUED A CERTIFICATE OF COMPLETION. NOTE: A MEETING SHOULD ALSO BE SCHEDULED WITH THE ENVIRONMENTAL CONSULTANT TO DETERMINE WHEN A BASIN MAY BE CONVERTED FOR STORMWATER USE. SOME MUNICIPALITIES MAY ALSO REQUIRE THIS.
 - REMOVE TEMPORARY STOCKPILE AREAS, CLEAN SEDIMENT FROM THE S. BIORETENTION CELL, AND STORMWATER PIPING, REMOVE BAFFLES AND SKIMMER FROM OUTLET STRUCTURE. PREPARE BIORETENTION CELLS FOR SERVICE.
 - WHEN VEGETATION BECOMES ESTABLISHED, CALL FOR A FINAL SITE INSPECTION BY THE ENVIRONMENTAL CONSULTANT. OBTAIN A CERTIFICATE OF COMPLETION.

- MAINTENANCE:**
- EROSION AND SEDIMENT CONTROL DEVICES SHALL BE CHECKED AT LEAST ONCE EVERY WEEK AND AFTER EVERY RUN-OFF PRODUCING RAINFALL.
 - SEDIMENT SHALL BE REMOVED AND DEVICES REPAIRED AND/OR REPLACED AS NECESSARY.
 - SEEDING OR COVERING STOCKPILES WITH TARRPS OR MULCH IS REQUIRED AND WILL REDUCE EROSION PROBLEMS. TARRPS SHOULD BE KEPT IN AT THE TOP OF THE SLOPE TO KEEP WATER FROM RUNNING UNDERNEATH THE PLASTIC.
 - IF A STOCKPILE IS TO REMAIN FOR FUTURE USE AFTER THE PROJECT IS COMPLETE (BUILDERS, ETC.), THE FINANCIAL RESPONSIBLE PARTY MUST NOTIFY WAKE COUNTY OF A NEW RESPONSIBLE PARTY FOR THAT STOCKPILE.
 - THE APPROVED PLAN SHALL PROVIDE FOR THE USE OF STAGED SEEDING AND MULCHING ON A CONTINUAL BASIS WHILE THE STOCKPILE IS IN USE.
 - ESTABLISH AND MAINTAIN A VEGETATIVE BUFFER AT THE TOP OF THE SLOPE (WHERE PRACTICAL).

STABILIZATION REQUIREMENTS (GENERAL)

SITE AREA DESCRIPTION:	STABILIZATION TIMEFRAME:	EXCEPTION:
PERIMETER DIKES, SWALES, DITCHES, AND SLOPES	7 DAYS	NONE
HIGH QUALITY WATER ZONES	7 DAYS	NONE
SLOPES STEEPER THAN 3:1	7 DAYS	IF SLOPE LENGTH IS 10' OR LESS & IS NOT STEEPER THAN 2:1, 14
SLOPES 3:1 OR FLATTER	14 DAYS	7 DAYS FOR SLOPES GREATER THAN 50' IN LENGTH
ALL OTHER AREAS WITH SLOPES FLATTER THAN 4:1	14 DAYS	NONE, EXCEPT FOR PERIMETERS AND HQW ZONES

SILT FENCE CALCULATIONS

LOCATION	DRAINAGE AREA (ACRES)	SILT FENCE (LINEAR FT)	SLOPE	MAX. AREA (ACRES)	SILT FENCE OUTLET
SF#1 - MATERIAL	0.04	216	2.25%	0.37	NO
SF#2 - ALONG N. ARENDELL	0.03	128	1.50%	0.29	NO

Note: Silt fence outlets if required to be installed at the low end point along the silt fence
Maximum allowable drainage area for silt fence outlet < 1.0 acre.

SKIMMER SEDIMENT BASIN SCHEDULE

BASIN	AREA	MIN	COEFF	INTENSITY	Q-10	SURFACE	VOL	LENGTH	WIDTH	DEPTH	WEIR	BAFFLES	PROP	PROP	AREA	PROP	BAFFLE PLACEMENT	SKIMMER	ORIFICE	DEWATERING			
SB#	ACRES	ACRES		INH/R	CF	SQ FT	CU FT	FT	FT	FT	FT	REQ	REQ	REQ	SQ FT	CF	BAFFLE 1	BAFFLE 2	BAFFLE 3	IN	IN	DAYS	
1	1.09	1.09	5	0.35	7.20	2.75	1195	1962	49	24	2.0	10	YES	1195	2.1	672	1842	12	24	37	1.5	0.73	4.5
MINIMUM WEIR WIDTH = 10 FT																							

DISSIPATOR PAD/OUTLET PROTECTION SCHEDULE

LOCATION	NYDOT METHOD			NUMBER OF PIPES	DISTANCE CENT-CENT FEET	APRON LENGTH' (L _a) FEET	APRON WIDTH' FEET	CLASS STONE	DEPTH' INCHES	D50 STONE SIZE			
	Q _{max} CFS	Q ₁₀ CFS	V ₁₀ FPS										
FES-1	17.54	12.34	6.04	6.31	24	2	6	1	12	9	B	22	8

Pipes: Do = Pipe Diameter; Channels: Do = Square root of the cross sectional area of flow at channel outlet

DITCH CALCULATIONS

10-YEAR DESIGN STORM

LOCATION	DRAINAGE AREA SQ.FT.	DRAINAGE AREA ACRES	COEFFICIENT	RUNOFF INHR	RAINFALL REQUIRED FLOW Q	DITCH SLOPE S	BOTTOM FLOW WIDTH d	SIDE FLOW DEPTH y	WETTED PERIMETER M	HYDRAULIC RADIUS R	ACTUAL VELOCITY V	TOP WIDTH W	SHEAR STRESS (lb/sq.ft.)	PERM LNER	TEMP LNER	TEMPORARY LNER TYPE			
SWALE#1 - TO SKIMMER BASIN	20233	0.46	0.35	7.20	1.17	0.0222	0	0.31	3	0.28	1.95	0.15	4.11	1.17	1.85	0.43	YES	YES	STRAW W/ NET

DISTURBED AREA = 1.84 AC.±
(NOT SURVEYED)

- LINE LEGEND & ABBREVIATIONS:**
- PROP. DRAINAGE INLET (DI) PROTECTION
 - PROP. CATCH BASIN (CB) PROTECTION
 - PROP. DRAINAGE CATCH BASIN
 - PROP. DRAINAGE DROP INLET
 - PROP. DRAINAGE FLARED END SECTION
 - PROPOSED WATTLE CHECK DAM (TEMPORARY)
 - PROPOSED SILT FENCE
 - PROPOSED CONSTRUCTION ENTRANCE
 - PROPOSED DISSIPATOR PAD
 - PROPOSED PIPE INLET PROTECTION
 - PROPOSED TEMP DIVERSION DITCH

ZEBULON ANIMAL HOSPITAL
DVM SERVICES REALTY, LLC

PROJECT NUMBER:


PROJECT PHASE:

















DATE: 5/1/2024

SHEET TITLE:
SEDIMENTATION AND
EROSION CONTROL
PLAN (PHASE 2)

SHEET NUMBER:

SE2

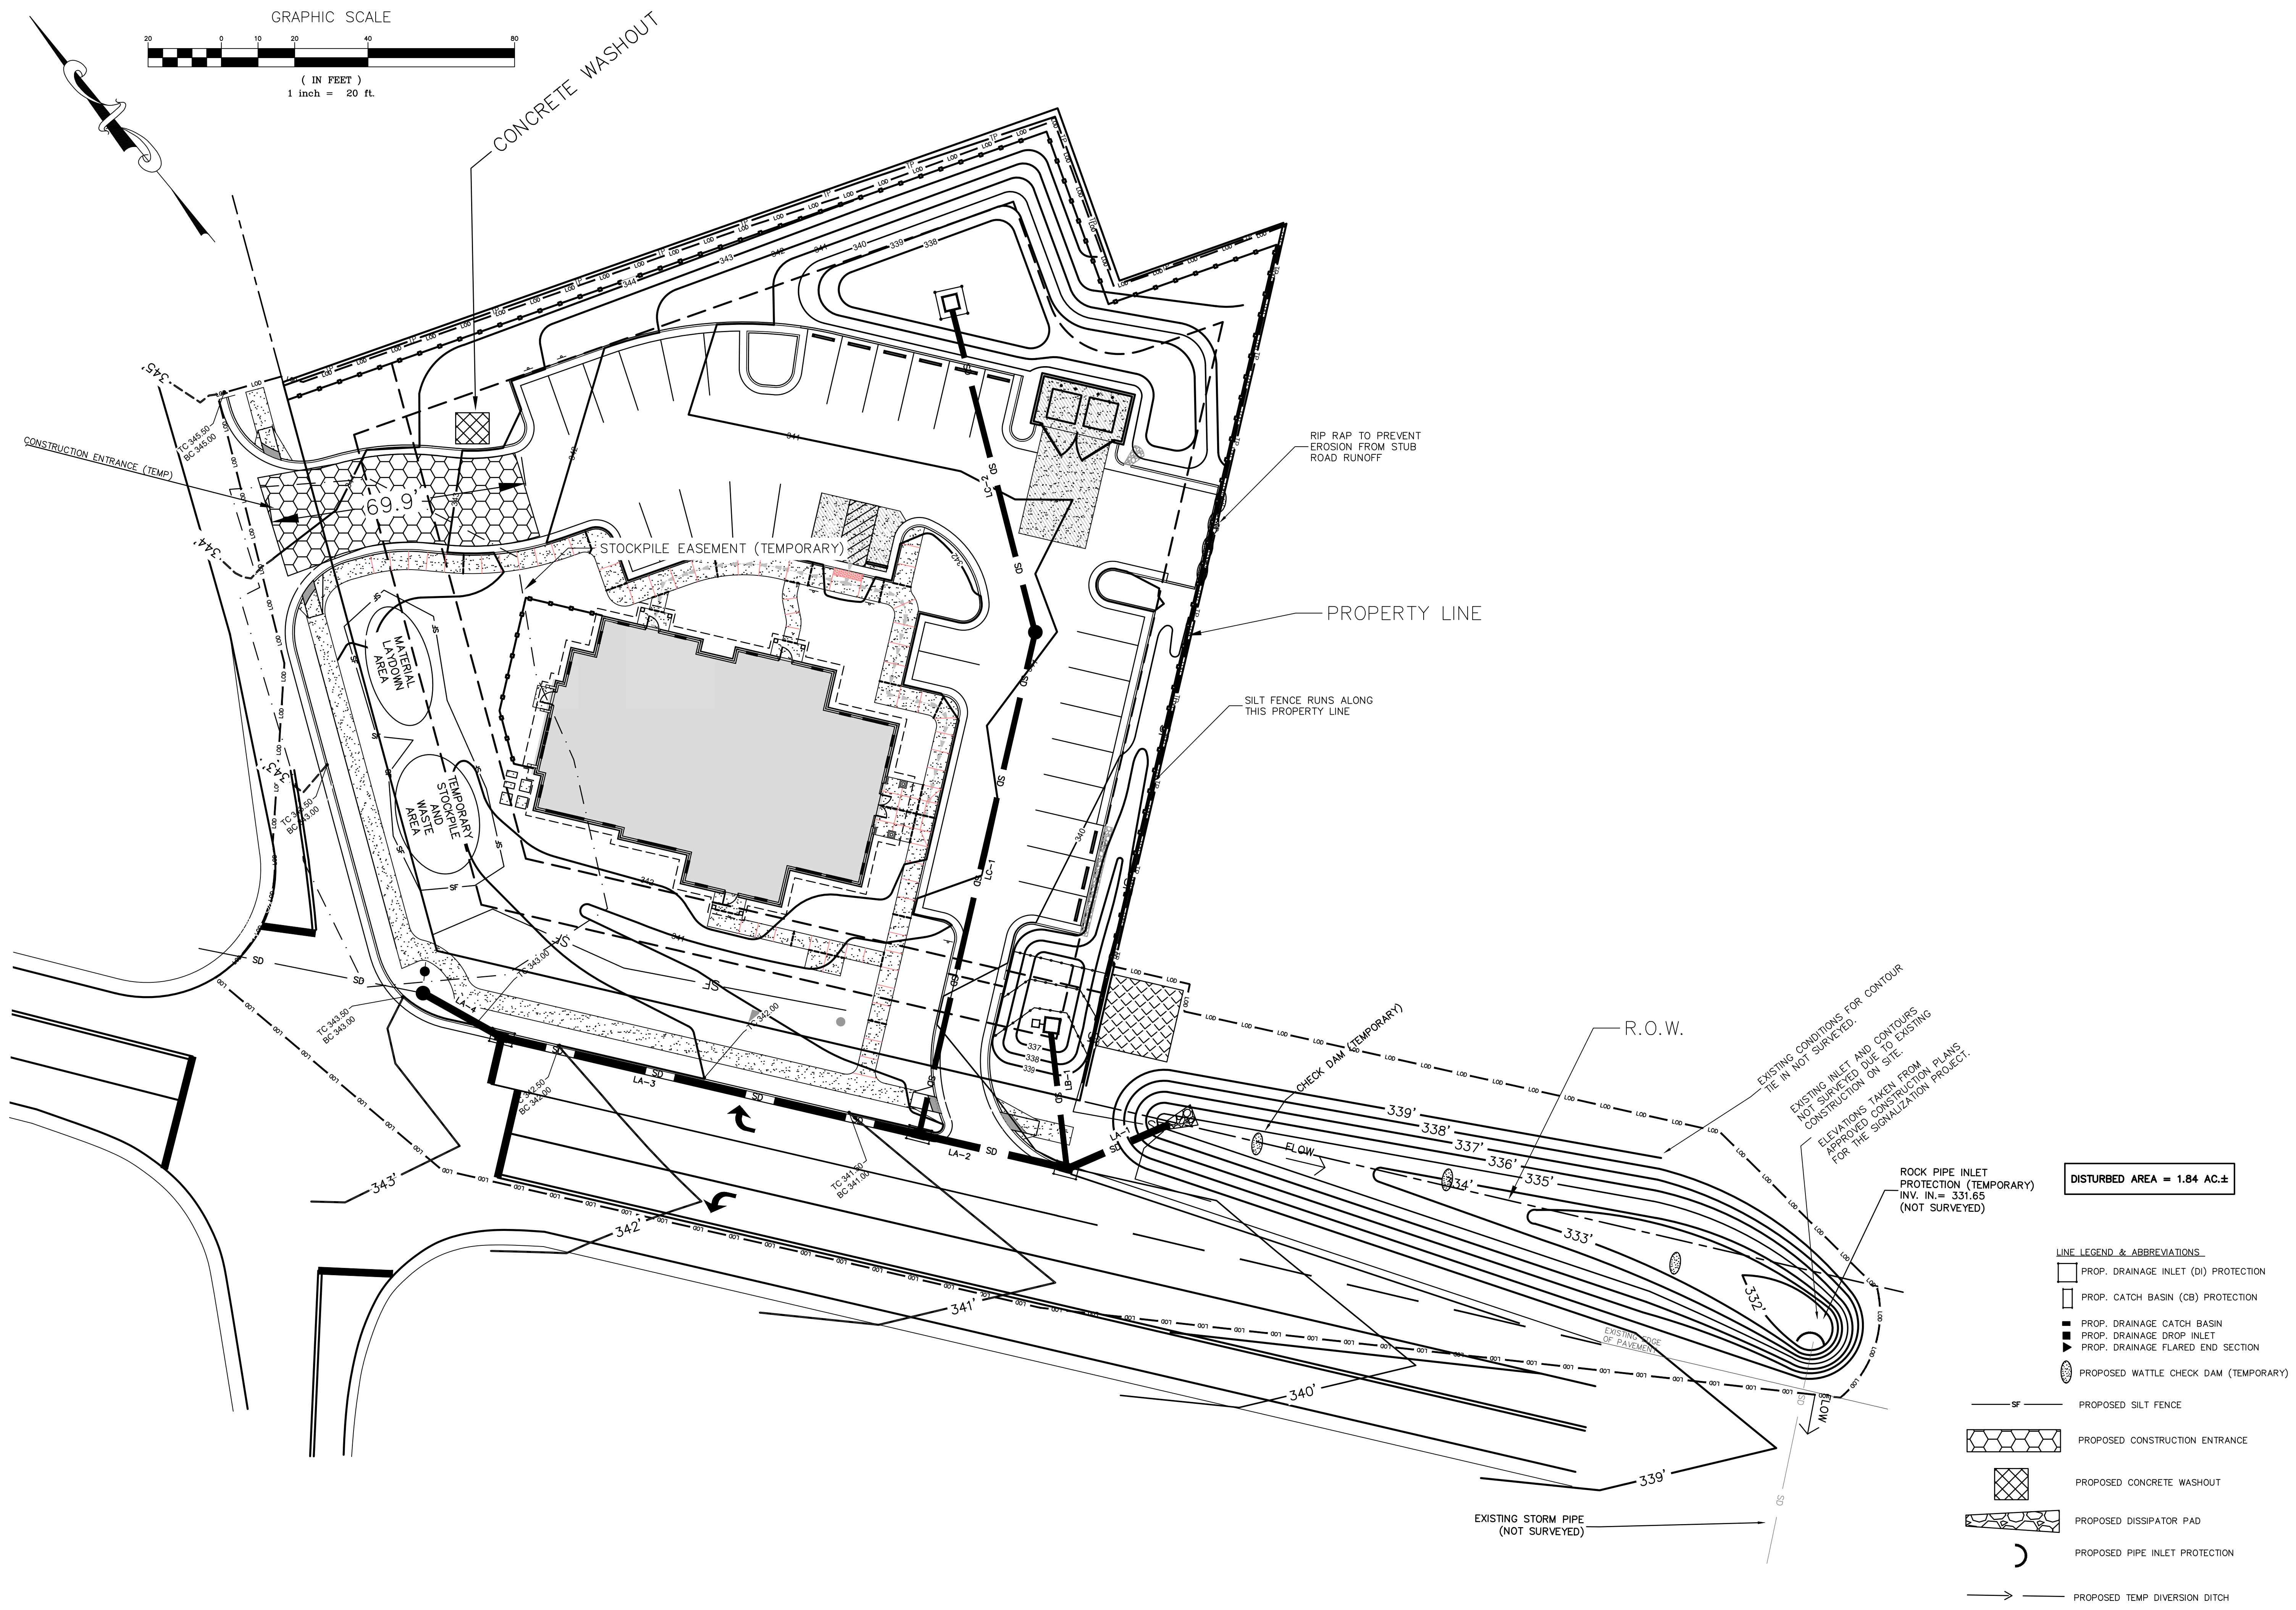

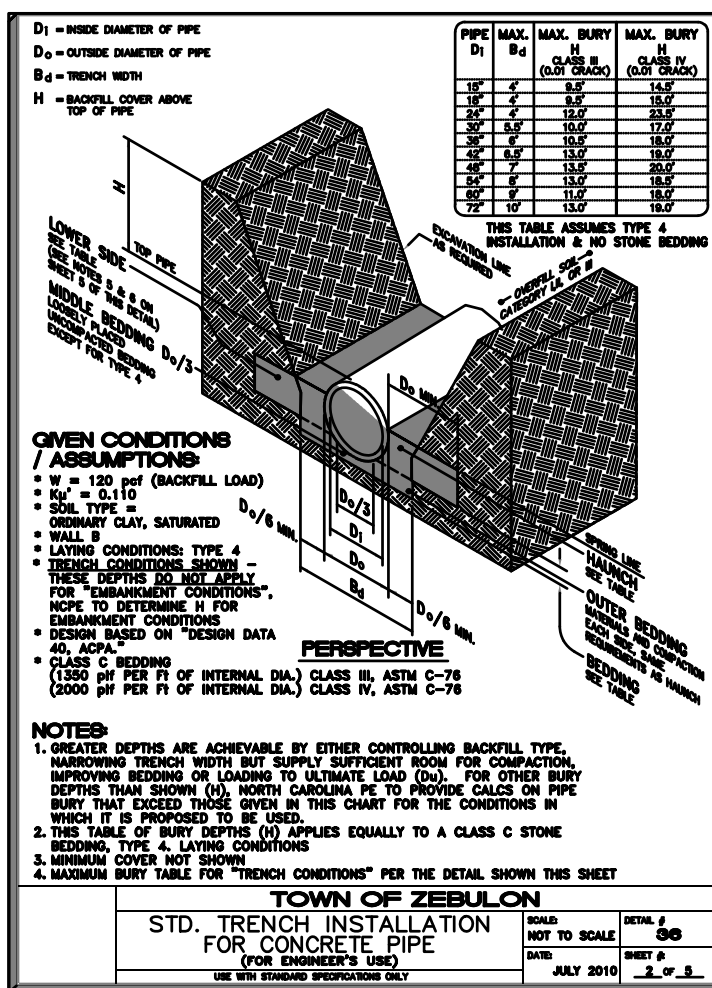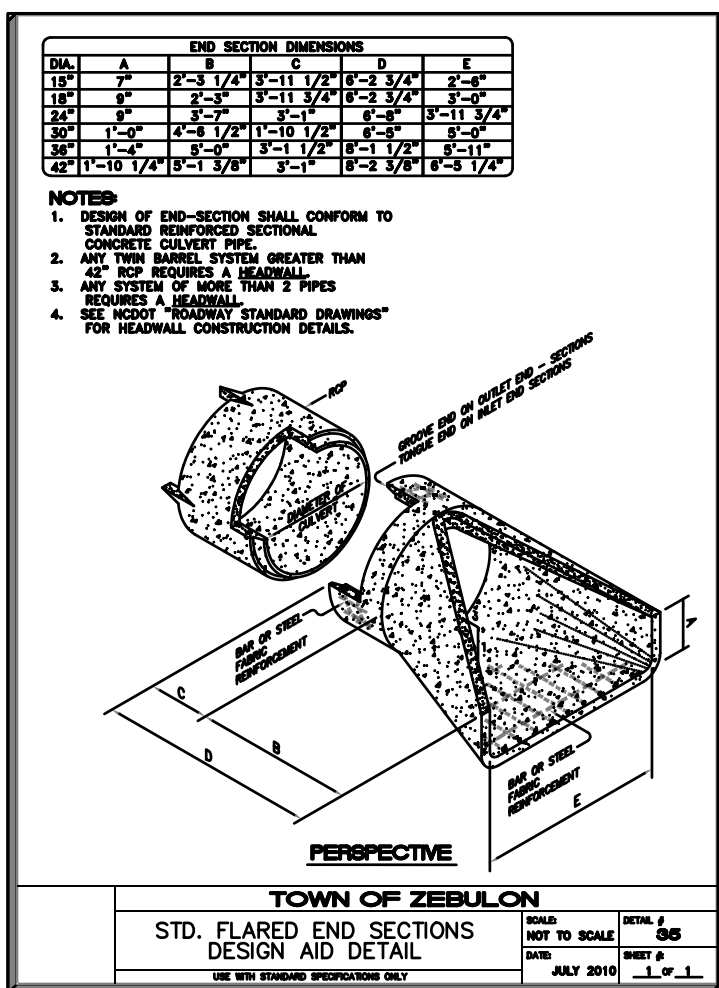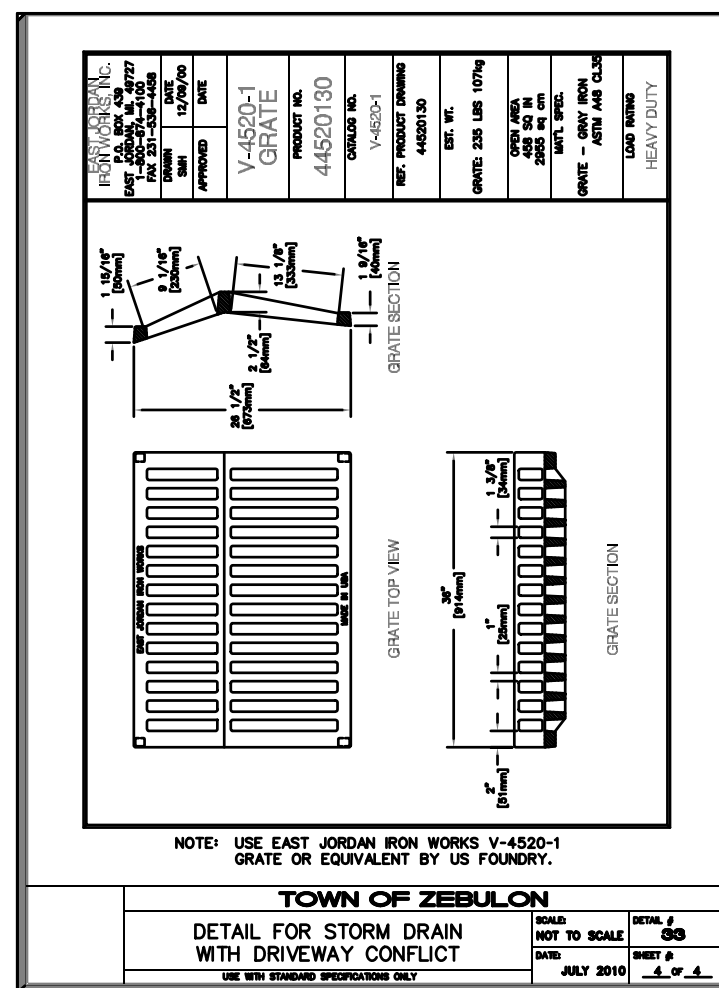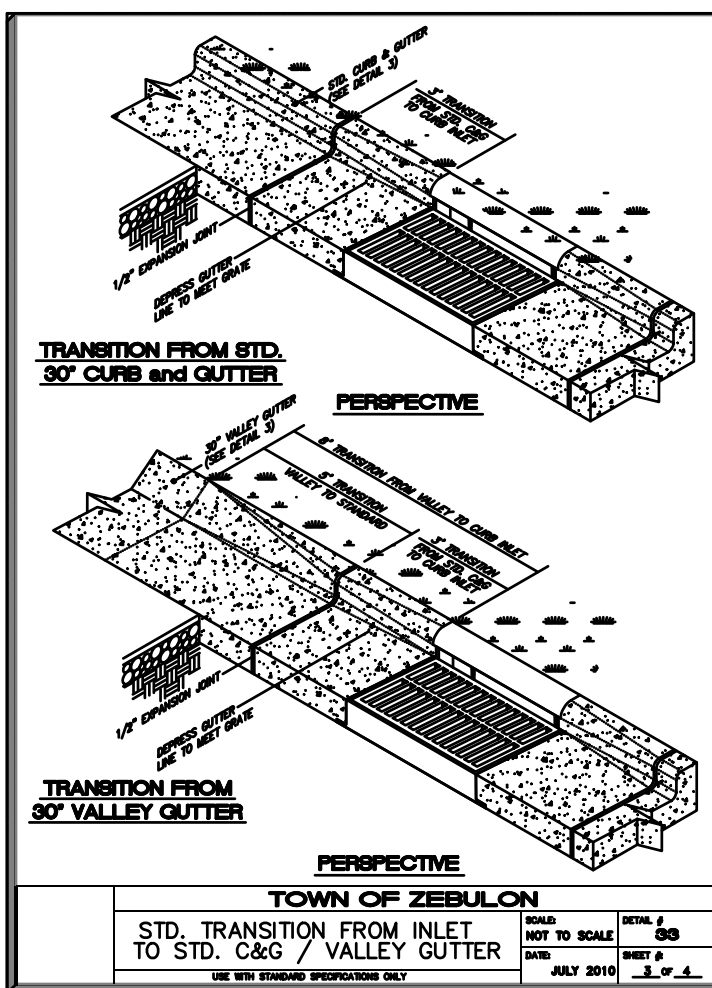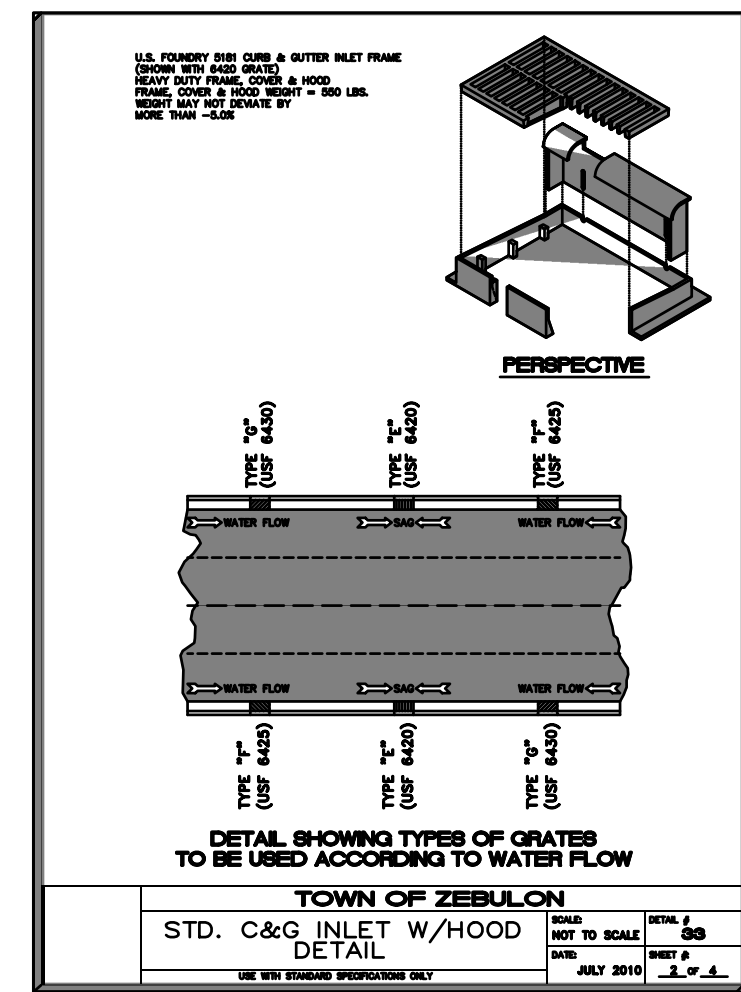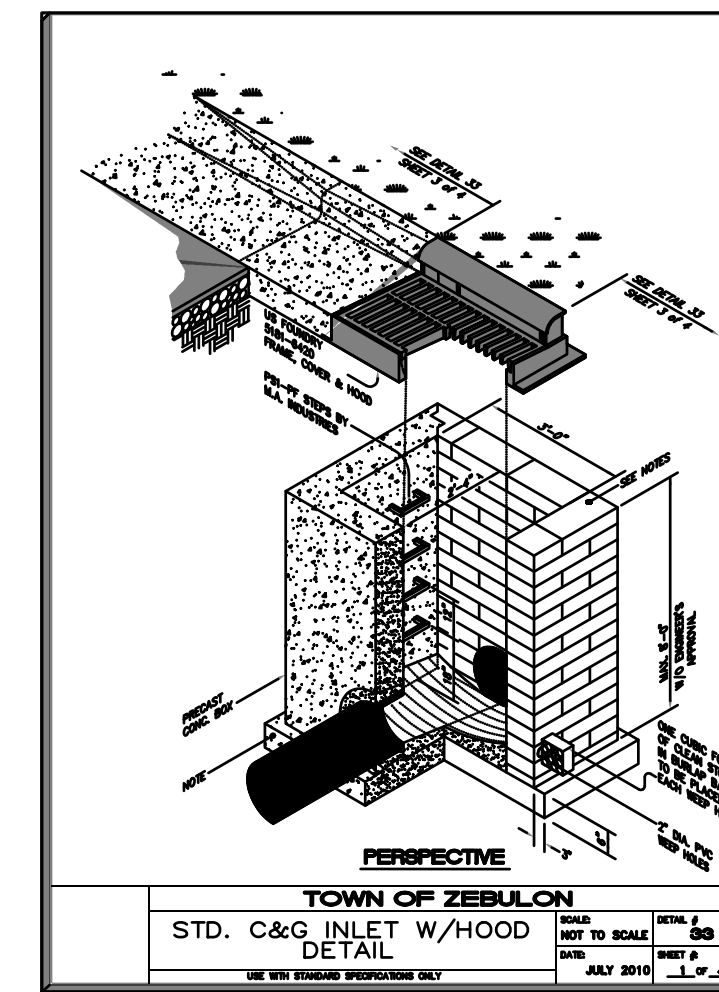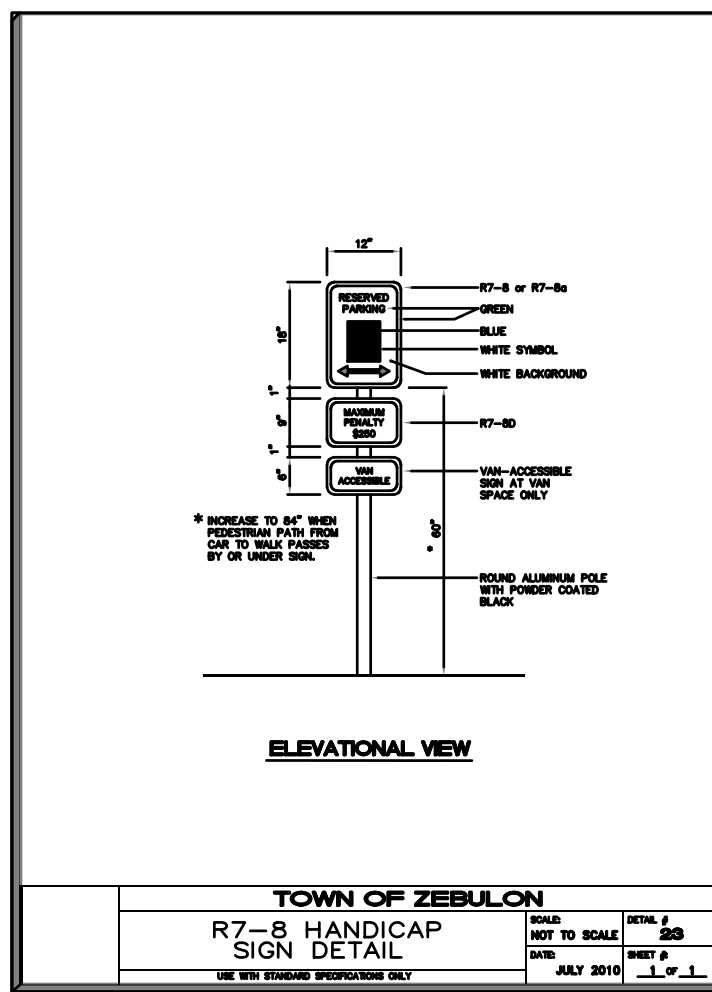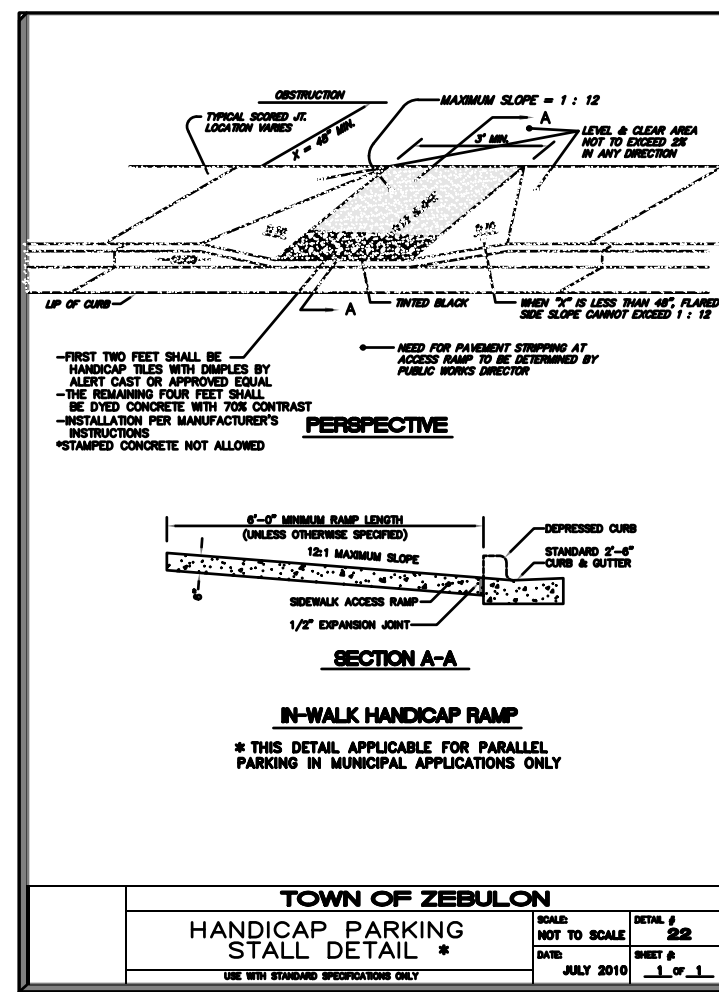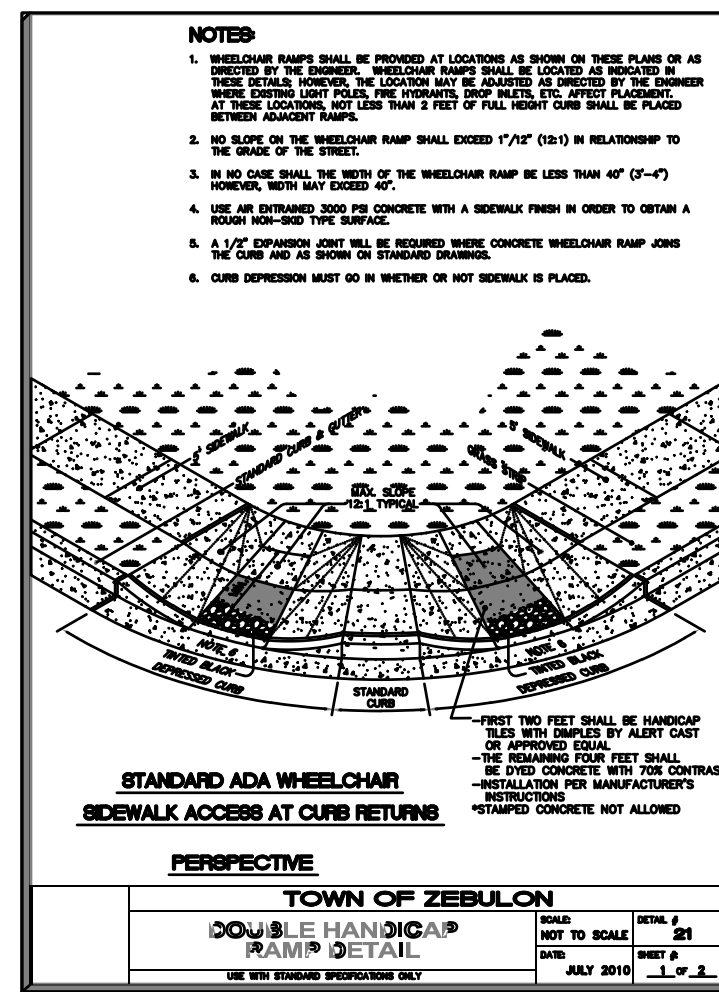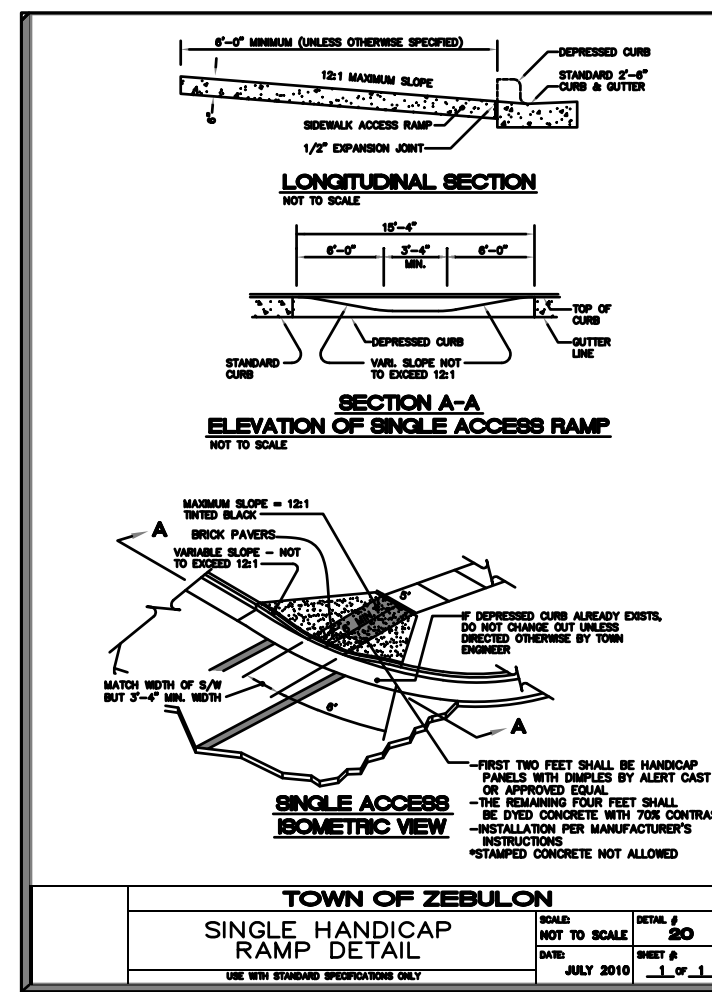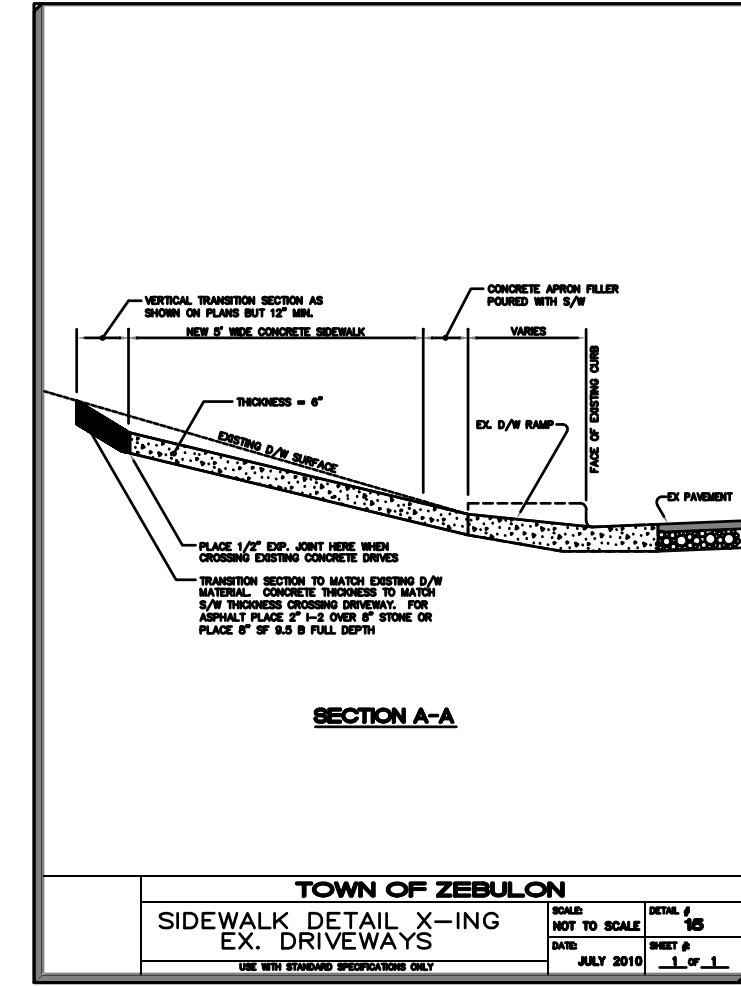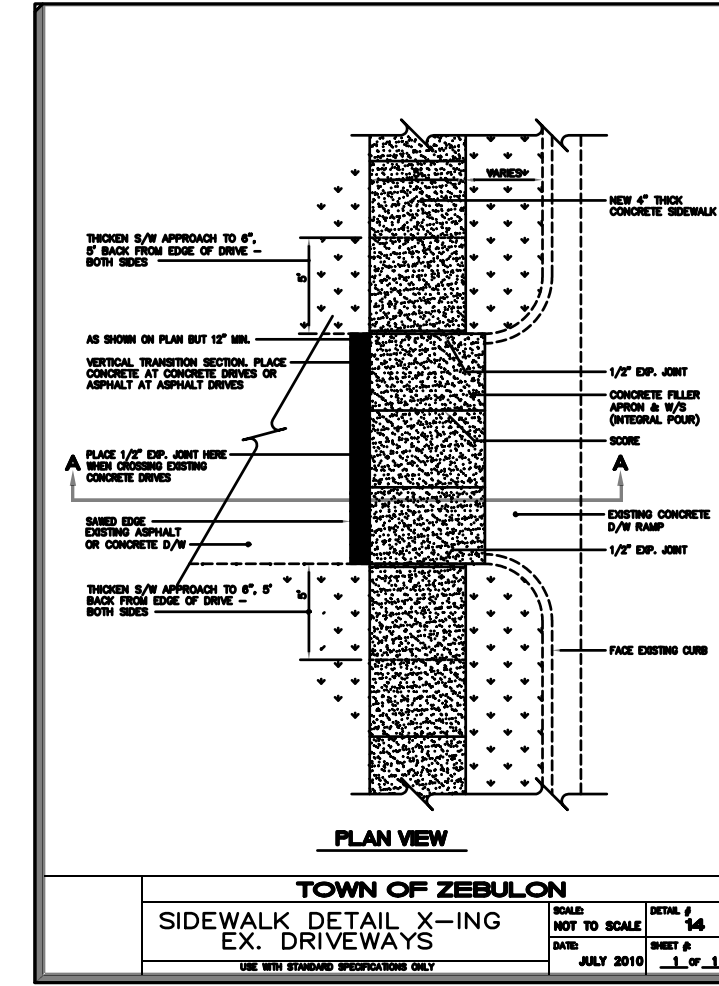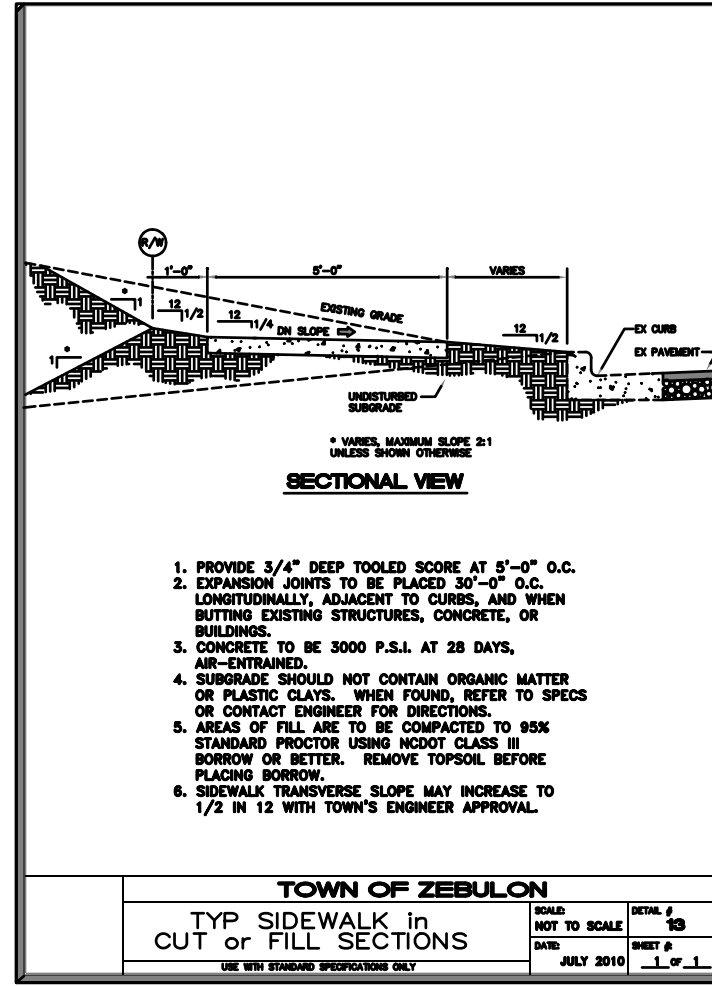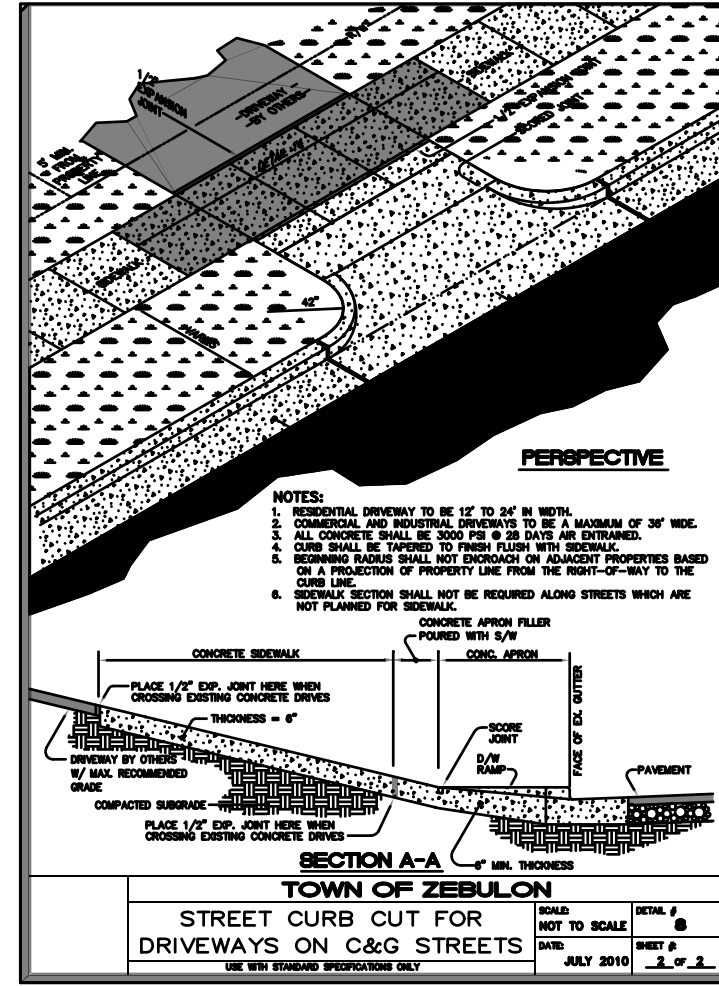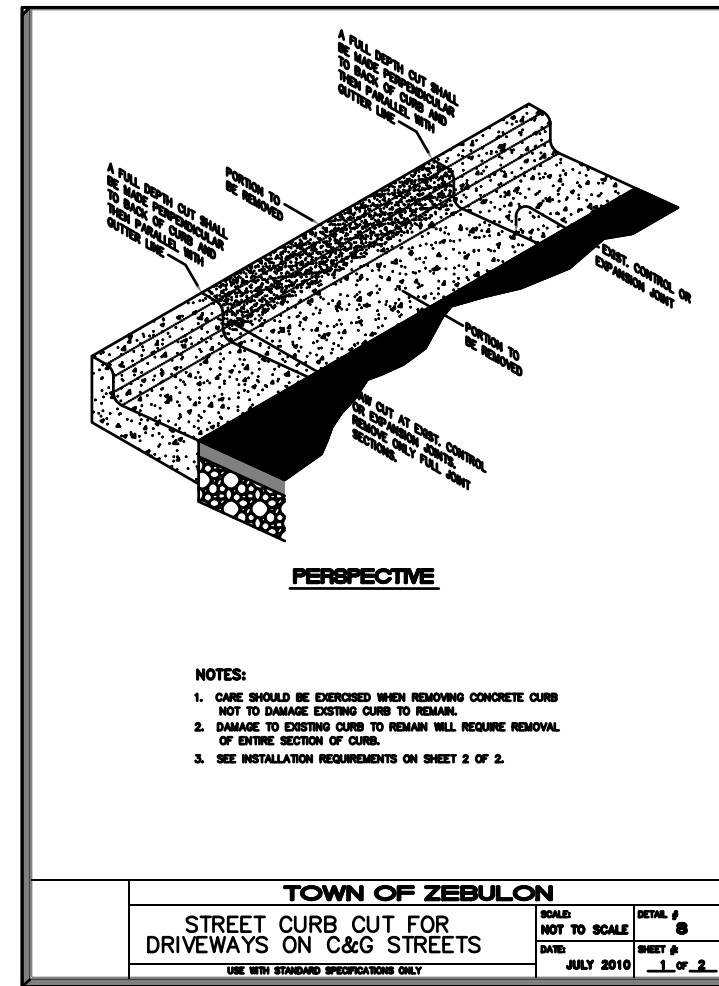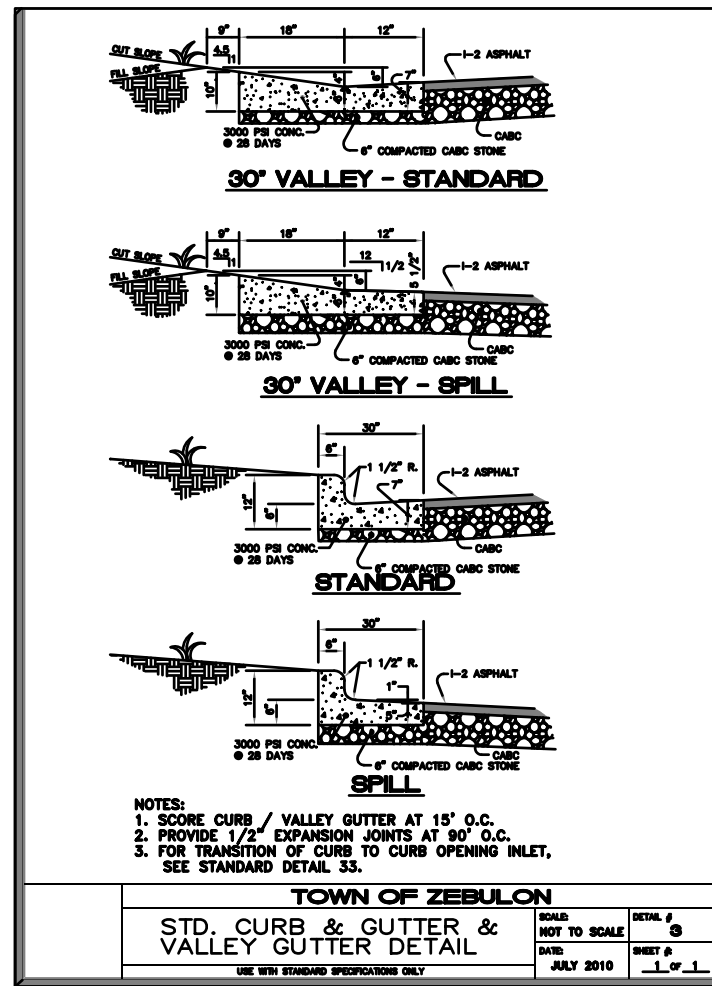

TOWN OF ZEBULON
STD. TRENCH INSTALLATION (TRENCH CONDITION SHOWN)
SHEET 32
DATE: JULY 2010






Soil Category	Soil Description	Soil Symbol	Soil Type	Soil Compaction
Soil Category 1	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	95%
Soil Category 2	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	90%
Soil Category 3	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	85%
Soil Category 4	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	80%

TOWN OF ZEBULON
STD. TRENCH INSTALLATION (TRENCH CONDITION SHOWN)
SHEET 33
DATE: JULY 2010

Inclusion Type	Soil Description	Soil Symbol	Soil Type	Soil Compaction
Type 1	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	95%
Type 2	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	90%
Type 3	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	85%
Type 4	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	80%

TOWN OF ZEBULON
STD. TRENCH INSTALLATION (TRENCH CONDITION SHOWN)
SHEET 34
DATE: JULY 2010

Type	Soil Description	Soil Symbol	Soil Type	Soil Compaction
Type 1	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	95%
Type 2	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	90%
Type 3	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	85%
Type 4	CL, ML, OL, CL-ML, CL-ML (F), CL-ML (H), CL-ML (V), CL-ML (VH), CL-ML (VH), CL-ML (VH)	ALAN	CLAYEY SILT	80%

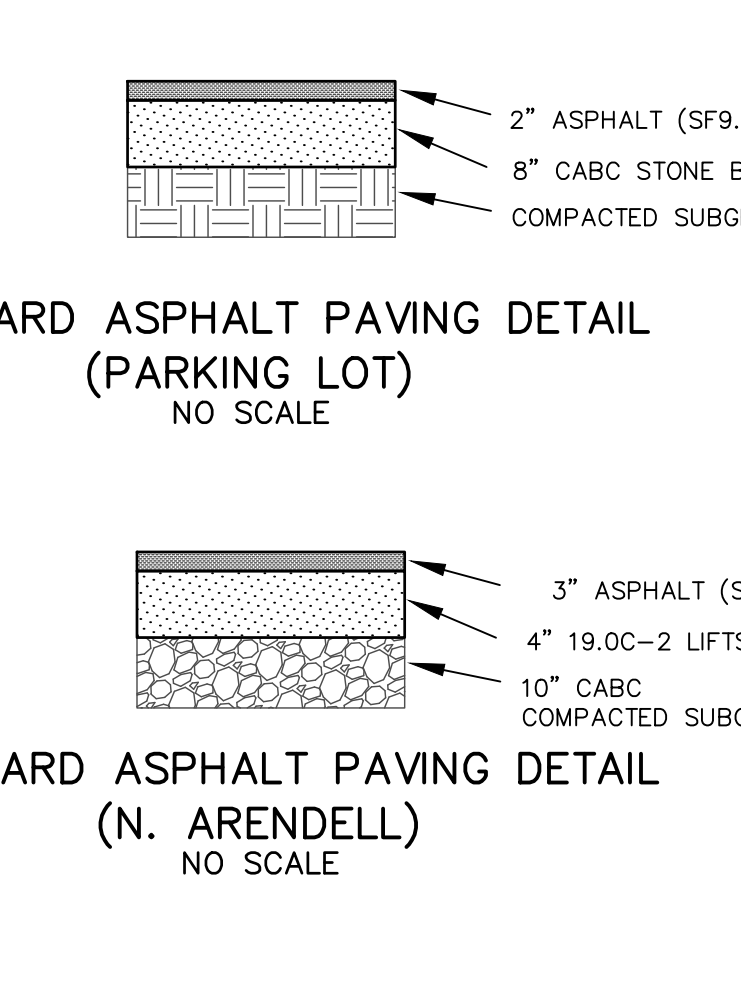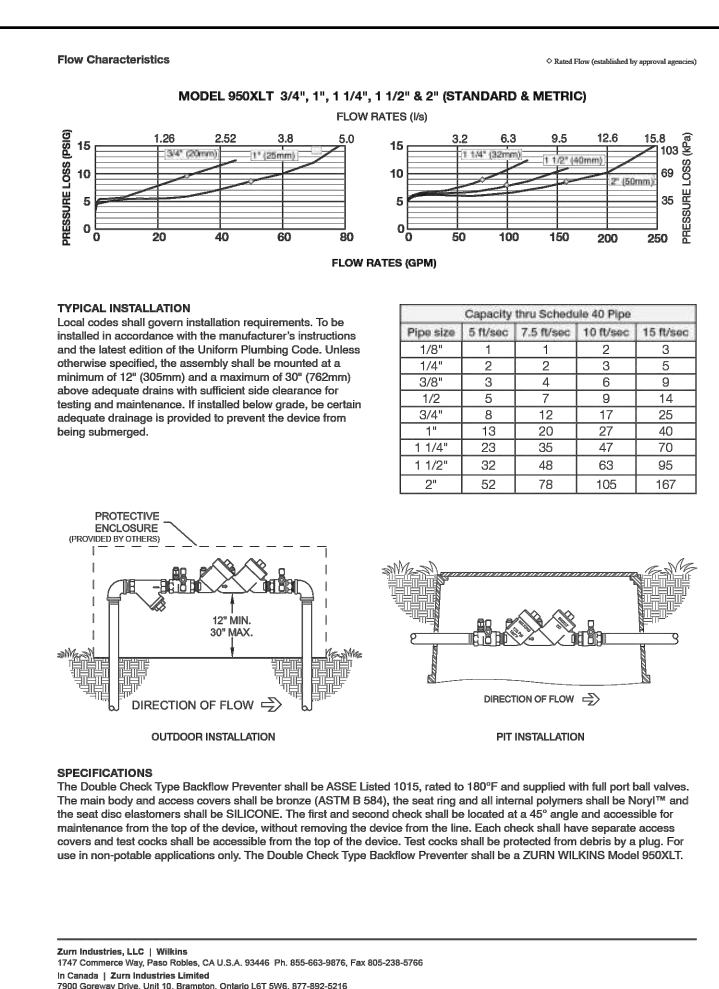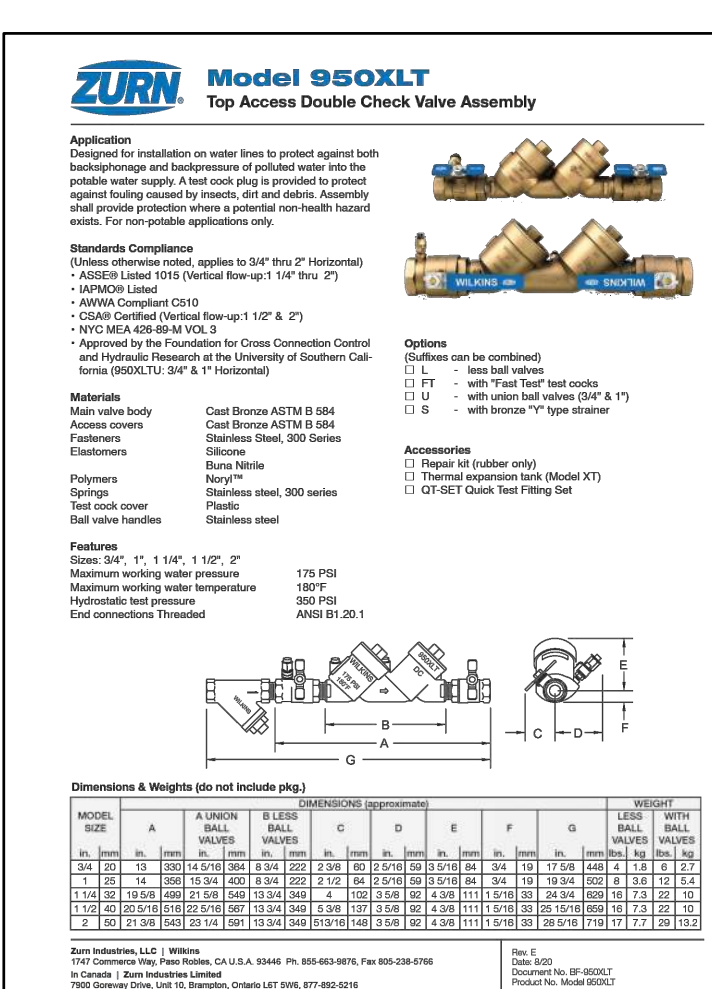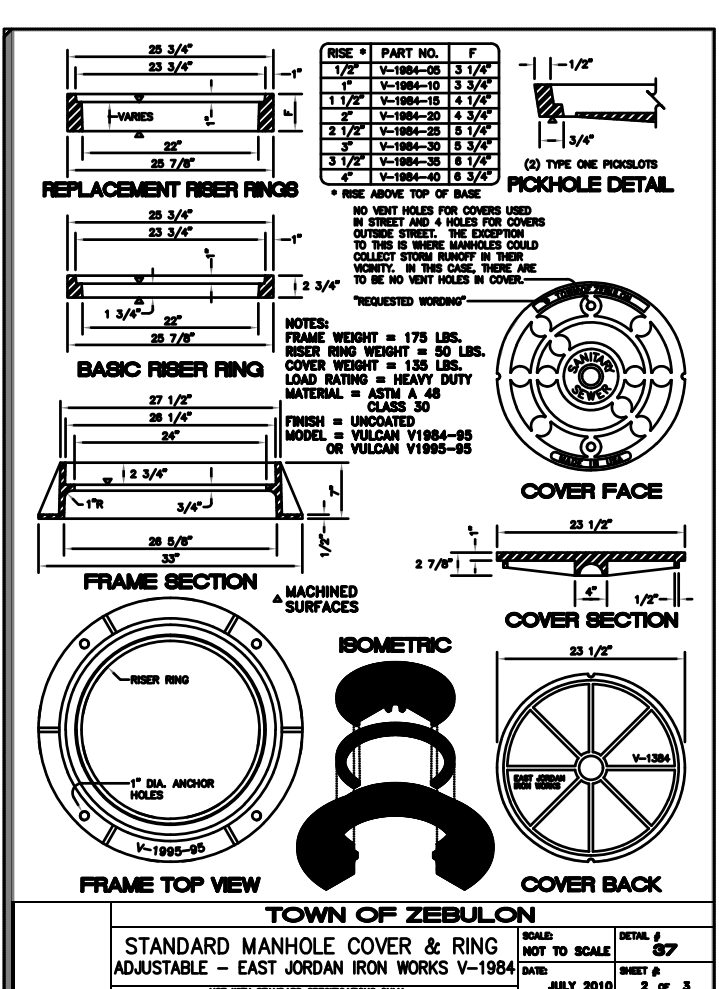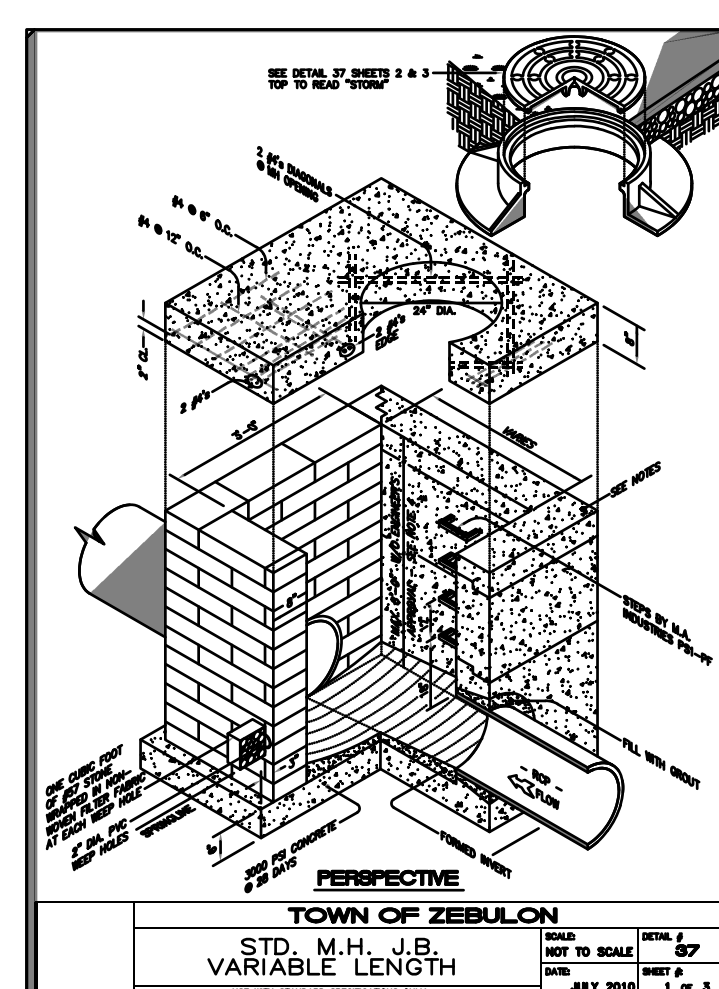

GROUND STABILIZATION AND MATERIALS HANDLING PRACTICES FOR COMPLIANCE WITH THE NCG01 CONSTRUCTION GENERAL PERMIT

Implementing the details and specifications on this plan sheet will result in the construction activity being considered compliant with the Ground Stabilization and Materials Handling sections of the NCG01 Construction General Permit (Sections E and F, respectively). The permittee shall comply with the Erosion and Sediment Control plan approved by the delegated authority having jurisdiction. All details and specifications shown on this sheet may not apply depending on site conditions and the delegated authority having jurisdiction.

SECTION E: GROUND STABILIZATION

Site Area Description	Stabilize within this many calendar days after ceasing land disturbance	Timeframe variations
(a) Perimeter dikes, swales, ditches, and perimeter slopes	7	None
(b) High Quality Water (HQW) Zones	7	None
(c) Slopes steeper than 3:1	7	If slopes are 10' or less in length and are not steeper than 2:1, 14 days are allowed. -7 days for slopes greater than 50' in length and with slopes steeper than 4:1 -7 days for perimeter dikes, swales, ditches, perimeter slopes and HQW Zones
(d) Slopes 3:1 to 4:1	14	-10 days for Falls Lake Watershed
(e) Areas with slopes flatter than 4:1	14	-10 days for Falls Lake Watershed unless there is zero slope

Note: After the permanent cessation of construction activities, any areas with temporary ground stabilization shall be converted to permanent ground stabilization as soon as practicable but in no case longer than 90 calendar days after the last land disturbing activity. Temporary ground stabilization shall be maintained in a manner to render the surface stable against accelerated erosion until permanent ground stabilization is achieved.

GROUND STABILIZATION SPECIFICATION

Stabilize the ground sufficiently so that rain will not dislodge the soil. Use one of the techniques in the table below:

Temporary Stabilization	Permanent Stabilization
<ul style="list-style-type: none"> Temporary grass seed covered with straw or other mulches and tackifiers Hydroseeding Roll-on erosion control products with or without temporary grass seed Appropriately applied straw or other mulch Plastic sheeting 	<ul style="list-style-type: none"> Permanent grass seed covered with straw or other mulches and tackifiers Geotextile fabrics such as permanent soil reinforcement matting Hydroseeding Shrubs or other permanent plantings covered with mulch Uniform and evenly distributed ground cover sufficient to restrain erosion Structural methods such as concrete, asphalt or retaining walls Roll-on erosion control products with grass seed


POLYACRYLAMIDES (PAMS) AND FLOCCULANTS

- Select flocculants that are appropriate for the soils being exposed during construction, selecting from the NC DWPR List of Approved PAMS/Flocculants.
- Apply flocculants at or before the inlets to Erosion and Sediment Control Measures.
- Apply flocculants at the concentrations specified in the NC DWPR List of Approved PAMS/Flocculants and in accordance with the manufacturer's instructions.
- Provide ponding area for containment of treated stormwater before discharging offsite.
- Store flocculants in leak-proof containers that are kept under storm-resistant cover or surrounded by secondary containment structures.

NCG01 GROUND STABILIZATION AND MATERIALS HANDLING EFFECTIVE: 04/01/19

EQUIPMENT AND VEHICLE MAINTENANCE

- Maintain vehicles and equipment to prevent discharge of fluids.
- Provide drip pans under any stored equipment.
- Identify leaks and repair as soon as feasible, or remove leaking equipment from the project.
- Collect all spent fluids, store in separate containers and properly dispose as hazardous waste (recycle when possible).
- Remove leaking vehicles and construction equipment from service until the problem has been corrected.
- Bring used fuels, lubricants, coolants, hydraulic fluids and other petroleum products to a recycling or disposal center that handles these materials.

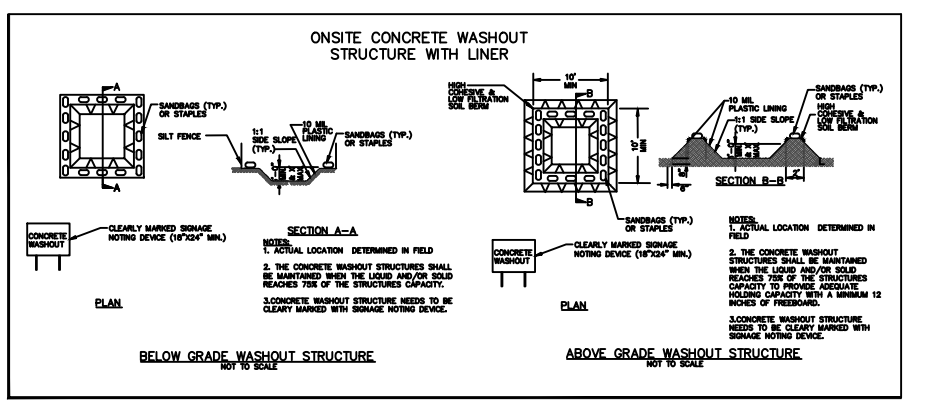

CONCRETE WASHOUTS

- Do not discharge concrete or cement slurry from the site.
- Dispose of, or recycle, hardened concrete residue in accordance with local and state solid waste regulations and at an approved facility.
- Locate waste containers at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Locate waste containers on areas that do not receive substantial amounts of runoff from upland areas and does not drain directly to a storm drain, stream or wetland.
- Cover waste containers at the end of each workday and before storm events or provide secondary containment. Repair or replace damaged waste containers.
- Anchor all lightweight items in waste containers during times of high winds.
- Empty waste containers as needed to prevent overflow. Clean up immediately if containers overflow.
- Dispose waste off-site at an approved disposal facility.
- On business days, clean up and dispose of waste in designated waste containers.

LITTER, BUILDING MATERIAL AND LAND CLEARING WASTE

- Never bury or burn waste. Place litter and debris in approved waste containers.
- Provide a sufficient number and size of waste containers (e.g. dumpster, trash receptacle) on site to contain construction and domestic wastes.
- Locate waste containers at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Locate waste containers on areas that do not receive substantial amounts of runoff from upland areas and does not drain directly to a storm drain, stream or wetland.
- Cover waste containers at the end of each workday and before storm events or provide secondary containment. Repair or replace damaged waste containers.
- Anchor all lightweight items in waste containers during times of high winds.
- Empty waste containers as needed to prevent overflow. Clean up immediately if containers overflow.
- Dispose waste off-site at an approved disposal facility.
- On business days, clean up and dispose of waste in designated waste containers.

PAINT AND OTHER LIQUID WASTE

- Do not dump paint and other liquid waste into storm drains, streams or wetlands.
- Locate paint washouts at least 50 feet away from storm drain inlets and surface waters unless no other alternatives are reasonably available.
- Contain liquid wastes in a controlled area.
- Containment must be labeled, sized and placed appropriately for the needs of site.
- Prevent the discharge of soaps, solvents, detergents and other liquid wastes from construction sites.

PORTABLE TOILETS

- Install portable toilets on level ground, at least 50 feet away from storm drains, streams or wetlands unless there is no alternative reasonably available. If 50 foot offset is not attainable, provide relocation of portable toilet behind silt fence or in place on a gravel pad and surround with sand bags.
- Provide staking or anchoring of portable toilets during periods of high winds or in high traffic areas.
- Monitor portable toilets for leaking and properly dispose of any leaked material. Utilize a licensed sanitary waste hauler to remove leaking portable toilets and replace with properly operating unit.

HERBICIDES, PESTICIDES AND RODENTICIDES

- Store and apply herbicides, pesticides and rodenticides in accordance with label restrictions.
- Store herbicides, pesticides and rodenticides in their original containers with the label, which lists directions for use, ingredients and first aid steps in case of accidental poisoning.
- Do not store herbicides, pesticides and rodenticides in areas where flooding is possible or where they may spill or leak into wells, stormwater drains, ground water or surface water. If a spill occurs, clean area immediately.
- Do not stockpile these materials onsite.

HAZARDOUS AND TOXIC WASTE

- Create designated hazardous waste collection areas on-site.
- Place hazardous waste containers under cover or in secondary containment.
- Do not store hazardous chemicals, drums or bagged materials directly on the ground.

SECTION A: SELF-INSPECTION

Self-inspections are required during normal business hours in accordance with the table below. When adverse weather or site conditions would cause the safety of the inspection personnel to be in jeopardy, the inspection may be delayed until the next business day on which it is safe to perform the inspection. In addition, when a storm event of equal to or greater than 1.0 inch occurs outside of normal business hours, the self-inspection shall be performed upon the commencement of the next business day. Any time when inspections were delayed shall be noted in the inspection Record.

Inspect	Frequency (during normal business hours)	Inspection records must include:
(1) Rain gauge maintained in good working order	Daily	Daily rainfall amounts. If no daily rain gauge observations are made during weekend or holiday periods, no individual-day rainfall information is available, record the cumulative rain measurement for those unattended days (and this will determine if a site inspection is needed). Days on which no rainfall occurred shall be recorded as "zero." The permittee may use another rain-measuring device approved by the Division.
(2) E&S Measures	At least once per 7 calendar days and within 24 hours of a rain event 1.0 inch in 24 hours	1. Identification of the measures inspected, 2. Date and time of the inspection, 3. Name of the person performing the inspection, 4. Indication of whether the measures were operating properly, 5. Description of maintenance needs for the measure, 6. Description, evidence, and date of corrective actions taken.
(3) Stormwater discharge outfalls (SDOs)	At least once per 7 calendar days and within 24 hours of a rain event 1.0 inch in 24 hours	1. Identification of the discharge outfall inspected, 2. Date and time of the inspection, 3. Name of the person performing the inspection, 4. Evidence of indicators of stormwater pollution such as oil sheen, floating or suspended solids or discoloration, 5. Indication of visible sediment leaving the site, 6. Description, evidence, and date of corrective actions taken.
(4) Perimeter of site	At least once per 7 calendar days and within 24 hours of a rain event 1.0 inch in 24 hours	1. Actions taken to clean up or stabilize the sediment that has left the site limits, 2. Description, evidence, and date of corrective actions taken, and 3. An explanation as to the actions taken to control future releases.
(5) Streams or wetlands onsite or off-site (where applicable)	At least once per 7 calendar days and within 24 hours of a rain event 1.0 inch in 24 hours	1. If the stream or wetland has increased visible sedimentation or a stream has visible increased turbidity from the construction activity, then a record of the following shall be made: a. Description, evidence and date of corrective actions taken, and b. Records of the required reports to the appropriate Division Regional Office per Part III, Section C, Item (2)(a) of this permit of this permit.
(6) Ground stabilization measures	After each phase of grading	1. The phase of grading, installation of perimeter E&S measures, clearing and grubbing, installation of storm drainage facilities, completion of all land-disturbing activity, construction or re-development, permanent ground cover. 2. Documentation that the required ground stabilization measure has been provided with the required timeframe or an assurance that they will be provided as soon as possible.

NOTE: The rain inspection resets the required 7 calendar day inspection requirement.

NCG01 SELF-INSPECTION, RECORDKEEPING AND REPORTING EFFECTIVE: 04/01/19

SECTION B: RECORDKEEPING

1. E&S Plan Documentation

The approved E&S plan as well as any approved deviation shall be kept on the site. The approved E&S plan must be kept up-to-date throughout the coverage under this permit. The following items pertaining to the E&S plan shall be documented in the manner described:

Item to Document	Documentation Requirements
(a) Each E&S Measure has been installed and does not significantly deviate from the locations, dimensions and relative elevations shown on the approved E&S Plan.	Initial and date each E&S Measure on a copy of the approved E&S Plan or complete, date and sign an inspection report that lists each E&S Measure shown on the approved E&S Plan. This documentation is required upon the initial installation of the E&S Measures or if the E&S Measures are modified after initial installation.
(b) A phase of grading has been completed.	Initial and date a copy of the approved E&S Plan or complete, date and sign an inspection report to indicate completion of the construction phase.
(c) Ground cover is located and installed in accordance with the approved E&S Plan.	Initial and date a copy of the approved E&S Plan or complete, date and sign an inspection report to indicate compliance with approved ground cover specifications.
(d) The maintenance and repair requirements for all E&S Measures have been performed.	Complete, date and sign an inspection report.
(e) Corrective actions have been taken to E&S Measures.	Initial and date a copy of the approved E&S Plan or complete, date and sign an inspection report to indicate the completion of the corrective action.

2. Additional Documentation

In addition to the E&S Plan documents above, the following items shall be kept on the site and available for agency inspectors at all times during normal business hours, unless the Division provides a site-specific exemption based on unique site conditions that make this requirement not practical:

- This general permit as well as the certificate of coverage, after it is received.
- Records of inspections made during the previous 30 days. The permittee shall record the required observations on the Inspection Record Form provided by the Division or a similar inspection form that includes all the required elements. Use of electronically-available records in lieu of the required paper copies will be allowed if shown to provide equal access and utility as the hard-copy records.
- All data used to complete the Notice of Intent and older inspection records shall be maintained for a period of three years after project completion and made available upon request. [40 CFR 122.41]

SECTION C: REPORTING

1. Occurrences that must be reported

Permittees shall report the following occurrences:

- Visible sediment deposition in a stream or wetland.
- Oil spills if:
 - They are 25 gallons or more,
 - They are less than 25 gallons but cannot be cleaned up within 24 hours,
 - They cause sheen on surface waters (regardless of volume), or
 - They are within 100 feet of surface waters (regardless of volume).
- Releases of hazardous substances in excess of reportable quantities under Section 311 of the Clean Water Act (Ref: 40 CFR 110.3 and 40 CFR 117.3) or Section 102 of CERCLA (Ref: 40 CFR 302.4) or G.S. 145-215.85.
- Anticipated bypasses and unanticipated bypasses.
- Noncompliance with the conditions of this permit that may endanger health or the environment.

2. Reporting Timeframes and Other Requirements

After a permittee becomes aware of an occurrence that must be reported, he shall contact the appropriate Division regional office within the timeframes and in accordance with the other requirements listed below. Occurrences outside normal business hours may also be reported to the Division's Emergency Response personnel at (800) 662-7956, (800) 858-0368 or (919) 733-3300.

Occurrences	Reporting Timeframes (After Discovery) and Other Requirements
(a) Visible sediment deposition in a stream or wetland	<ul style="list-style-type: none"> Within 24 hours, an oral or electronic notification. Within 7 calendar days, a report that contains a description of the sediment and actions taken to address the cause of the deposition. Division staff may waive the requirement for a written report on a case-by-case basis. If the stream is named on the NC 303(d) list as impaired for sediment-related causes, the permittee may be required to perform additional monitoring, inspections or apply more stringent practices if staff determine that additional requirements are needed to assure compliance with the federal or state impaired waters conditions.
(b) Oil spills and release of hazardous substances per item 1(b)(c) above	<ul style="list-style-type: none"> Within 24 hours, an oral or electronic notification. The notification shall include information about the date, time, nature, volume and location of the spill or release. A report at least ten days before the date of the bypass, if possible. The report shall include an evaluation of the anticipated quality and effect of the bypass.
(c) Anticipated bypasses [40 CFR 122.41(m)(3)]	<ul style="list-style-type: none"> Within 24 hours, an oral or electronic notification. Within 7 calendar days, a report that includes an evaluation of the quality and effect of the bypass.
(d) Noncompliance with the conditions of this permit that may endanger health or the environment [40 CFR 122.41(l)(7)]	<ul style="list-style-type: none"> Within 24 hours, an oral or electronic notification. Within 7 calendar days, a report that contains a description of the noncompliance, and its causes; the period of noncompliance, including exact dates and times; and if the noncompliance has not been corrected, the anticipated time noncompliance is expected to continue, and steps taken or planned to reduce, eliminate, and prevent recurrence of the noncompliance. [40 CFR 122.41(l)(8)]. Division staff may waive the requirement for a written report on a case-by-case basis.

NOTES:

- PROVIDE STABILIZED OUTLET TO STREAM BANK.
- WOOD PALLET MAY BE USED IN LIEU OF STONE AND GEOTEXTILE AS DIRECTED. A SUFFICIENT NUMBER OF PALLET MUST BE PROVIDED TO ELEVATE THE ENTIRE FILTER BAG FOR DEWATERING ABOVE NATURAL GROUND.

MAINTENANCE NOTES:

- REPLACE AND DISPOSE OF FILTER BAG(S) WHEN IT IS $\frac{3}{4}$ FULL OF SEDIMENT OR WHEN IT IS IMPRACTICAL FOR BAG TO FILTER SEDIMENT.
- PROVIDE A SUFFICIENT QUANTITY OF FILTER BAGS TO CONTAIN SILT FROM PUMPED EFFLUENT.

NOT TO SCALE

NOTES:

- L = THE LENGTH OF THE RIPRAP APRON.
- d = 1.5 TIMES THE MAXIMUM STONE DIAMETER BUT NOT LESS THAN 6" (INCHES).
- IN A WELL-DEFINED CHANNEL EXTEND THE APRON UP THE CHANNEL BANKS TO AN ELEVATION OF 6" (INCHES) ABOVE THE MAXIMUM TAILWATER DEPTH OR TO THE TOP OF THE BANK, WHICHEVER IS LESS.
- A FILTER BLANKET OR FILTER FABRIC SHOULD BE INSTALLED BETWEEN THE RIPRAP AND SOIL FOUNDATION.

MAINTENANCE NOTES:

- INSPECT RIPRAP OUTLET STRUCTURES WEEKLY AND AFTER SIGNIFICANT (1 INCH OR GREATER) RAINFALL EVENTS TO SEE IF ANY EROSION AROUND OR BELOW THE RIPRAP HAS TAKEN PLACE, OR IF STONES HAVE BEEN DISLODGED. IMMEDIATELY MAKE ALL NEEDED REPAIRS TO PREVENT FURTHER DAMAGE.

NOTES:

- BAFFLE MATERIAL SHOULD BE SECURED AT THE BOTTOM AND SIDES USING STAPLES OR BY TRENCING AS FOR SILT FENCE.
- MOST OF THE SEDIMENT WILL ACCUMULATE IN THE 1ST BAY, WHICH SHOULD BE READILY ACCESSIBLE FOR MAINTENANCE.
- PROVIDE 3 BAFFLES (USE TWO IF LESS THAN 20 FEET IN LENGTH). PROVIDE 5 BAFFLES FOR DRAINAGE AREAS GREATER THAN 10 ACRES.
- BAFFLE SHALL BE 700 G/M2 COIR EROSION BLANKET.
- TOPS OF BAFFLES SHOULD BE 2 INCHES LOWER THAN THE TOP OF THE BERMS.

MAINTENANCE NOTES:

- INSPECT BAFFLES FOR REPAIR ONCE A WEEK AND AFTER EACH 1" RAINFALL.
- MAINTAIN ACCESS TO BAFFLES AND MAKE ANY REPAIRS IMMEDIATELY.
- REMOVE SEDIMENT DEPOSITS WHEN IT REACHES HALF FULL.
- AVOID DAMAGING BAFFLES DURING CLEANOUT AND REPLACE IF DAMAGED.
- REMOVE BAFFLES AND SEDIMENT DEPOSITS AFTER CONTRIBUTING DRAINAGE AREA HAS BEEN PERMANENTLY STABILIZED.

SedCatch® Dewatering Bag

www.SedCatch.com

Dewatering Bag Standard Drawing

The purpose of a Dewatering Bag is to collect sediment contained in the discharged water, to prevent the scour and erosion from water exiting a pipe at high velocity, to defuse the water over a wider area to minimize erosion as the water drains away, and to retain oil contained within effluent.

A SedCatch® dewatering bag or approved equal should be used anytime water is pumped on the site.

Installation and Use:

- Place SedCatch® Dewatering Bag on the ground or on a trailer over a relatively level, stabilized area.
- Insert discharge pipe a minimum of 5ft. inside SedCatch® dewatering bag and secure with a rope (included) wrapped 6 times around the snout over a 6 inch width of the bag.
- Replace SedCatch® Dewatering Bag when half full of sediment or when the sediment has reduced the flow rate of the pump discharge to an impractical amount.

Maintenance and Disposal:

- Remove and dispose of accumulated sediment away from waterways or environmentally sensitive areas. Silt open Sediment Bag and remove accumulated sediment. Dispose of bag at an appropriate recycling or solid waste facility. OR, as directed by engineer or inspector.

Standard Filter Bag for Dewatering Activities

WAKE COUNTY NORTH CAROLINA

EFFECTIVE: 01/31/08

Standard Pipe Outlet to Well-Defined Channel


WAKE COUNTY NORTH CAROLINA

EFFECTIVE: 01/31/08

Standard Baffles Detail











WAKE COUNTY NORTH CAROLINA

EFFECTIVE: 01/31/08

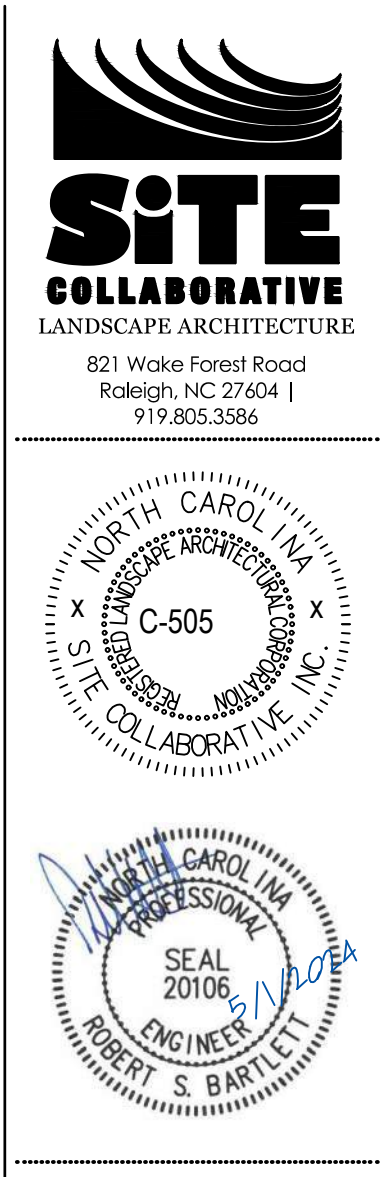

**ZEBULON ANIMAL HOSPITAL
DVM SERVICES REALTY, LLC**

PROJECT NUMBER:
PROJECT PHASE:
DATE: 5/1/2024
SHEET TITLE:
SEDIMENTATION AND EROSION CONTROL DETAILS NCG01
SHEET NUMBER:
DT3

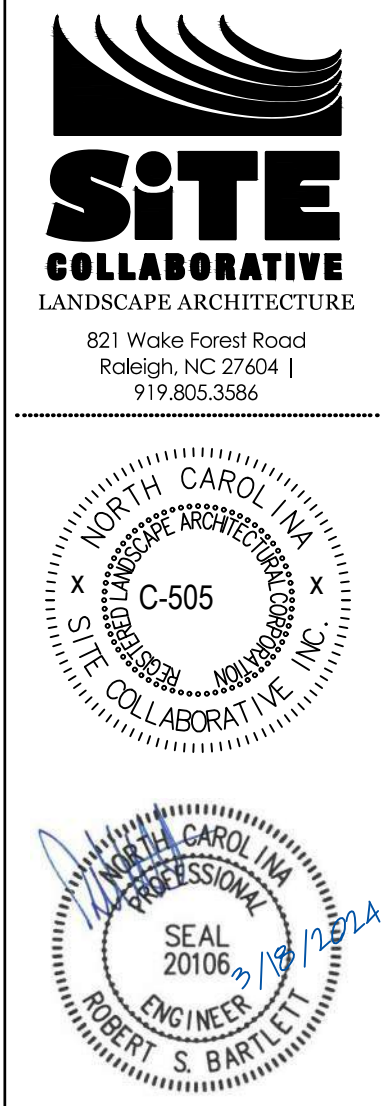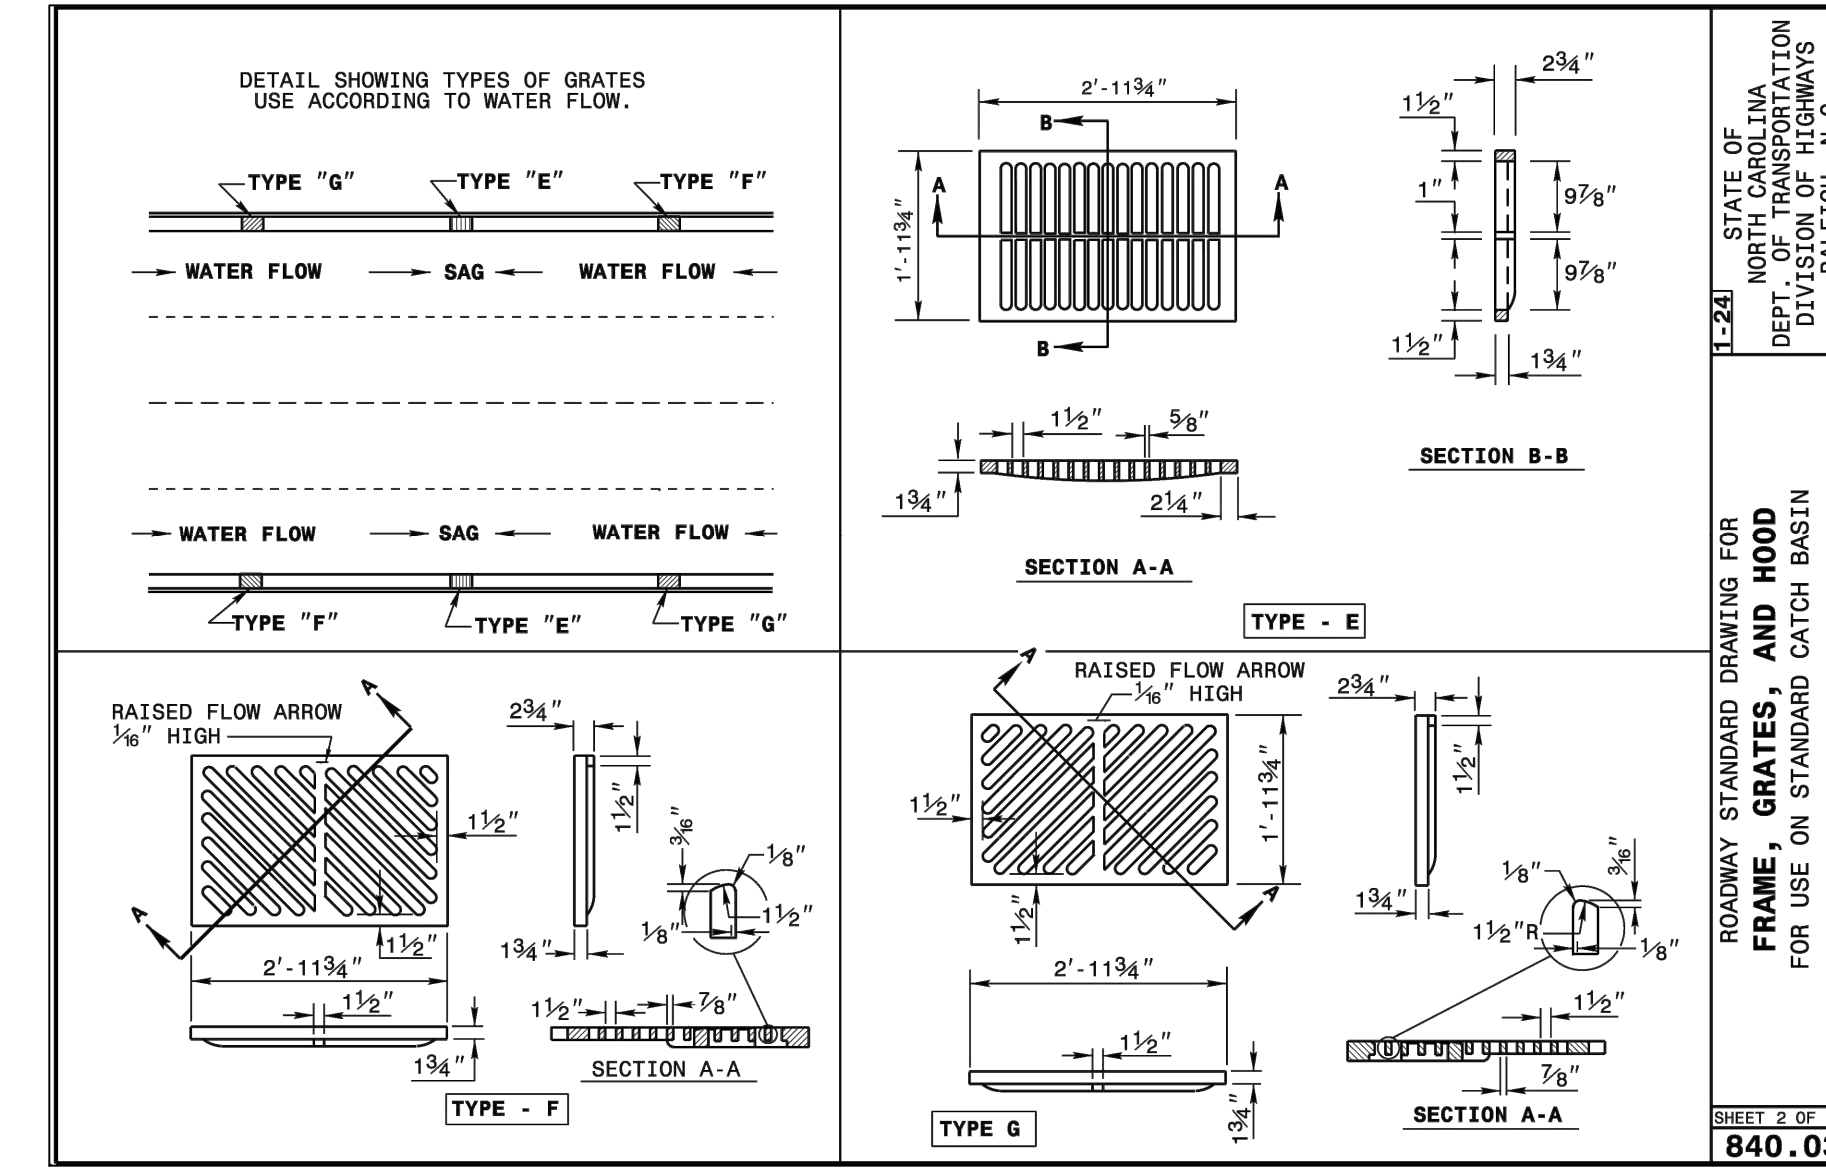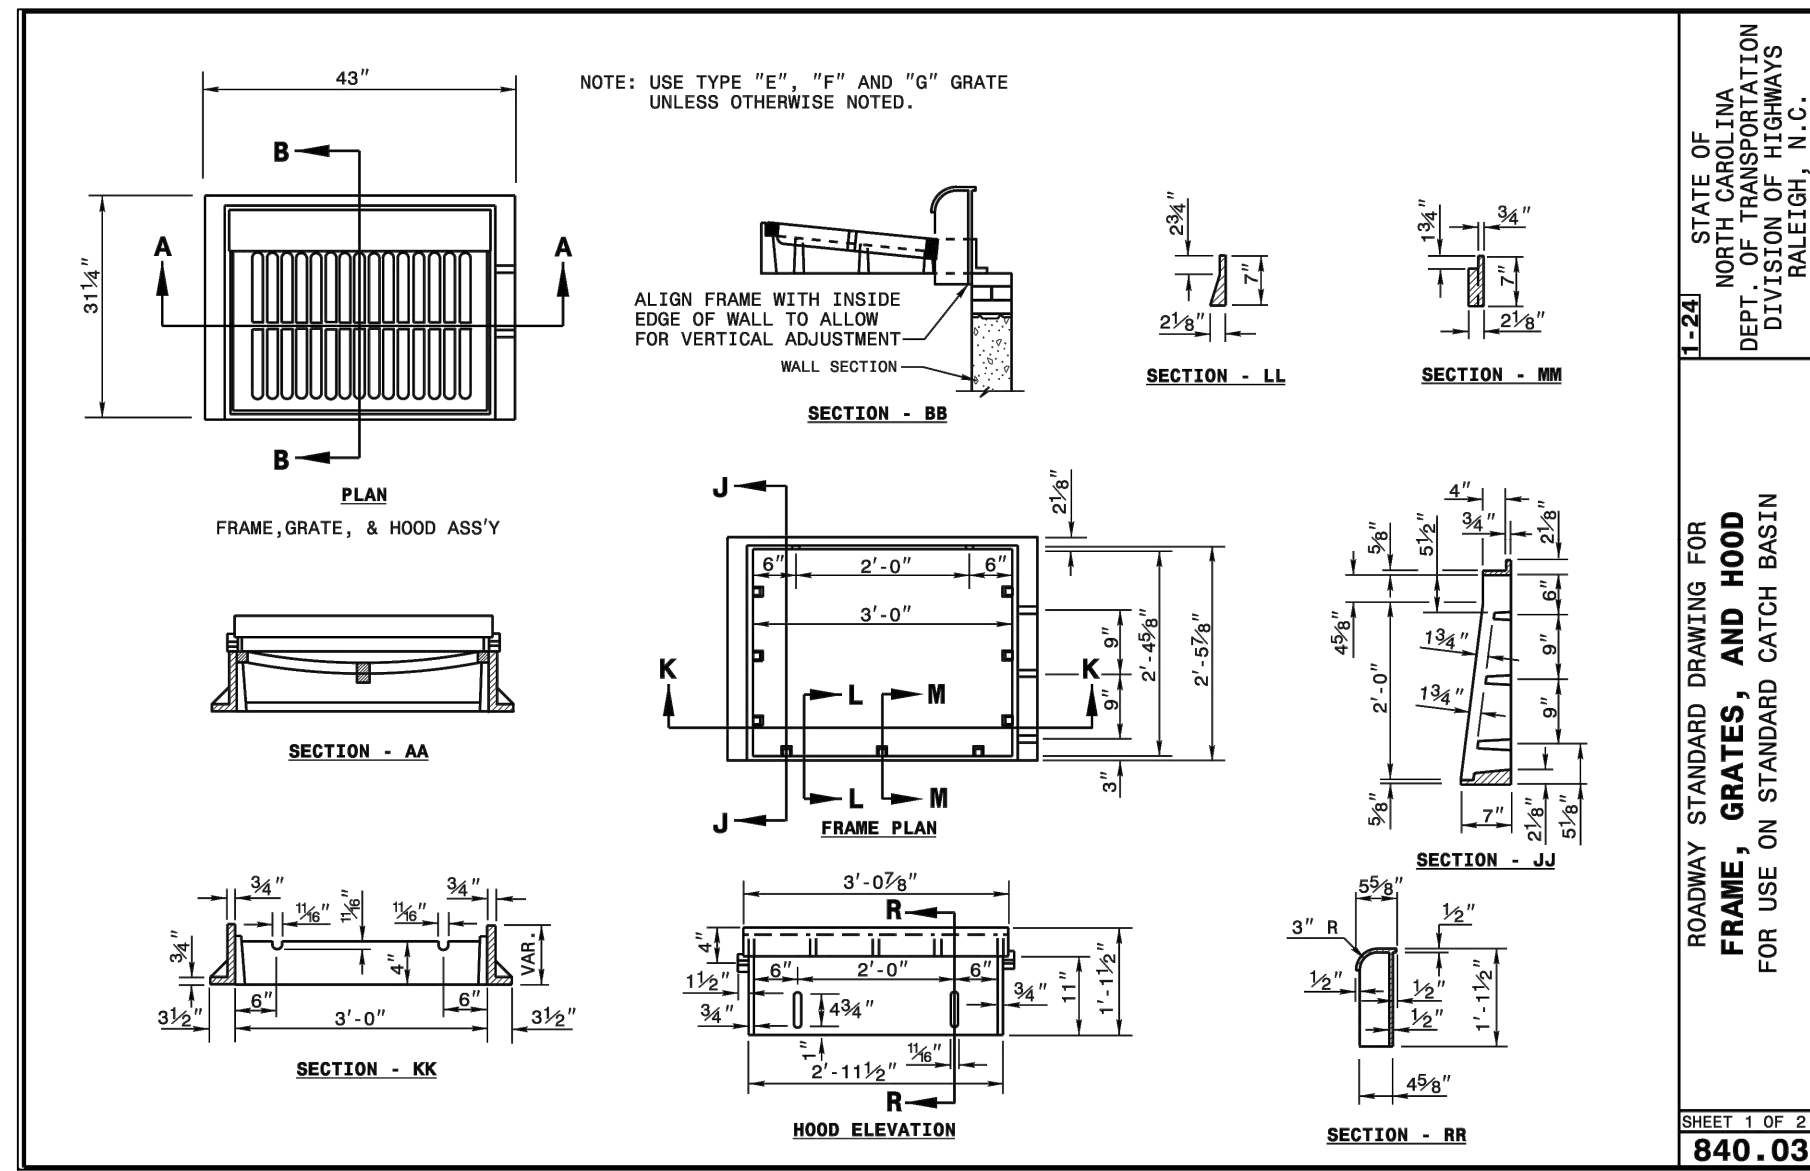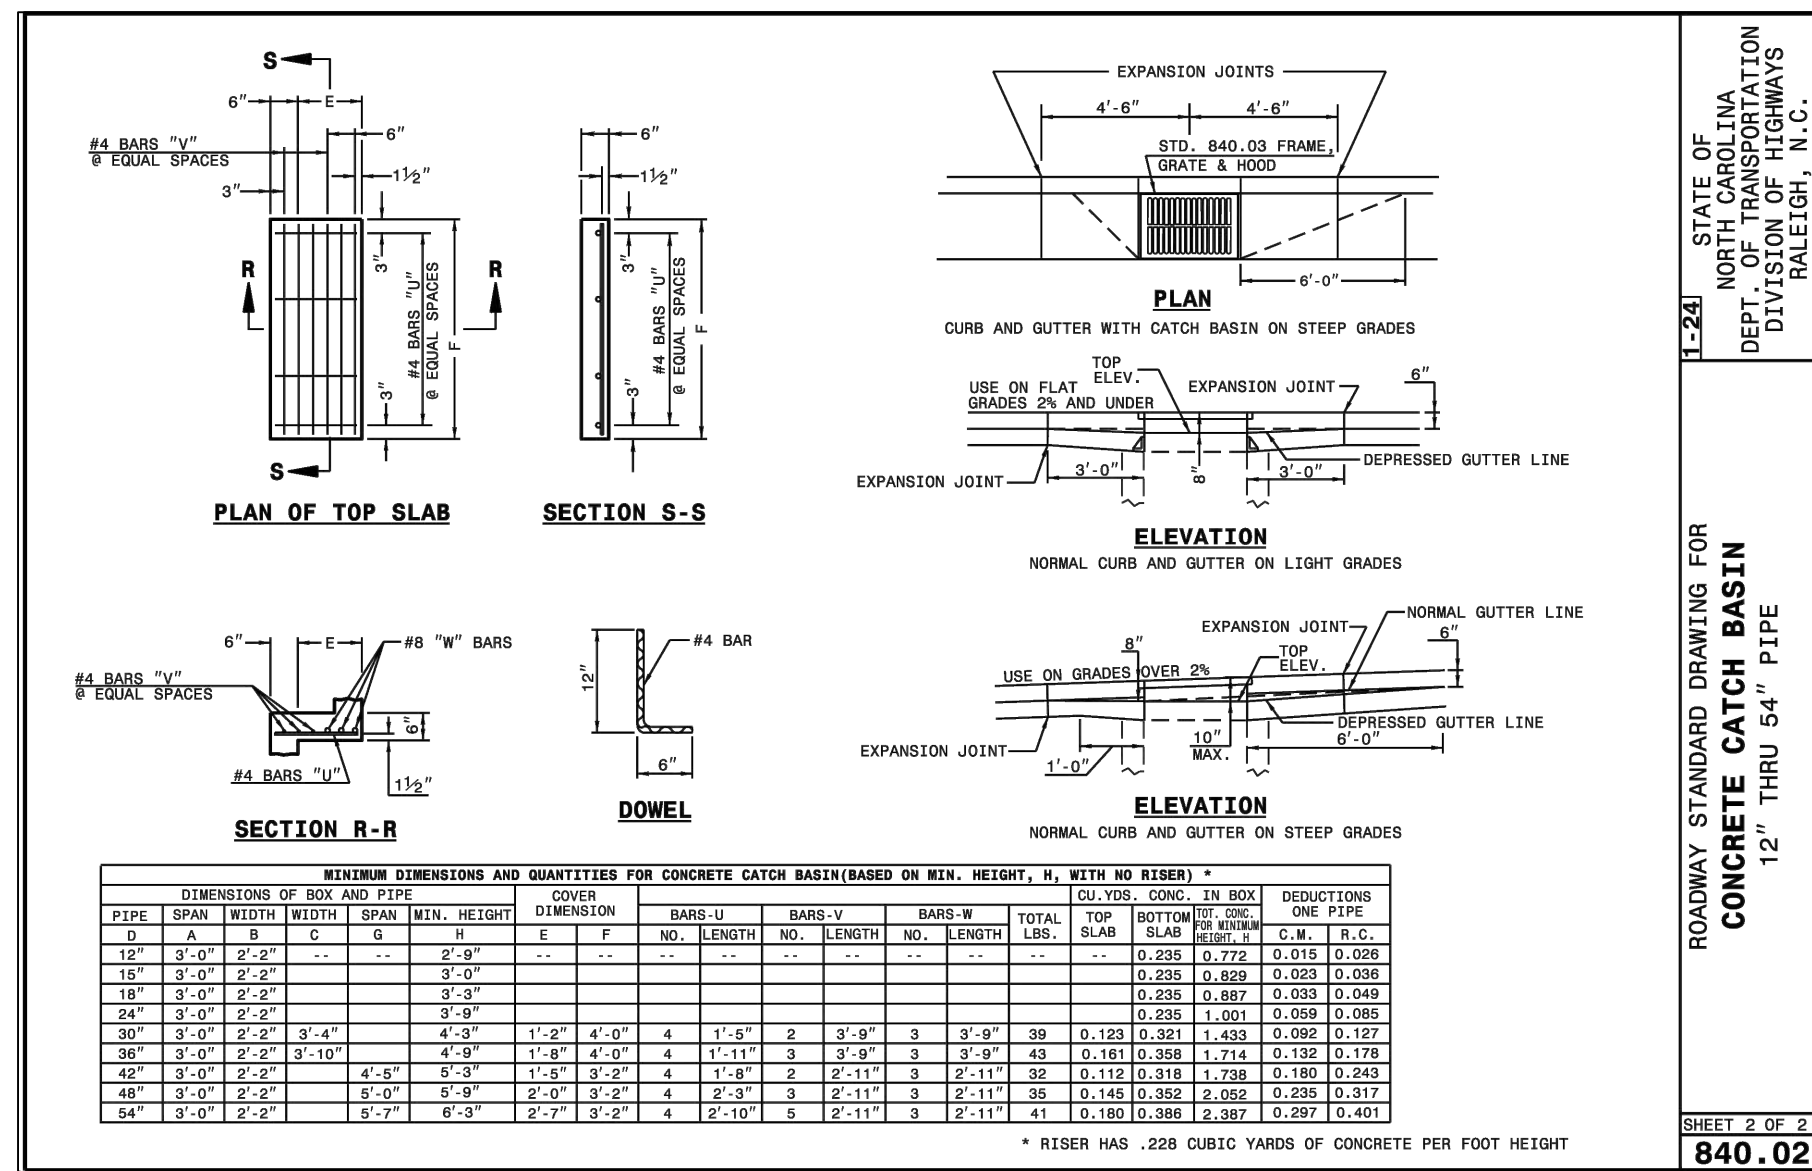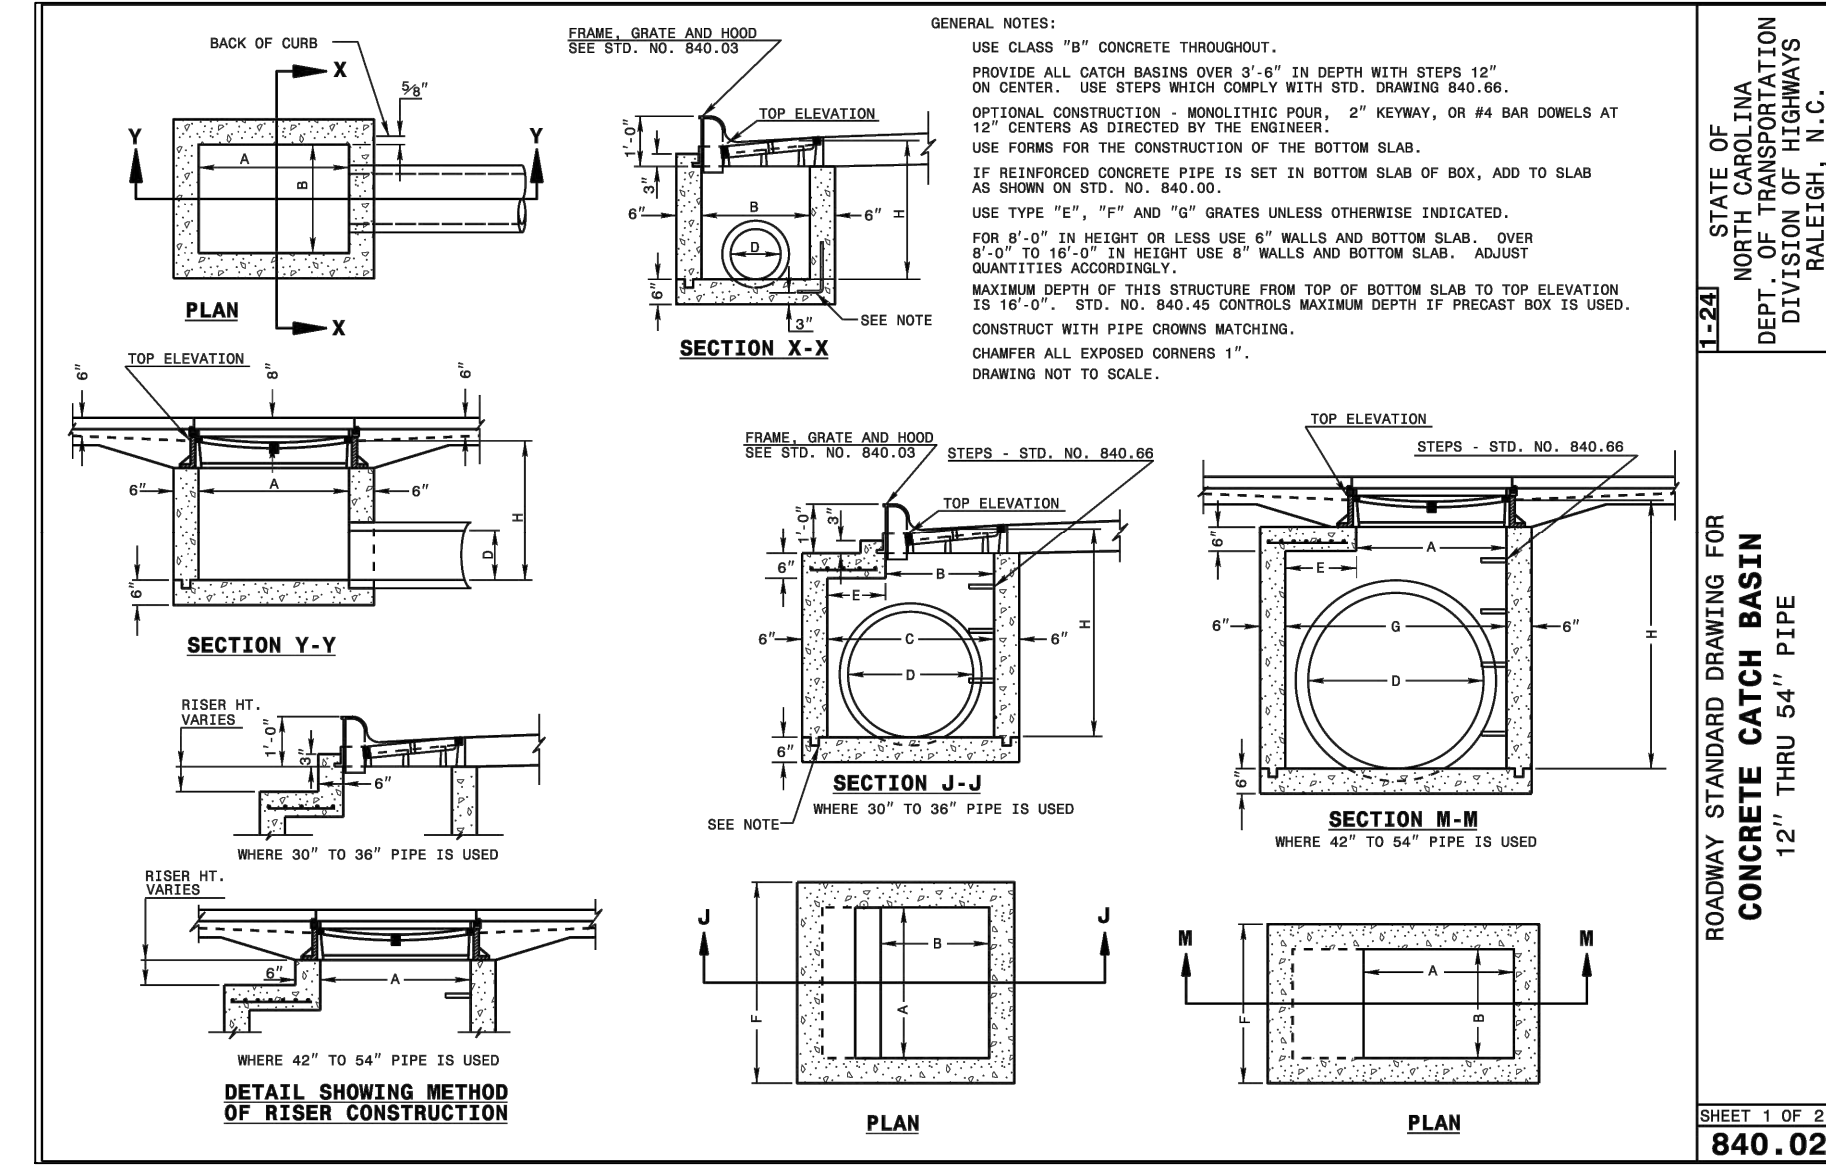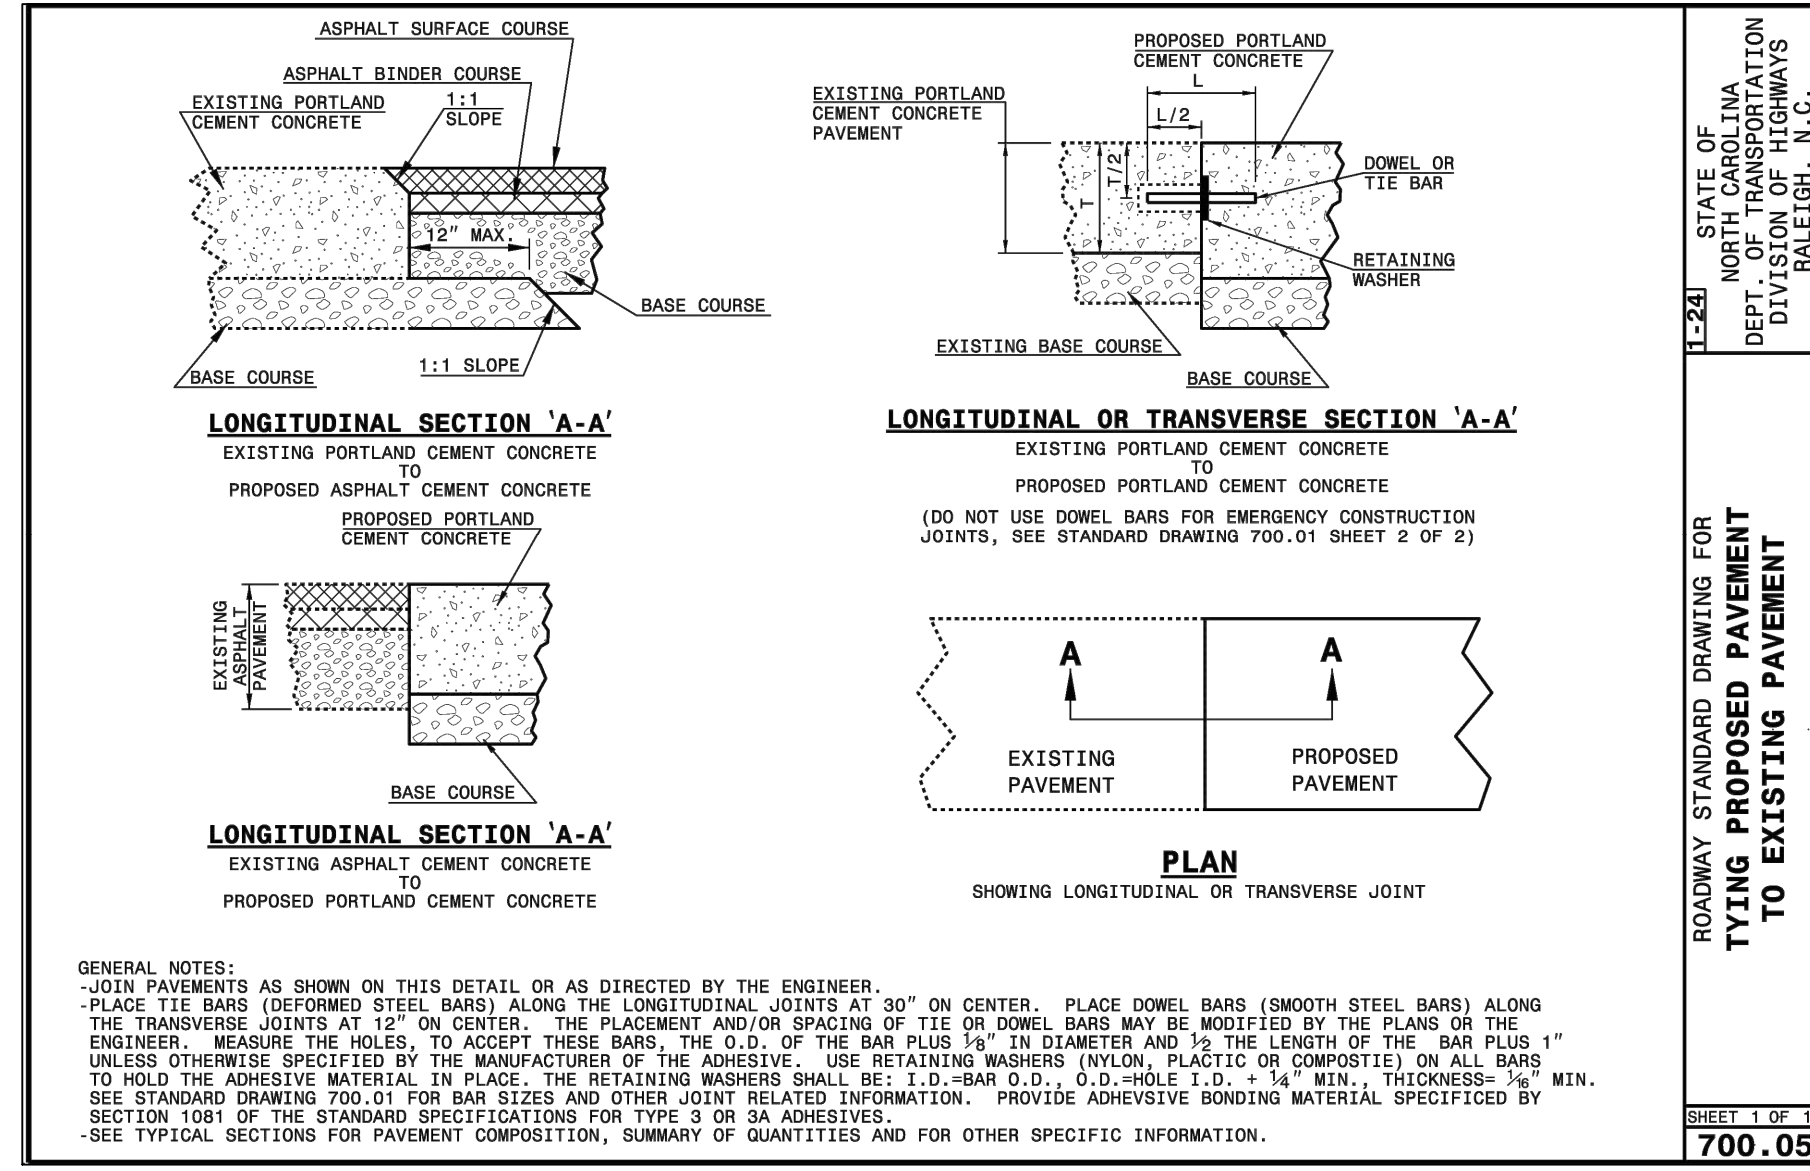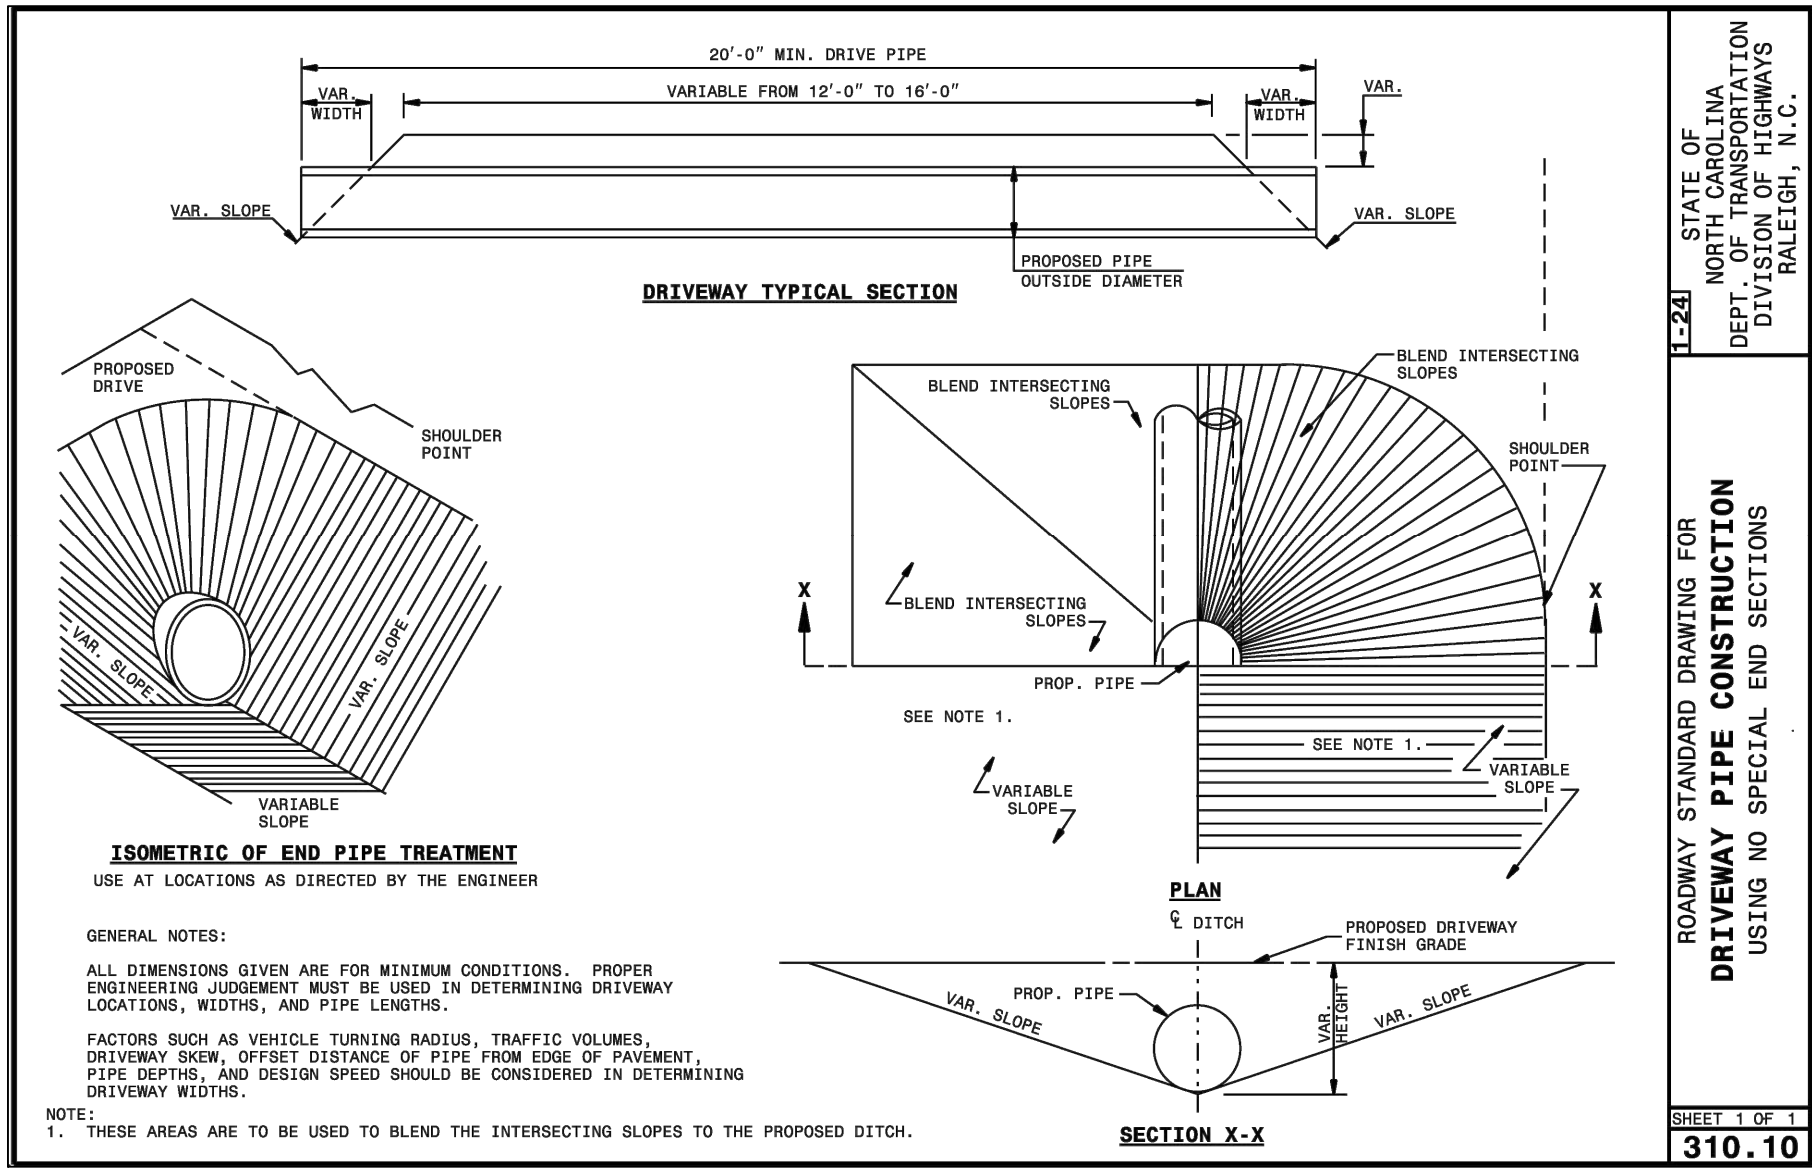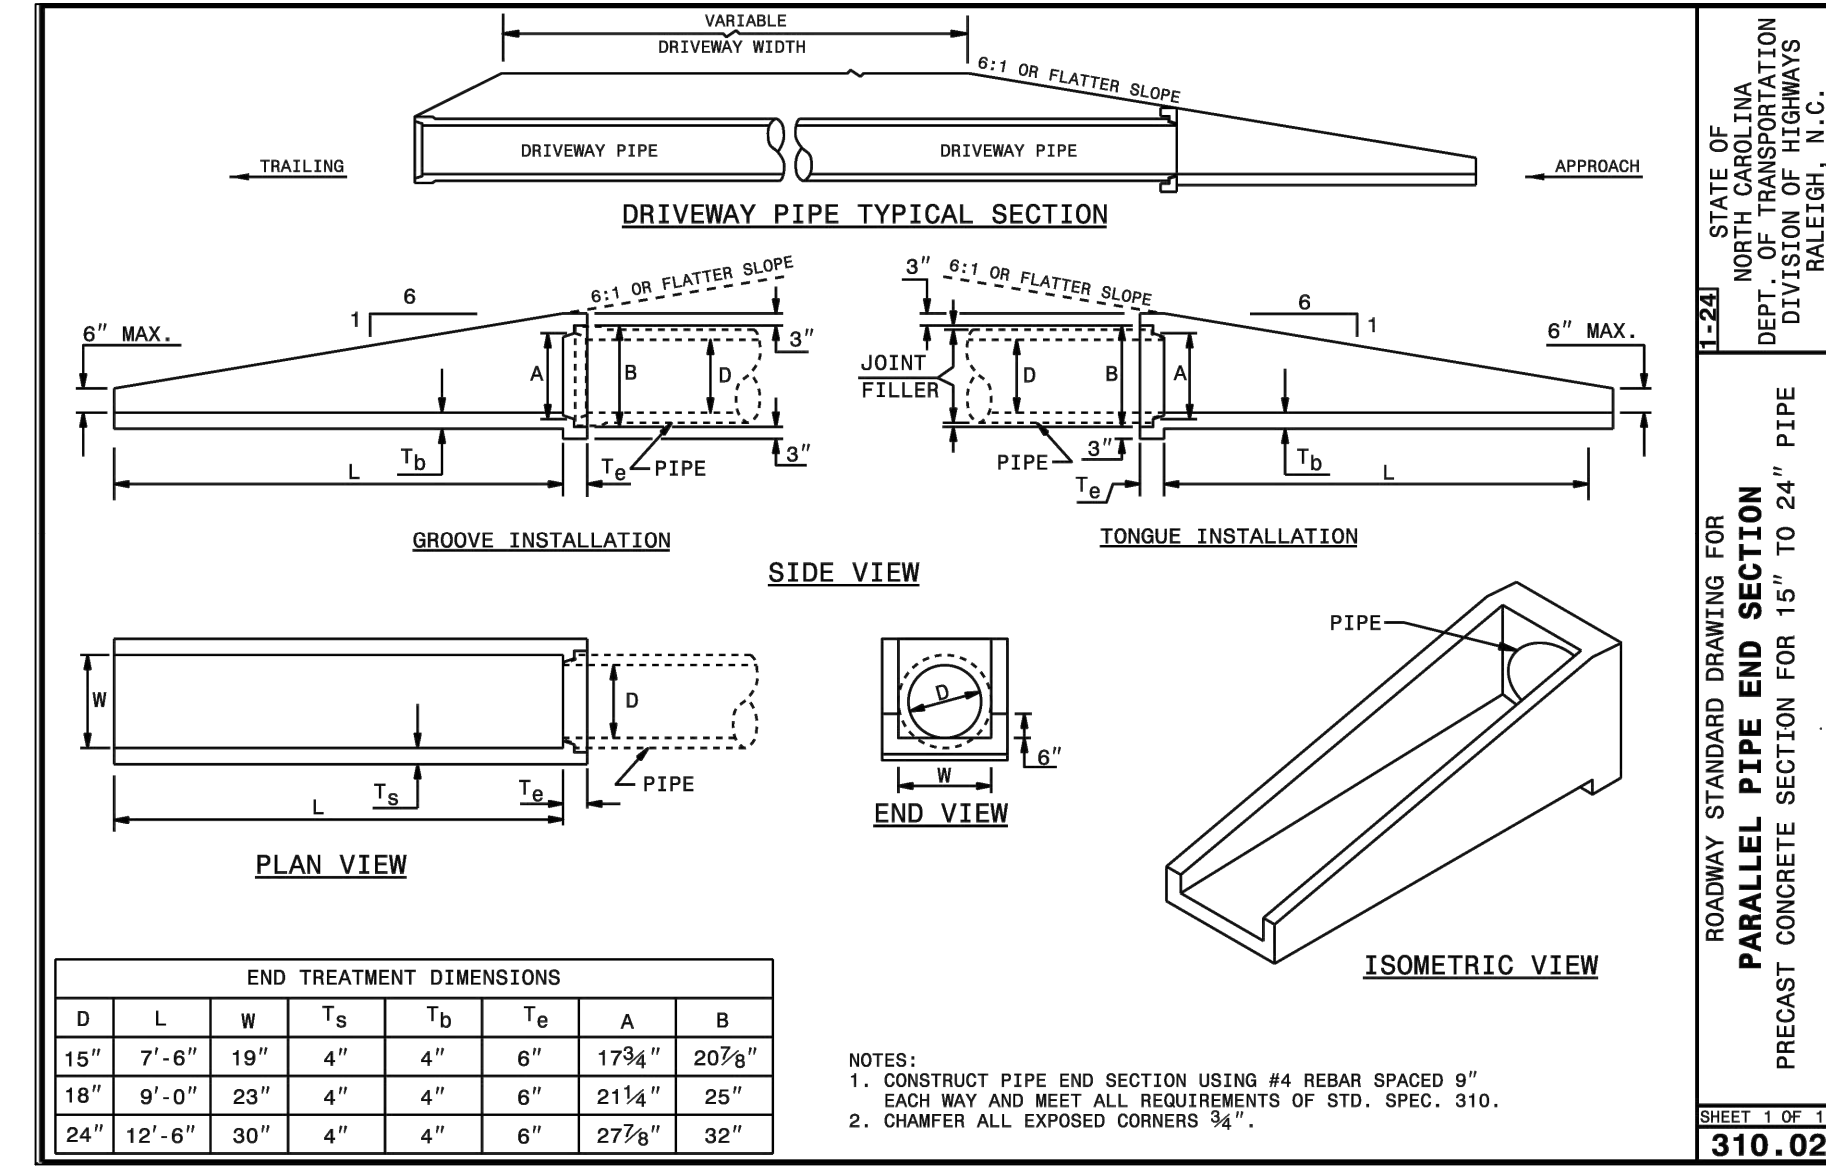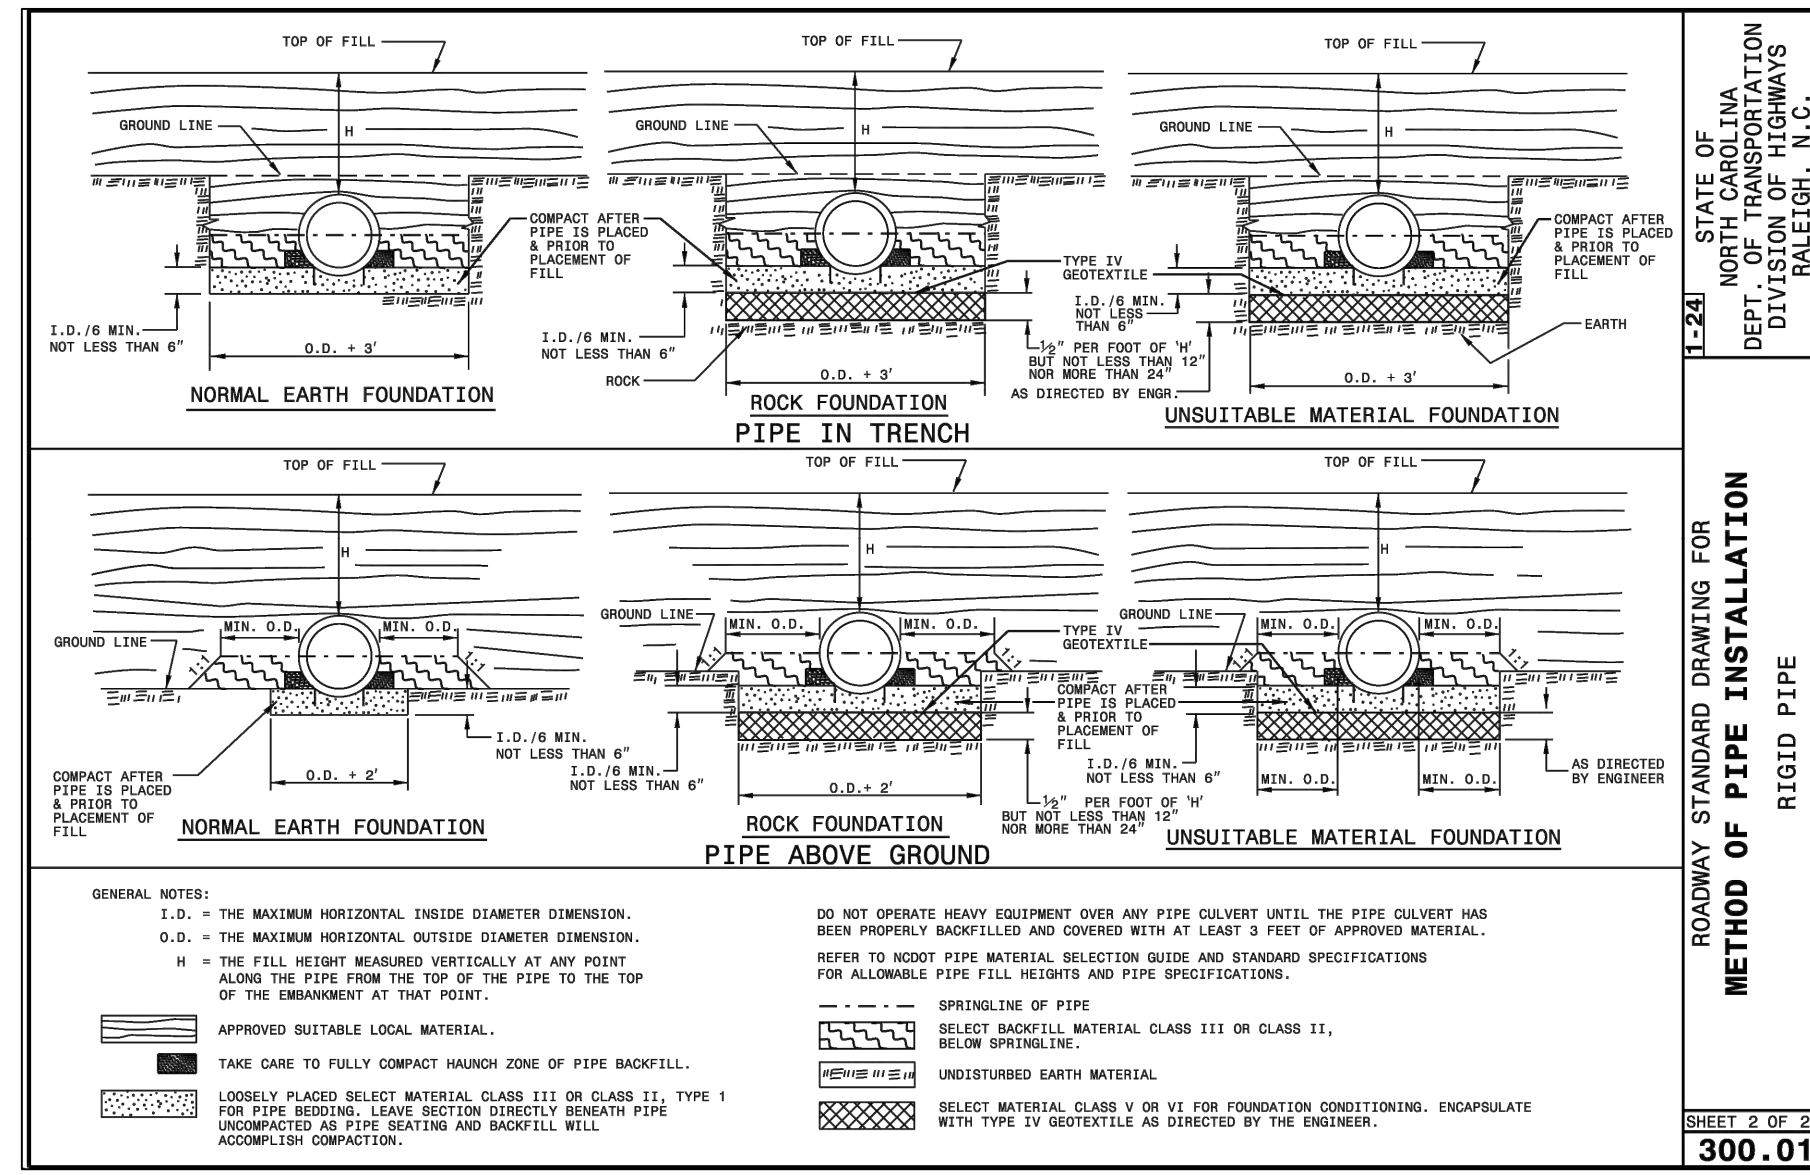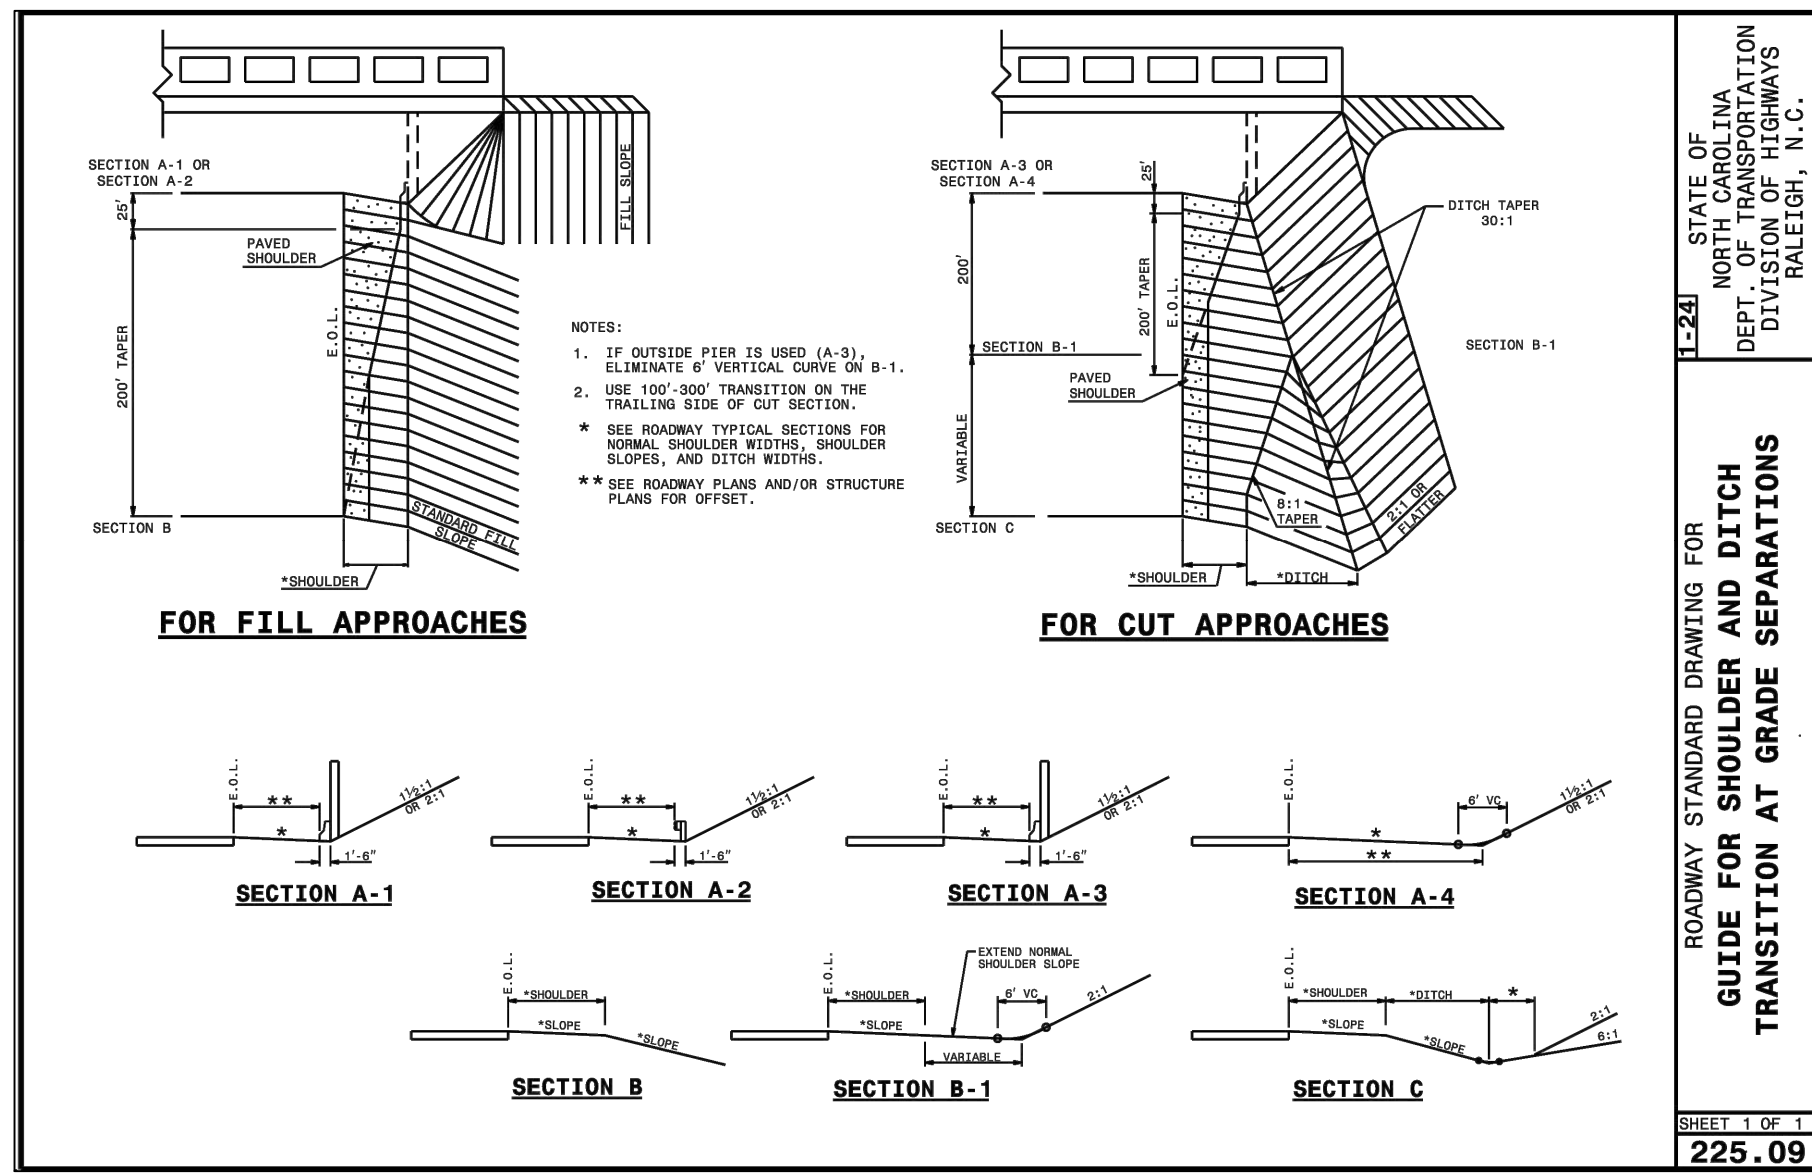

ZEBULON ANIMAL HOSPITAL
 DVM SERVICES REALTY, LLC

PROJECT NUMBER:
 PROJECT PHASE:
 DATE: 03.18.2024
 SHEET TITLE:
 NCDOT DETAILS
 SHEET NUMBER:
 DT4

GENERAL NOTES:
 USE CLASS "B" CONCRETE THROUGHOUT.
 OPTIONAL CONSTRUCTION OF CONCRETE BOX - MONOLITHIC POUR, 2" KEYWAY, OR #4 BARS DOWN AT 12" CENTERS AS DIRECTED BY THE ENGINEER.
 REINFORCING STEEL (#4 BARS) TO BE #3 STRAIGHT BARS, 12 BARS REQUIRED 2'-9" LONG FOR CONCRETE BOX AND 3'-1" LONG FOR BRICK BOX. DIMENSIONS OF BOX MAY BE CHANGED BY THE ENGINEER.
 MORTAR JOINTS 1/2" ± 1/4" THICK.
 CONCAVE TOOL ALL EXPOSED JOINTS.
 USE FORMS TO CONSTRUCT THE BOTTOM SLAB.
 JUMBO BRICK WILL BE PERMITTED. CONCRETE BRICK OR 4" SOLID CONCRETE BLOCKS MAY BE USED IN LIEU OF CLAY BRICK.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
SPRING BOX
 CONCRETE OR BRICK

SHEET 1 OF 1
840.41

FILL HEIGHT	TOP SLAB THICKNESS	CONC. CU. YD.	REINF. LBS.
25' OR LESS	6"	0.722	12
26' THRU 50'	6 1/2"	0.737	22
51' THRU 75'	7 1/2"	0.742	34
76' THRU 100'	8 1/2"	0.792	34

FILL HEIGHT	TOP SLAB THICKNESS	CONC. CU. YD.	BRICK	TOTAL REINF. LBS.
25' OR LESS	6"	0.535	0.395	0.930
26' THRU 50'	6 1/2"	0.552	0.395	0.947
51' THRU 75'	7 1/2"	0.556	0.395	0.961
76' THRU 100'	8 1/2"	0.620	0.395	1.015

* USE THIS TOP SLAB FOR LIVE LOAD UP TO 2' OF FILL.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
PRECAST DRAINAGE STRUCTURE
 (SOLID AND WAFFLE WALL)

SHEET 1 OF 2
840.45

THE PATTERN OF THE KNOCK-OUT PANELS ARE SHOWN FOR ILLUSTRATIVE PURPOSES ONLY.

GENERAL NOTES:
 THIS PRECAST BOX MAY BE USED FOR THE FOLLOWING STANDARDS: 840.01, 840.02, 840.04, 840.05, 840.13, 840.14, 840.15, 840.17, 840.18, 840.19, 840.26, 840.27, 840.28, 840.31, 840.32 AND 840.41.
 INSTALL PRECAST DRAINAGE STRUCTURES AND PAY FOR IN ACCORDANCE WITH SPECIFICATION SECTION 840.
 DO NOT PLACE PRECAST DRAINAGE STRUCTURES UNDER TRAFFIC OR WHERE TRAFFIC WILL BE DETOURD.
 USE 4000 PSI CONCRETE.
 PROVIDE ALL REINFORCING STEEL WHICH MEETS ASTM A615 FOR GRADE 60 AND WELDED WIRE FABRIC CONFORMING TO ASTM A1064. LIMIT MAXIMUM DEPTH TO TOP OF BOTTOM SLAB FOR WAFFLE WALL STRUCTURE TO 15'-0". LIMIT SOLID WALL STRUCTURE TO 15'-0".
 PLACE LIFT HOLES OR PINS IN ACCORDANCE WITH OSHA STANDARD 1926.704.
 CUT OR FORM OPENINGS FOR PIPE TO PROVIDE REQUIRED SIZE AND LOCATION. ORIENT WAFFLE WALL STRUCTURES SO THAT PIPES ENTER THROUGH THE KNOCKOUT/WAFFLE PANELS ONLY. PIPES MAY ENTER THROUGH THE CORNERS OF SOLID WALL BOXES IF A MINIMUM OF 6" OF WALL IS PROVIDED ABOVE THE HOLE.
 ALL ELEMENTS PRECAST TO MEET ASTM C913.
 FRAME AND GRATE HEIGHT MAY BE ADJUSTED WITH CONCRETE OR BRICK IN ACCORDANCE WITH STANDARD 840.25.
 PROVIDE PRECAST STRUCTURES OVER 3'-6" IN DEPTH WITH STEPS AS DIRECTED BY THE ENGINEER.
 WELDED WIRE FABRIC MAY BE SUBSTITUTED FOR REBAR AS LONG AS THE SAME AREA OF STEEL IS PROVIDED.
 SEAL JOINTS WITH A FLEXIBLE BUTYL RUBBER BASE CONFORMING TO FEDERAL SPECIFICATION SS-S-21A, AASHTO M-196, TYPE B - BUTYL RUBBER.
 LIMIT MAXIMUM STRUCTURE SIZE TO INSIDE CLEAR DIMENSIONS OF 5'-0" X 5'-0".
 THE OUTSIDE PIPE DIAMETER PLUS 2" OR THE OPENING REQUIRED FOR FRAME AND GRATE IS THE MINIMUM STRUCTURE SIZE WHICH EVER IS GREATER.
 USE MANHOLE FRAME AND COVER AS INDICATED ON THE PLANS. REINFORCE OPENING AS SHOWN ON THIS SHEET.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
PRECAST DRAINAGE STRUCTURE
 (GENERAL NOTES AND DETAILS)

SHEET 2 OF 2
840.45

GENERAL NOTES:
 USE 4000 PSI MINIMUM COMPRESSIVE STRENGTH CONCRETE.
 USE ASTM A615 GRADE 60 REINFORCING STEEL. USE ASTM A1064 WELDED WIRE FABRIC (WWF).
 FABRICATE, ASSEMBLE AND DESIGN PRECAST MANHOLE COMPONENTS ACCORDANCE WITH AASHTO M193.
 ASSEMBLE RISER AND GRADE RINGS WITH THE STEPS SPACED 12" FROM THE TOP TO THE BOTTOM OF THE MANHOLE.
 THE HEIGHT OF GRADE ADJUSTMENT RINGS PLUS FRAME AND COVER SHALL NOT EXCEED 24".
 WHERE THE MANHOLE IS EXPOSED TO ROAD TRAFFIC, CONSTRUCT THE TOP OF THE MANHOLE FLUSH WITH THE GROUND AND A MINIMUM OF 3" ABOVE THE GROUND AT OTHER LOCATIONS.
 LIMIT DEPTH OF FILL TO 30'-0" FROM FINISH GRADE TO TOP OF BOTTOM SLAB.
 THE MIN. SLAB THICKNESS "T" IS THE DIMENSION OF THE THINNEST PORTION OF THE TOP/BOTTOM SLAB.
 * TOP MAT OF REINFORCEMENT MAY BE NEGLECTED IF TOP SLAB HAS A DISTINGUISHABLE TOP AND BOTTOM.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
PRECAST MANHOLE 4'-5" AND 6" DIAMETER
 12" THRU 48" PIPE

SHEET 1 OF 1
840.52

D	W	T	As
4	4	6	0.12
5	5	8	0.15
6	6	8	0.18

SOLID COVER SHOWN PERFORATED. PERFORATED AVAILABLE IF SPECIFIED.
 STATE USE OF SYSTEM ON COVER (I.E.: SEWER, STORM DRAIN, ELECTRICAL)

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
MANHOLE FRAME AND COVER

SHEET 1 OF 1
840.54

MINIMUM WEIGHTS - LBS.
 FRAME - 180
 COVER - 120
 TOTAL - 300

NOTES:
 INSTALL ALL STEPS PROTRUDING 4" FROM INSIDE FACE OF STRUCTURE WALL. STEPS DIFFERING IN DIMENSIONS, CONFIGURATION OR MATERIALS FROM THOSE SHOWN MAY ALSO BE USED PROVIDED THE CONTRACTOR HAS FURNISHED THE ENGINEER WITH DETAILS OF THE PROPOSED STEPS AND HAS RECEIVED WRITTEN APPROVAL FROM THE ENGINEER FOR THE USE OF SUCH STEPS.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
DRAINAGE STRUCTURE STEPS

SHEET 1 OF 1
840.66

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
PIPE COLLAR

SHEET 1 OF 1
840.72

D	E	F	CU. YD.
12"	12"	12"	0.3528
18"	12"	12"	0.3990
24"	12"	12"	0.5528
30"	12"	12"	0.6560
36"	12"	12"	0.7640
42"	12"	12"	0.8856
48"	12"	12"	1.0128
54"	18"	18"	2.2920
60"	18"	18"	2.8508
66"	18"	18"	3.1307
72"	18"	18"	3.4176

GENERAL NOTES:
 USE PIPE COLLAR FOR EXTENDING EXISTING CONCRETE PIPE CULVERTS AT LOCATIONS SHOWN ON PLANS OR AS DIRECTED BY THE ENGINEER. THIS INCLUDES EXTENDING EXISTING PIPES WITH PIPES OF DIFFERENT MATERIALS.
 CONSTRUCT THE PIPE COLLAR WITH CLASS "B" OR BETTER CONCRETE.
 OBSERVE ALL REQUIREMENTS OF SECTION 840 OF THE STANDARD SPECIFICATIONS.
 * USE 12 INCH DIAMETER VALUES FOR PIPE DIAMETERS LESS THAN 12 INCH.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.

ROADWAY STANDARD DRAWING FOR
CONCRETE CURB, GUTTER AND CURB & GUTTER

SHEET 1 OF 3
846.01




GENERAL NOTES:
 PLACE CONTRACTION JOINTS AT 10' INTERVALS, EXCEPT THAT A 15' SPACING MAY BE USED WHEN A MACHINE IS USED OR WHEN SATISFACTORY SUPPORT FOR THE FACE FORM CAN BE OBTAINED WITHOUT THE USE OF TEMPLATES AT 10' INTERVALS.
 JOINT SPACING MAY BE ALTERED IF REQUIRED BY THE ENGINEER. CONTRACTION JOINTS MAY BE INSTALLED WITH THE USE OF TEMPLATES OR FORMED BY OTHER APPROVED METHODS.
 CONSTRUCT NON-TEMPLATE FORMED JOINTS A MIN. OF 1 1/2" DEEP. FILL ALL CONTRACTION JOINTS, EXCEPT IN 8" HIGH MEDIAN CURBS, WITH JOINT FILLER AND SEALER.
 SPACE EXPANSION JOINTS AT 90' INTERVALS AND ADJACENT TO ALL RIGID OBJECTS.

STATE OF NORTH CAROLINA
 DEPT. OF TRANSPORTATION
 DIVISION OF HIGHWAYS
 RALEIGH, N.C.







ROADWAY STANDARD DRAWING FOR
CONCRETE CURB, GUTTER AND CURB & GUTTER

SHEET 2 OF 3
846.01

* THE GUTTER SLOPE FOR 1'-6" CURB AND GUTTER SHALL MATCH THE SLOPE OF THE ADJOINING PAVEMENT.









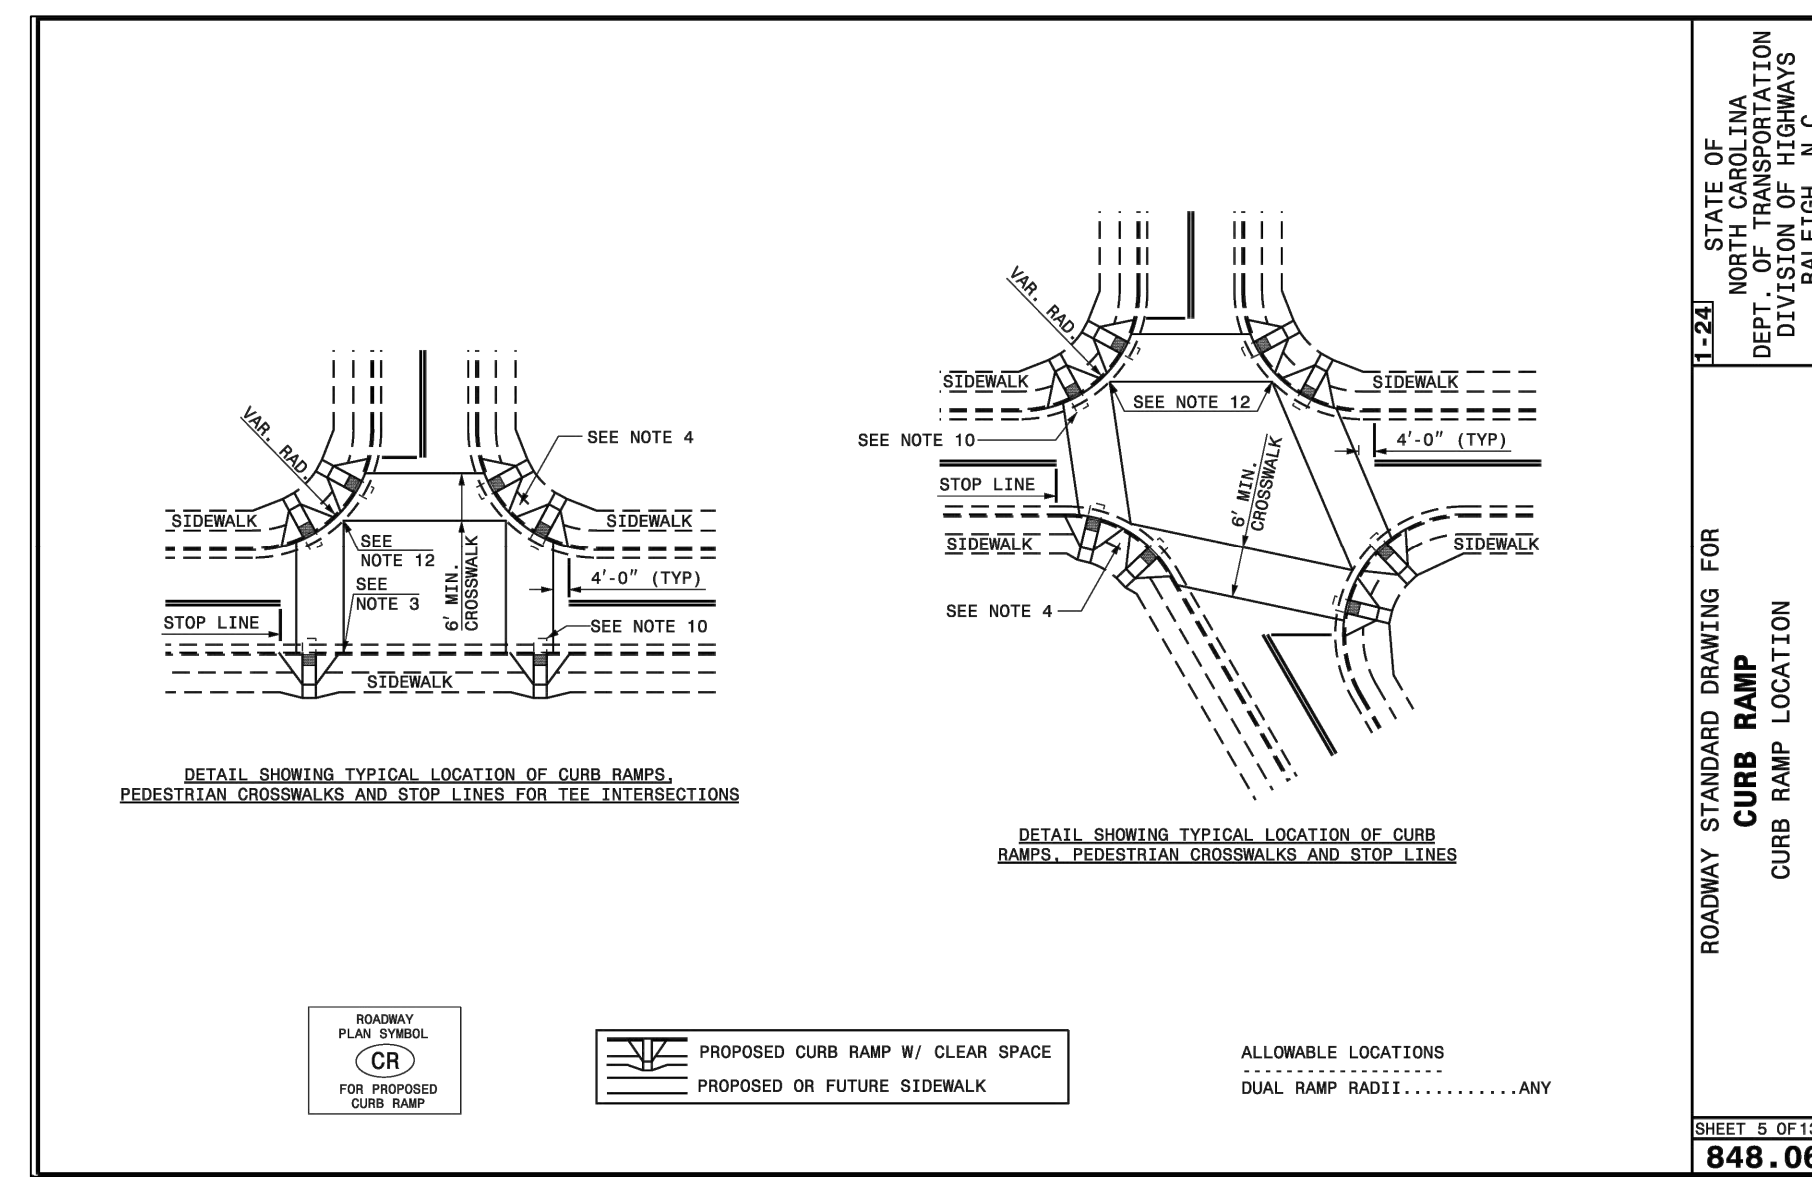
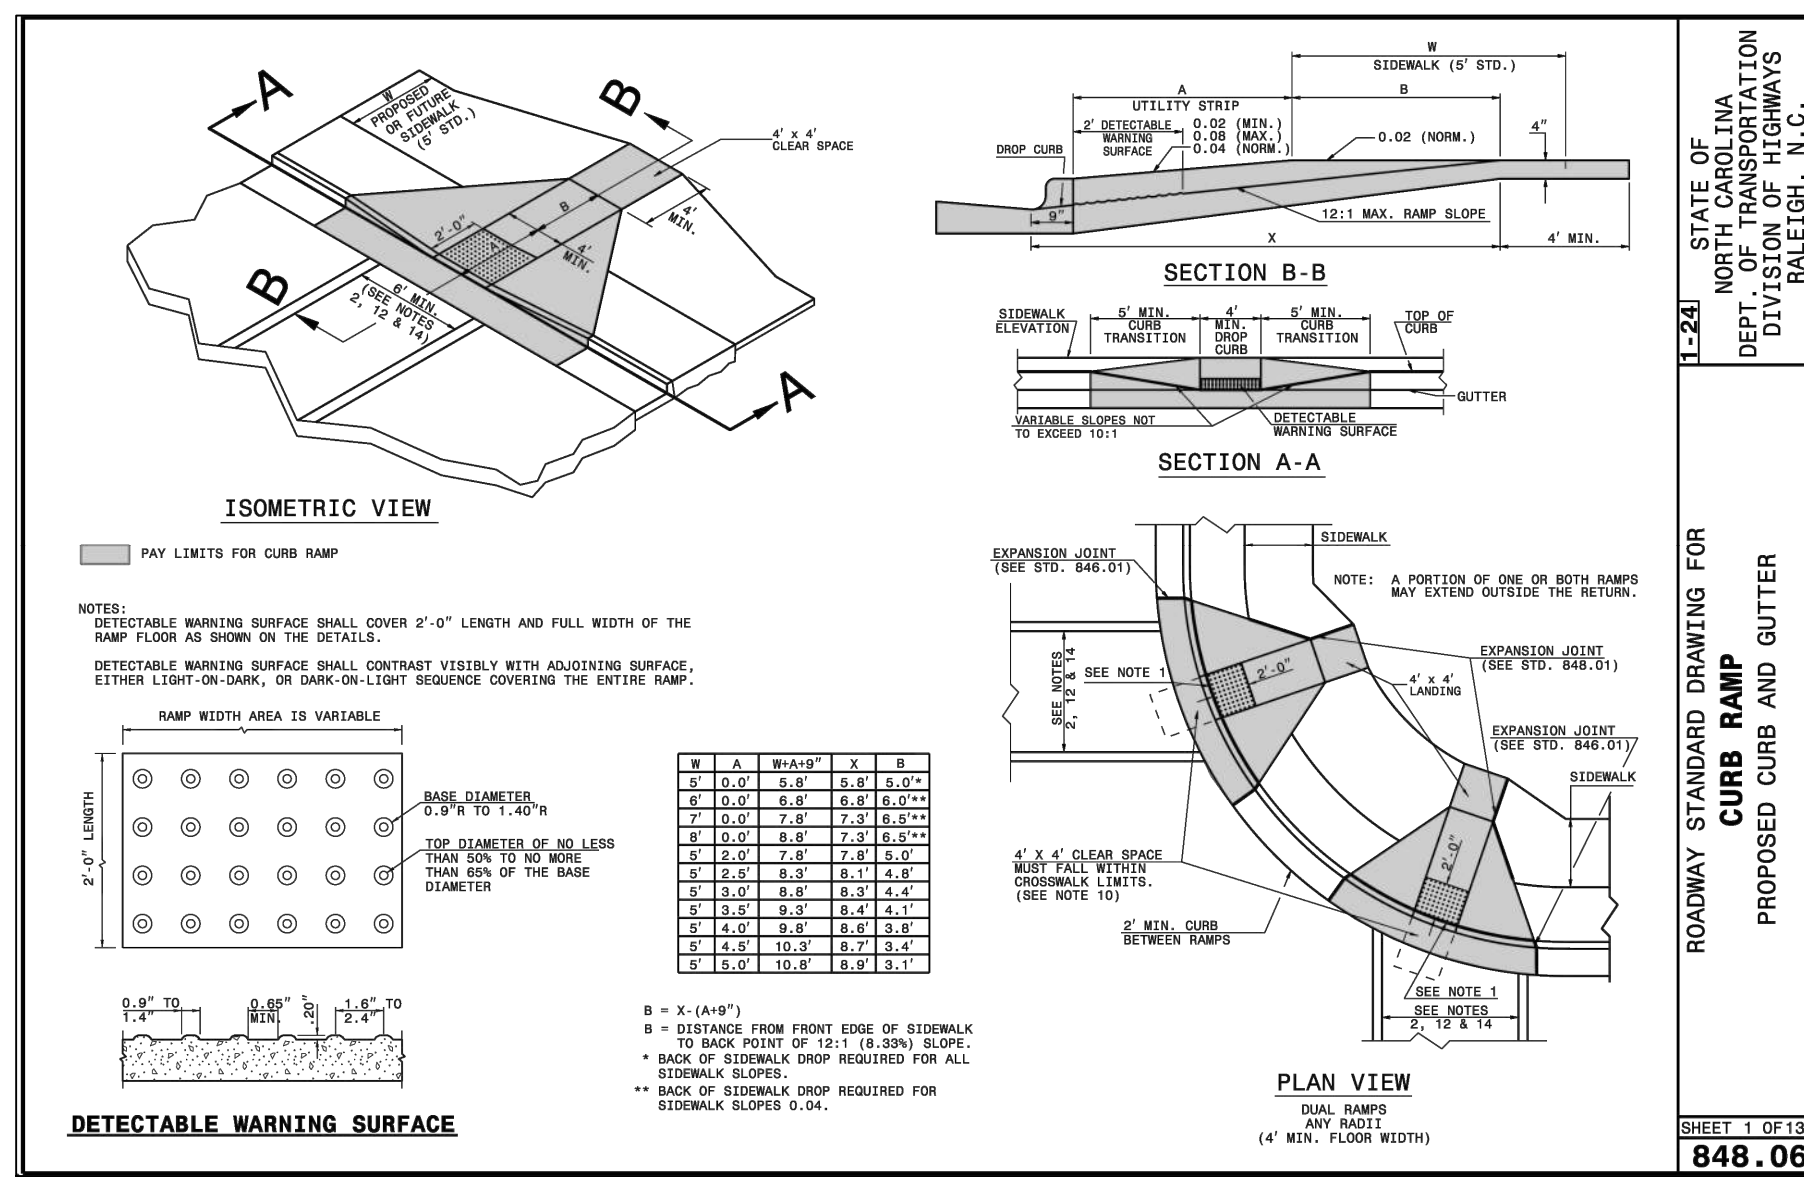
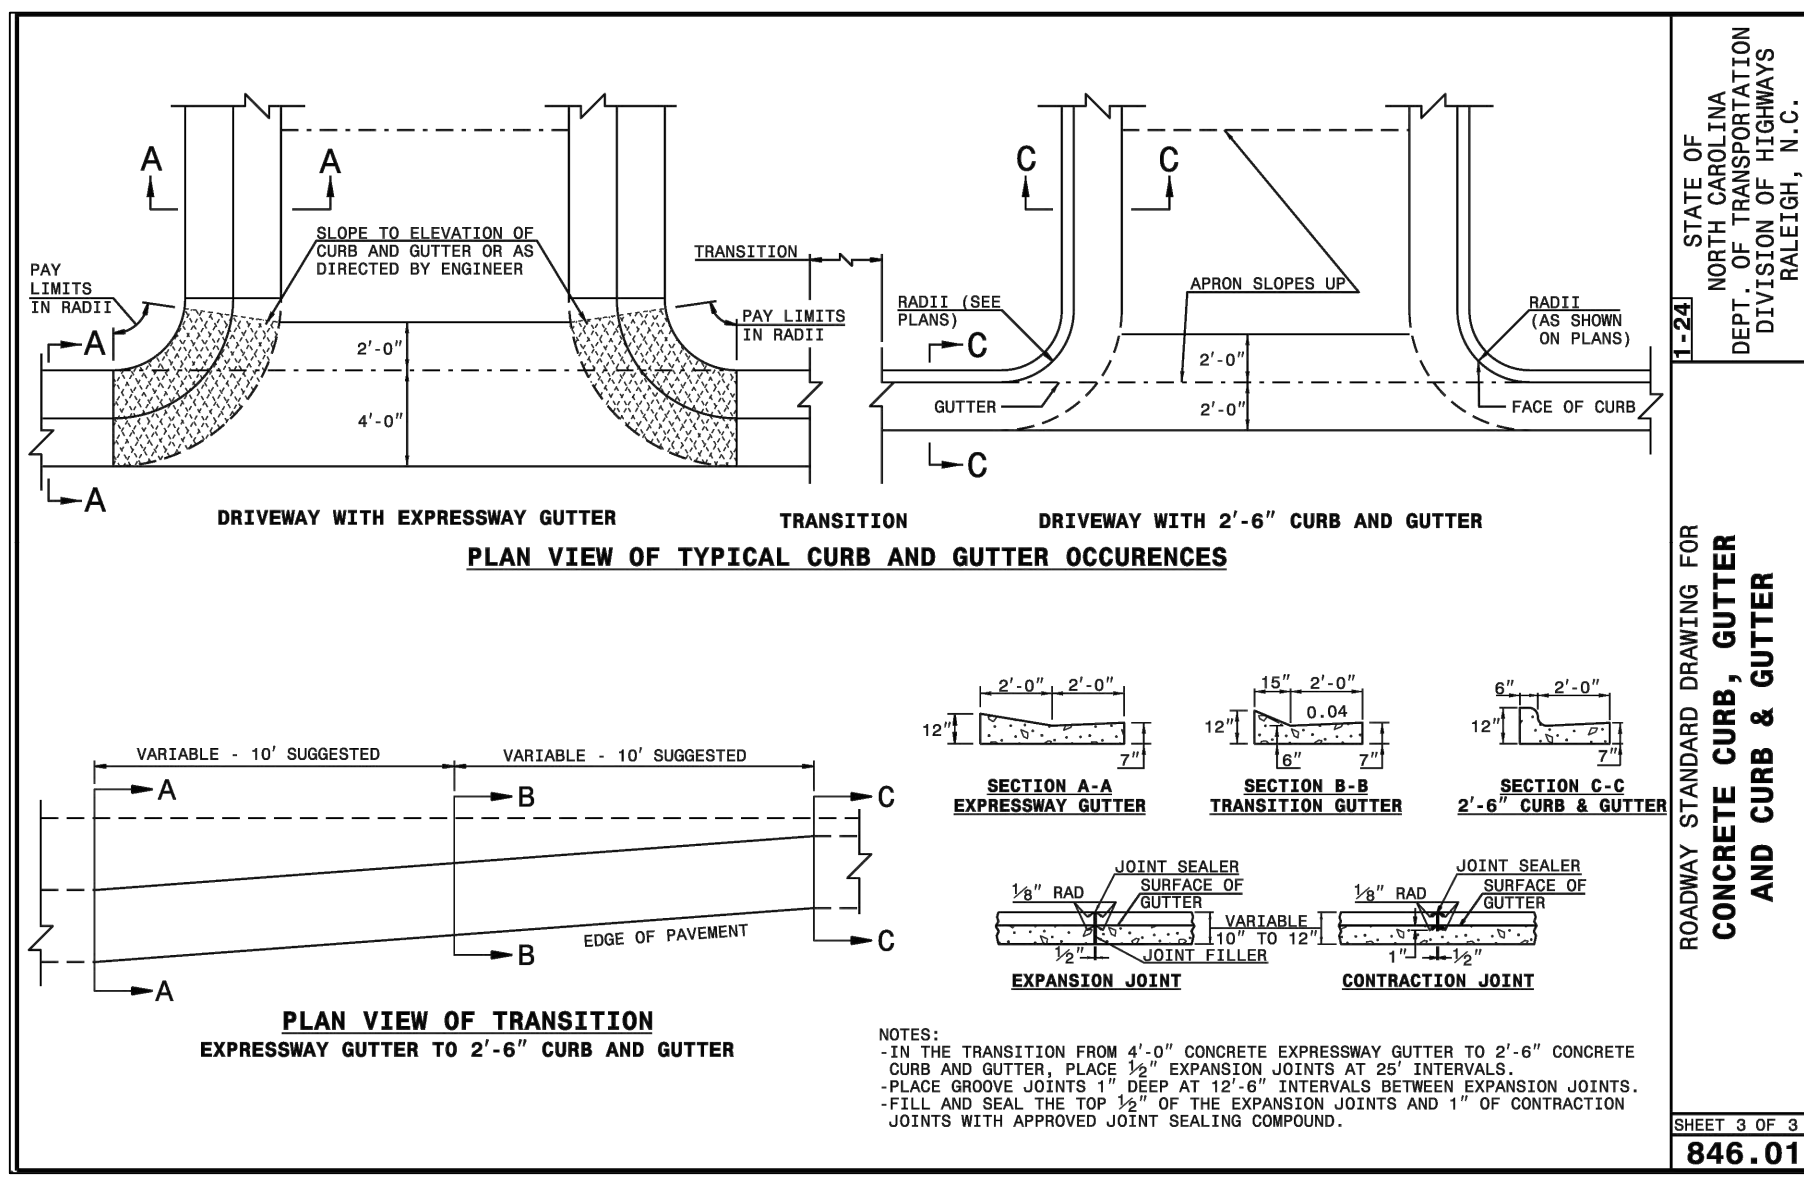



- NOTES:
- CONSTRUCT THE RAMP SURFACE TO BE STABLE, FIRM, AND SLIP RESISTANT. CONSTRUCT THE CURB RAMP TYPE AS SHOWN IN THE PAVEMENT MARKING PLANS OR AS DIRECTED BY THE ENGINEER.
 - LOCATE CURB RAMP AND PLACE PEDESTRIAN CROSSWALK MARKINGS AS SHOWN IN THE PAVEMENT MARKING PLANS. WHEN FIELD ADJUSTMENTS REQUIRE MOVING CURB RAMP OR MARKINGS AS SHOWN, CONTACT THE SIGNING AND DELINEATION UNIT OR LOCATE AS DIRECTED BY THE ENGINEER.
 - COORDINATE THE CURB RAMP AND THE PEDESTRIAN CROSSWALK MARKINGS SO A 4'x4' CLEAR SPACE AT THE BASE OF THE CURB RAMP WILL FALL WITHIN THE PEDESTRIAN CROSSWALK LINES.
 - SET BACK DISTANCE FROM INSIDE CROSSWALK MARKING TO NEAREST EDGE OF TRAVEL LANE IS 4' MINIMUM.
 - REFER TO THE PAVEMENT MARKING PLANS FOR STOP BAR LOCATIONS AT SIGNALIZED INTERSECTIONS. IF A PAVEMENT MARKING PLAN IS NOT PROVIDED, CONTACT THE SIGNAL DESIGN SECTION FOR THE STOP BAR LOCATIONS OR LOCATE AS DIRECTED BY THE ENGINEER.
 - TERMINATE PARKING A MINIMUM OF 20' FROM THE BACK OF PEDESTRIAN CROSSWALK.
 - CONSTRUCT CURB RAMP A MINIMUM OF 4' WIDE.
 - CONSTRUCT THE RUNNING SLOPE OF THE RAMP 8.33% MAXIMUM.
 - ALLOWABLE CROSS SLOPE ON SIDEWALKS AND CURB RAMP WILL BE 2% MAXIMUM.
 - CONSTRUCT THE SIDE FLARE SLOPE A MAXIMUM OF 10% MEASURED ALONG THE CURB LINE.
 - CONSTRUCT THE COUNTER SLOPE OF THE GUTTER OR STREET AT THE BASE OF THE CURB RAMP A MAXIMUM OF 5% AND MAINTAIN A SMOOTH TRANSITION.
 - CONSTRUCT CLEAR SPACES FOR SIDEWALK A MINIMUM OF 4'x4' WITH A MAXIMUM SLOPE OF 2% IN ANY DIRECTION. CONSTRUCT CLEAR SPACES FOR MEDIAN ISLANDS A MINIMUM OF 5'x5' WITH A MAXIMUM SLOPE OF 2% IN ANY DIRECTION. IF CONSTRAINED ON TWO OR MORE SIDES, THE CLEAR SPACE SHALL BE 4' MINIMUM X 5' MINIMUM WITH 5' PROVIDED IN THE DIRECTION OF THE PEDESTRIAN STREET CROSSING.
 - TO USE A MEDIAN ISLAND AS A PEDESTRIAN REFUGE AREA, MEDIAN ISLANDS WILL BE A MINIMUM OF 6' WIDE. CONSTRUCT MEDIAN ISLANDS TO PROVIDE PASSAGE OVER OR THROUGH THE ISLAND.
 - SMALL CHANNELIZATION ISLANDS THAT CAN NOT PROVIDE A 5'x5' CLEAR SPACE AT THE TOP OF RAMP, WILL BE CUT THROUGH LEVEL WITH THE SURFACE STREET.
 - CURB RAMP WITH RETURNED CURBS MAY BE USED ONLY WHERE PEDESTRIANS WOULD NOT NORMALLY WALK ACROSS THE RAMP, WHERE THE ADJACENT SURFACE IS PLANTING OR OTHER NON-WALKING SURFACE, OR THE SIDE APPROACH IS SUBSTANTIALLY OBSTRUCTED.
 - PLACE A 1/2" EXPANSION JOINT WHERE THE CONCRETE CURB RAMP JOINS THE CURB AS SHOWN IN ROADWAY STANDARD DRAWING 846.01.
 - PLACE ALL PEDESTRIAN PUSH BUTTON ACTUATORS AND CROSSING SIGNALS AS SHOWN IN THE PLANS OR AS SHOWN IN THE MUTCD.
 - DETECTABLE WARNING SURFACES WILL COVER 2'-0" LENGTH AND FULL WIDTH OF THE RAMP FLOOR AS SHOWN ON THE DETAILS.
 - DETECTABLE WARNING SURFACES WILL CONTRAST VISIBLY WITH ADJOINING SURFACE, EITHER LIGHT-ON-DARK, OR DARK-ON-LIGHT SEQUENCE COVERING THE ENTIRE RAMP.

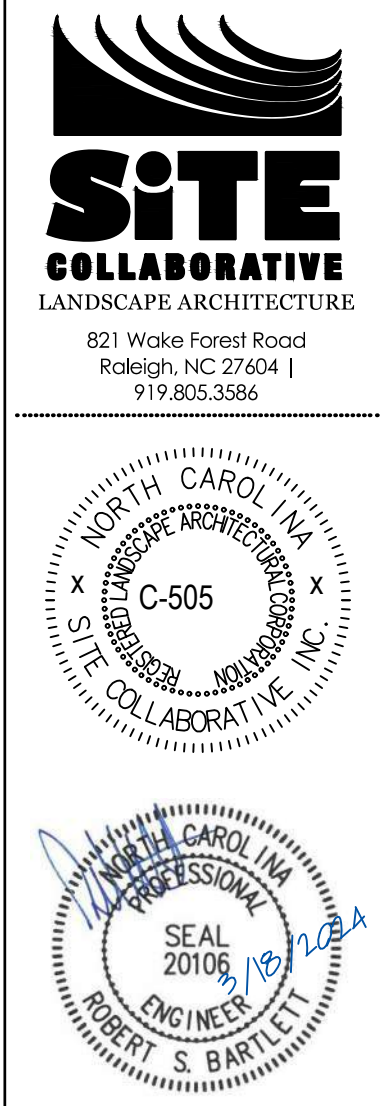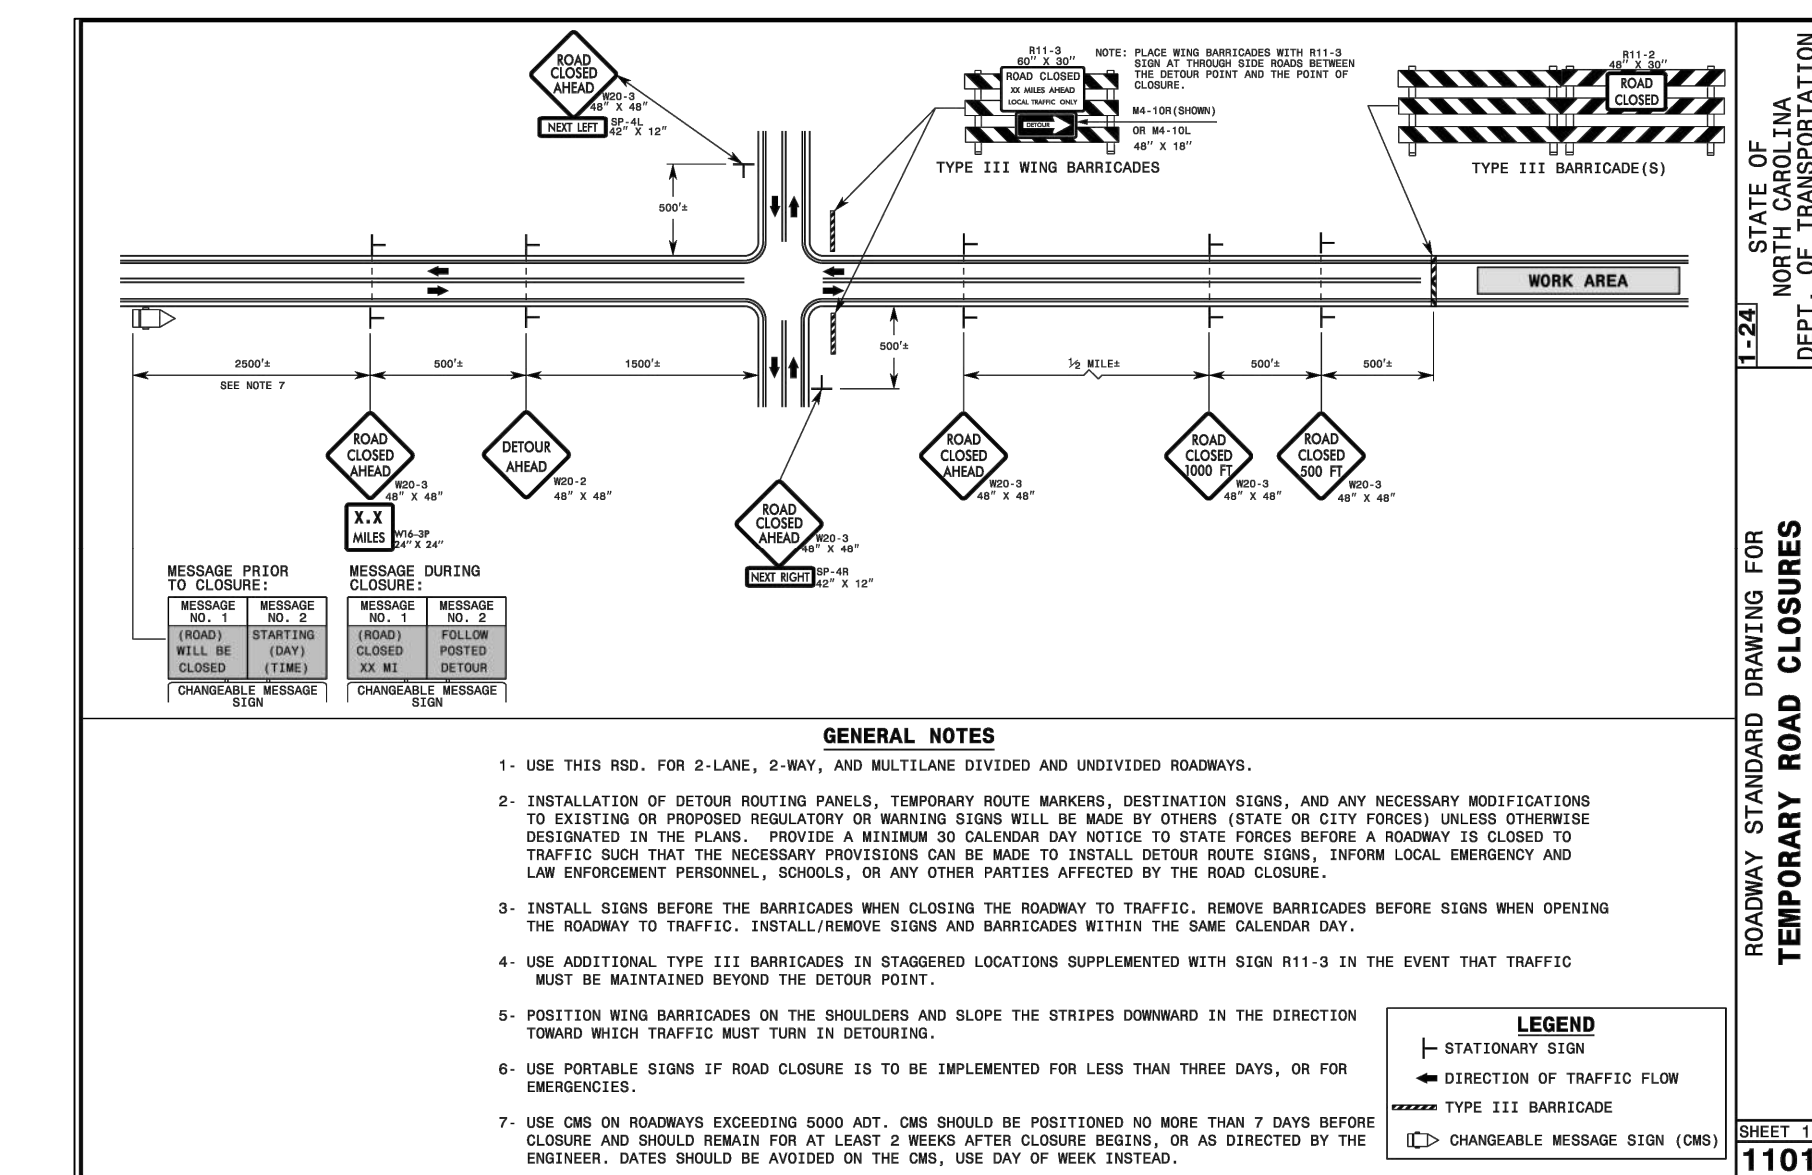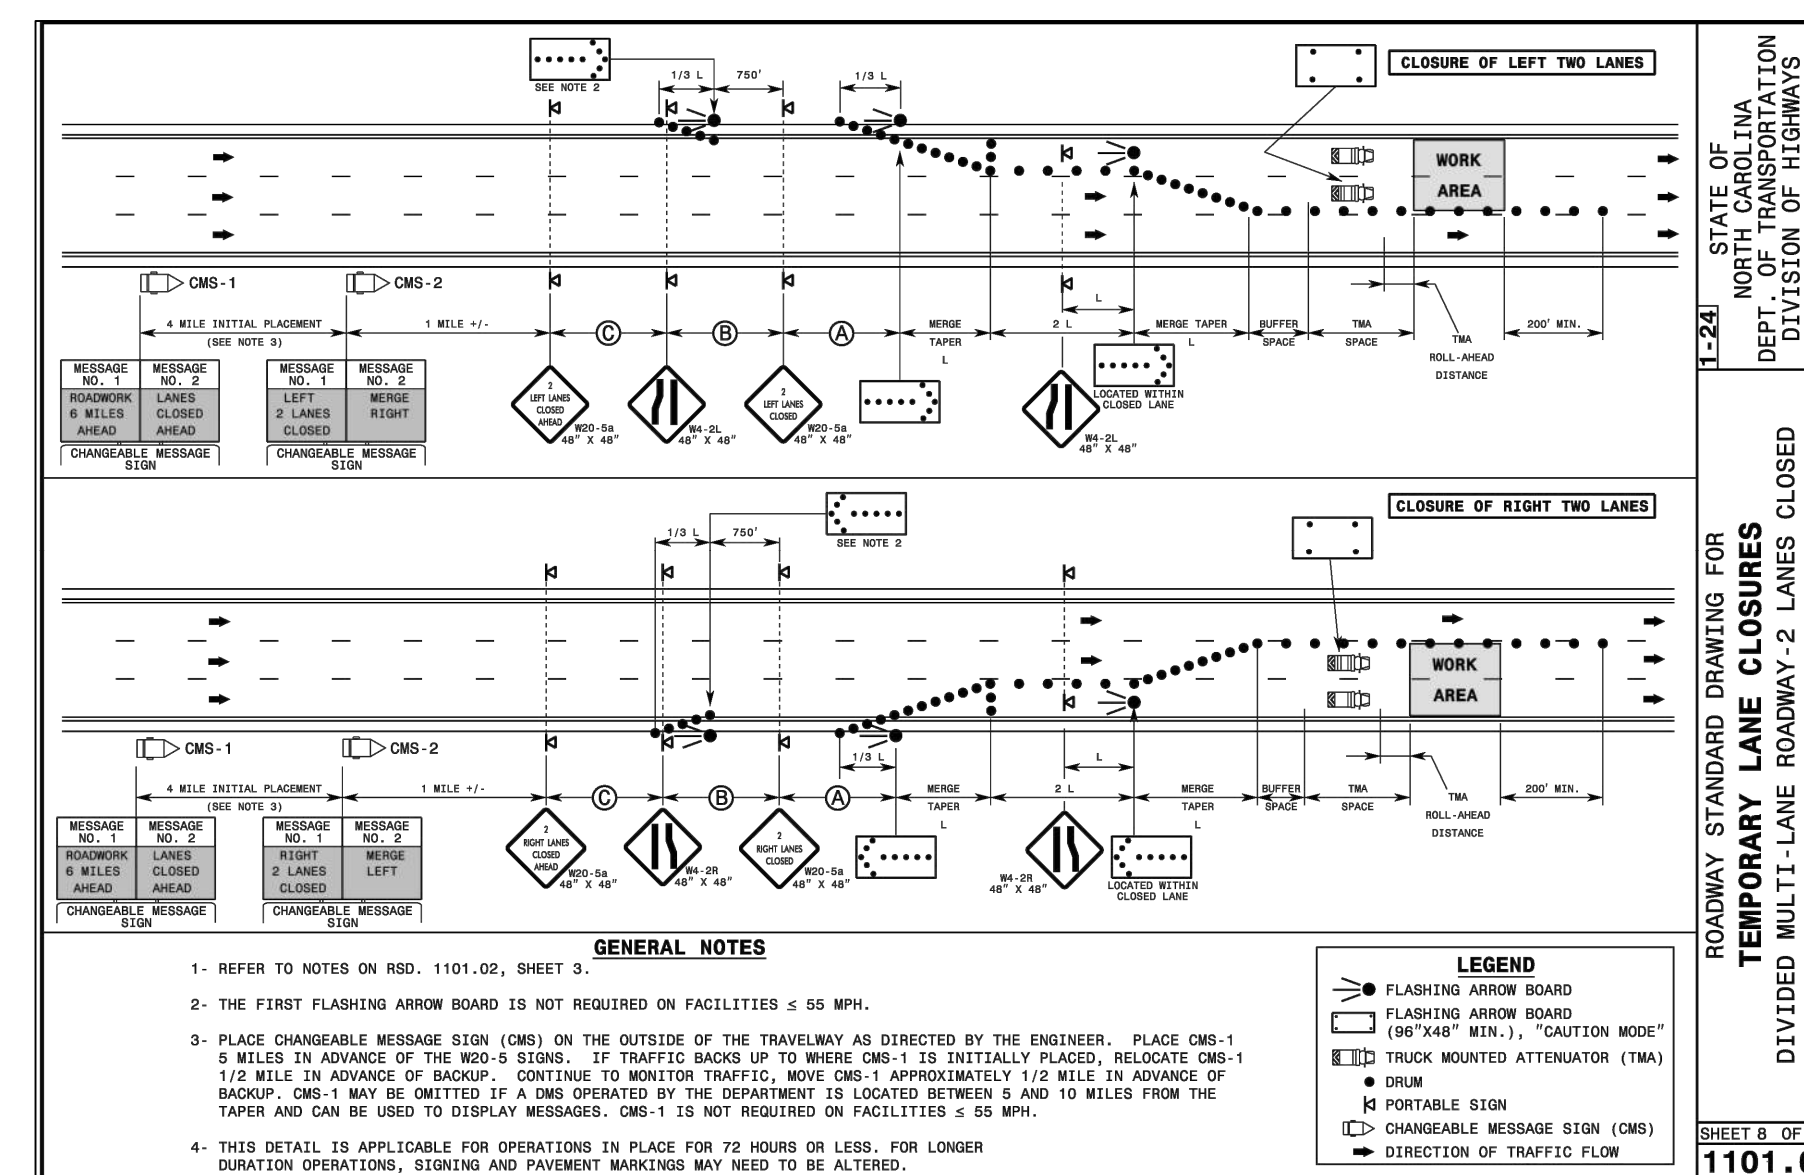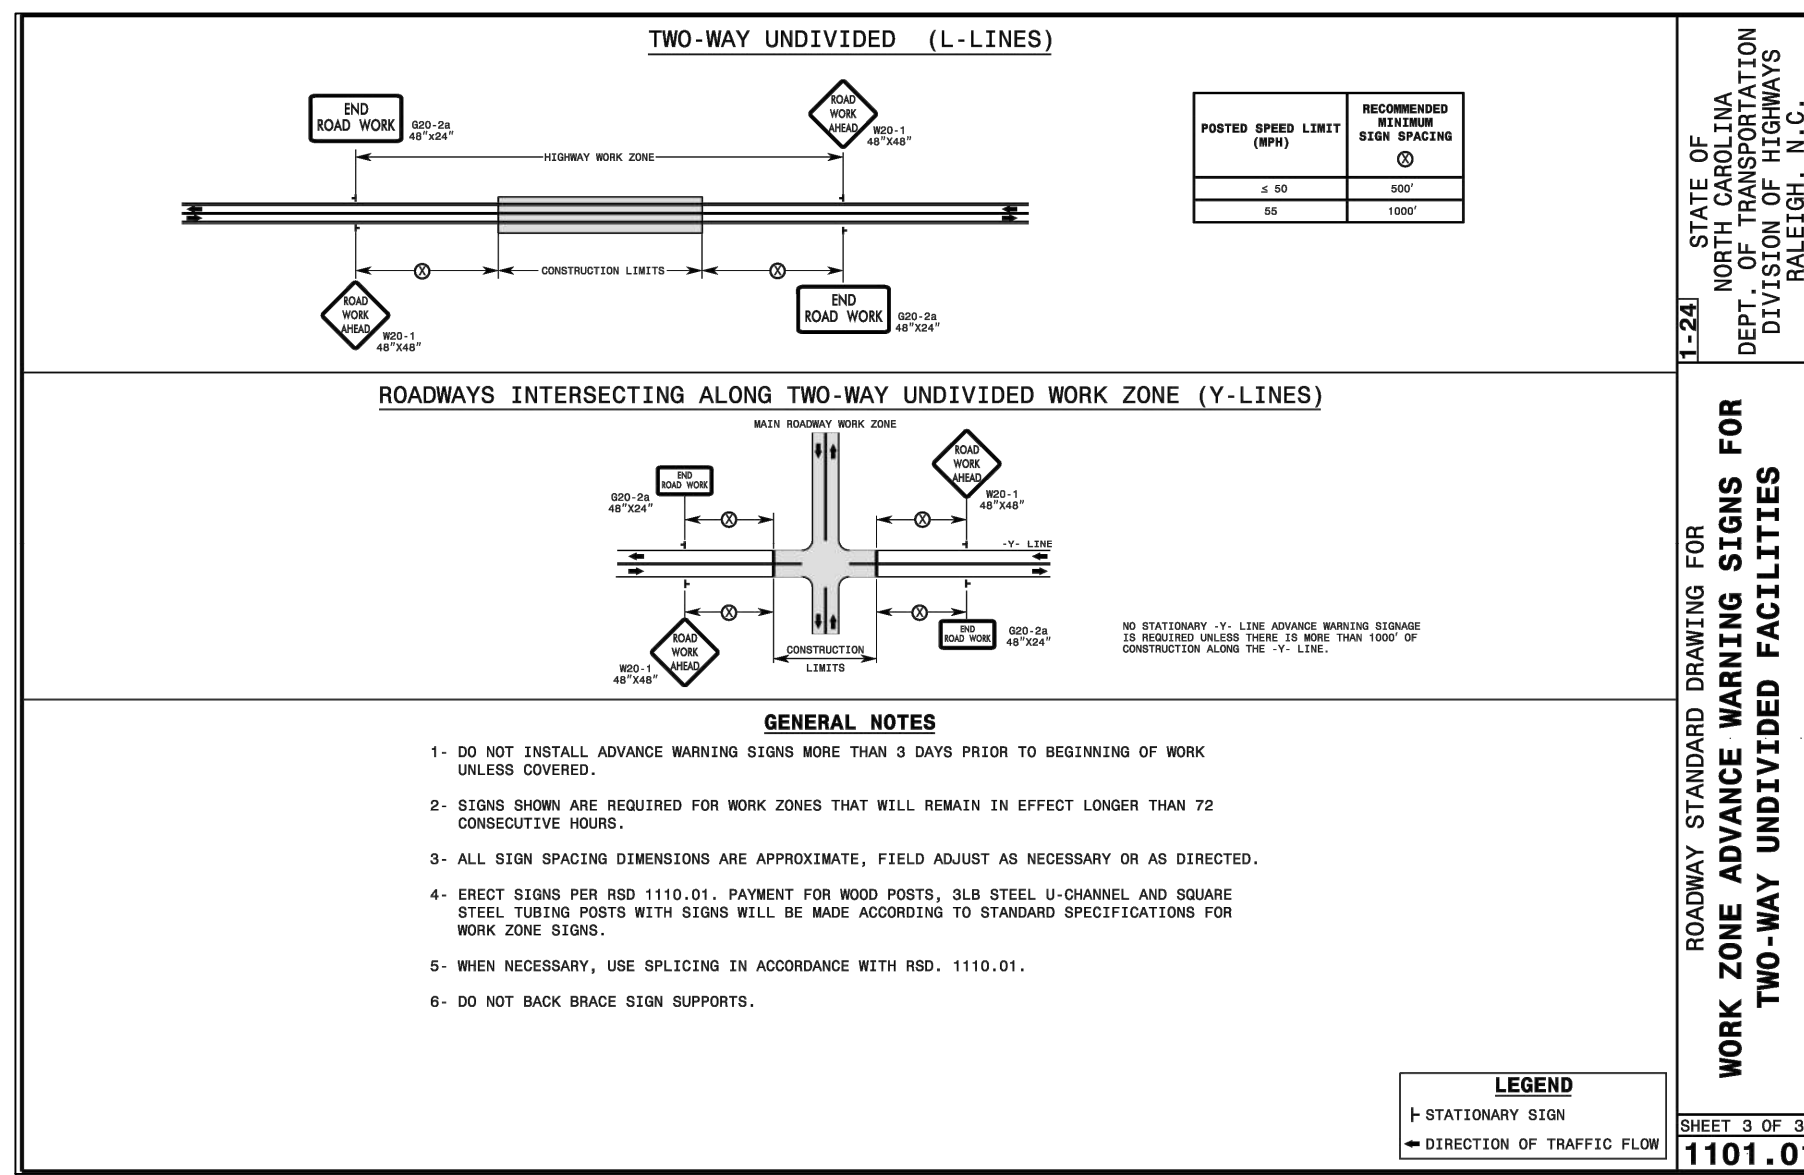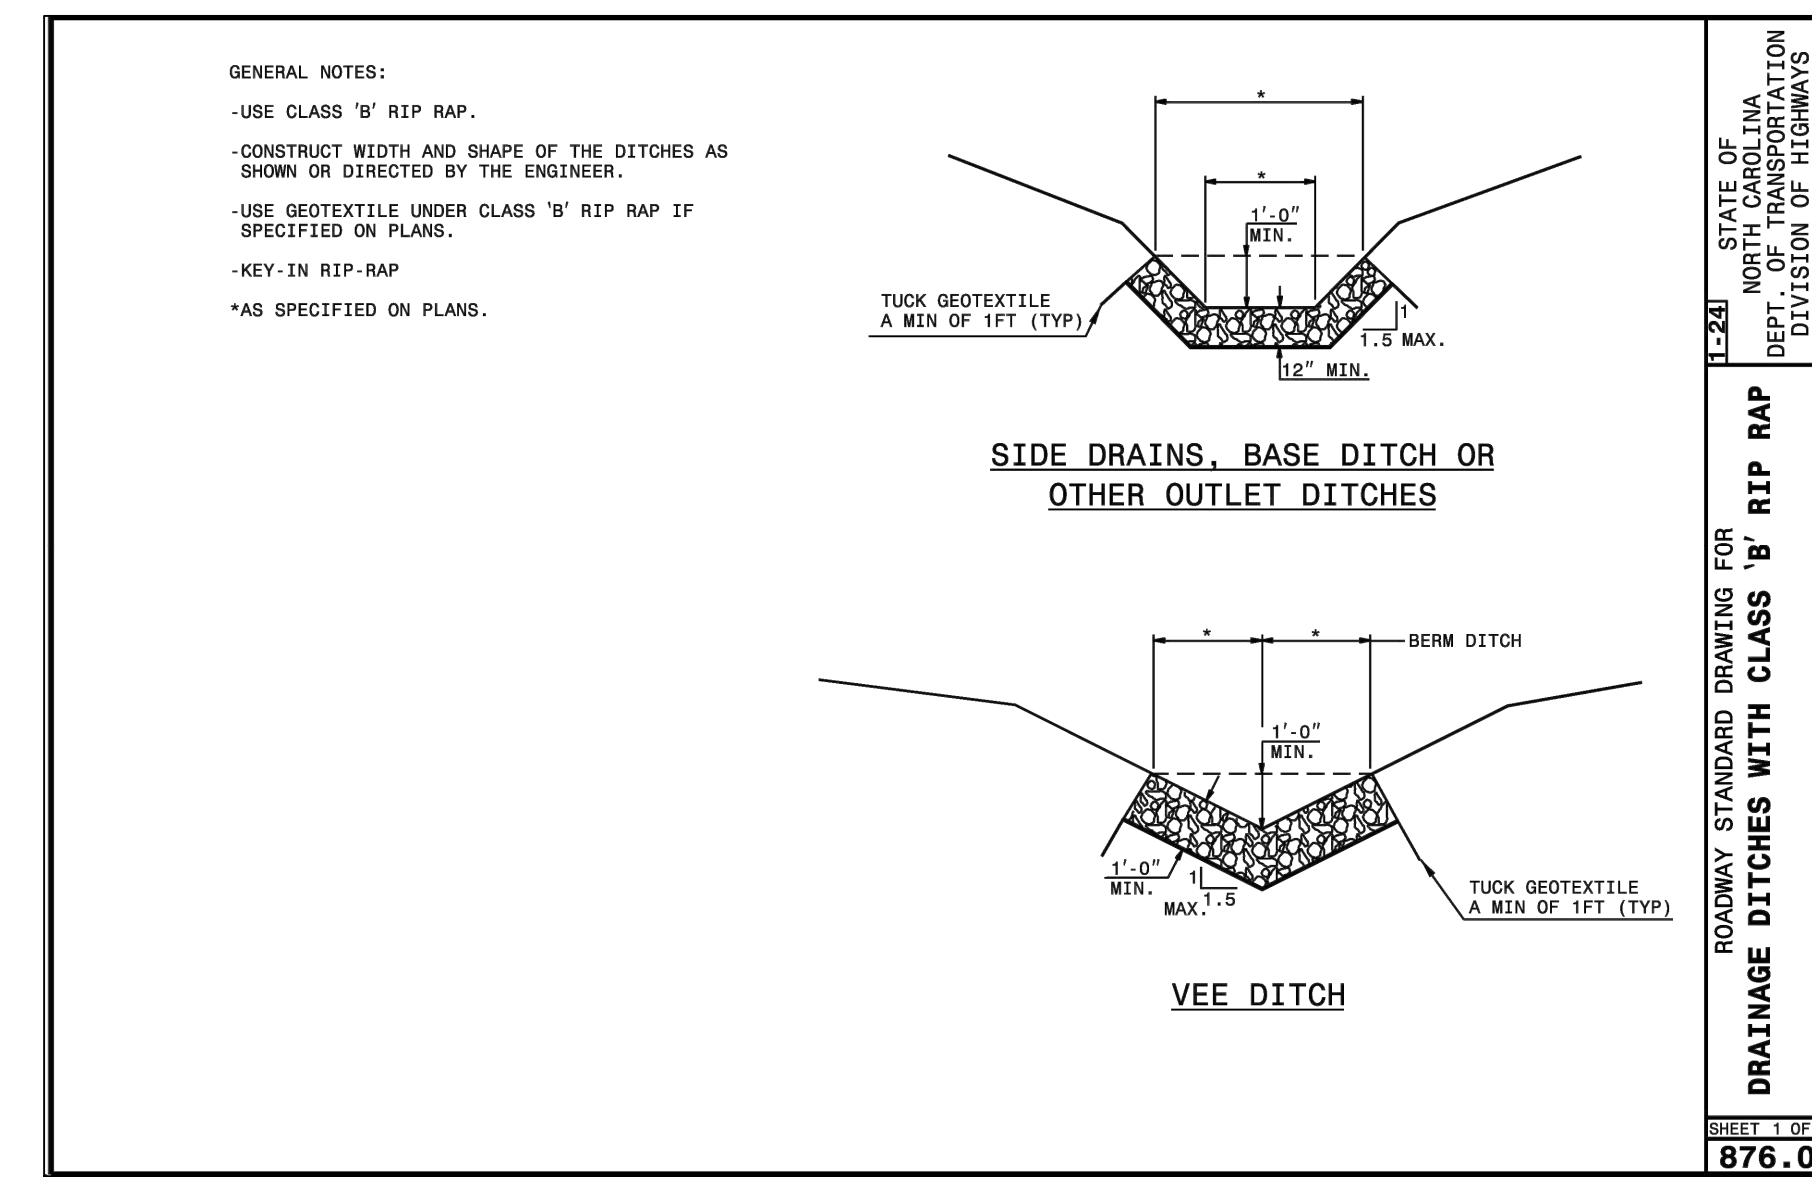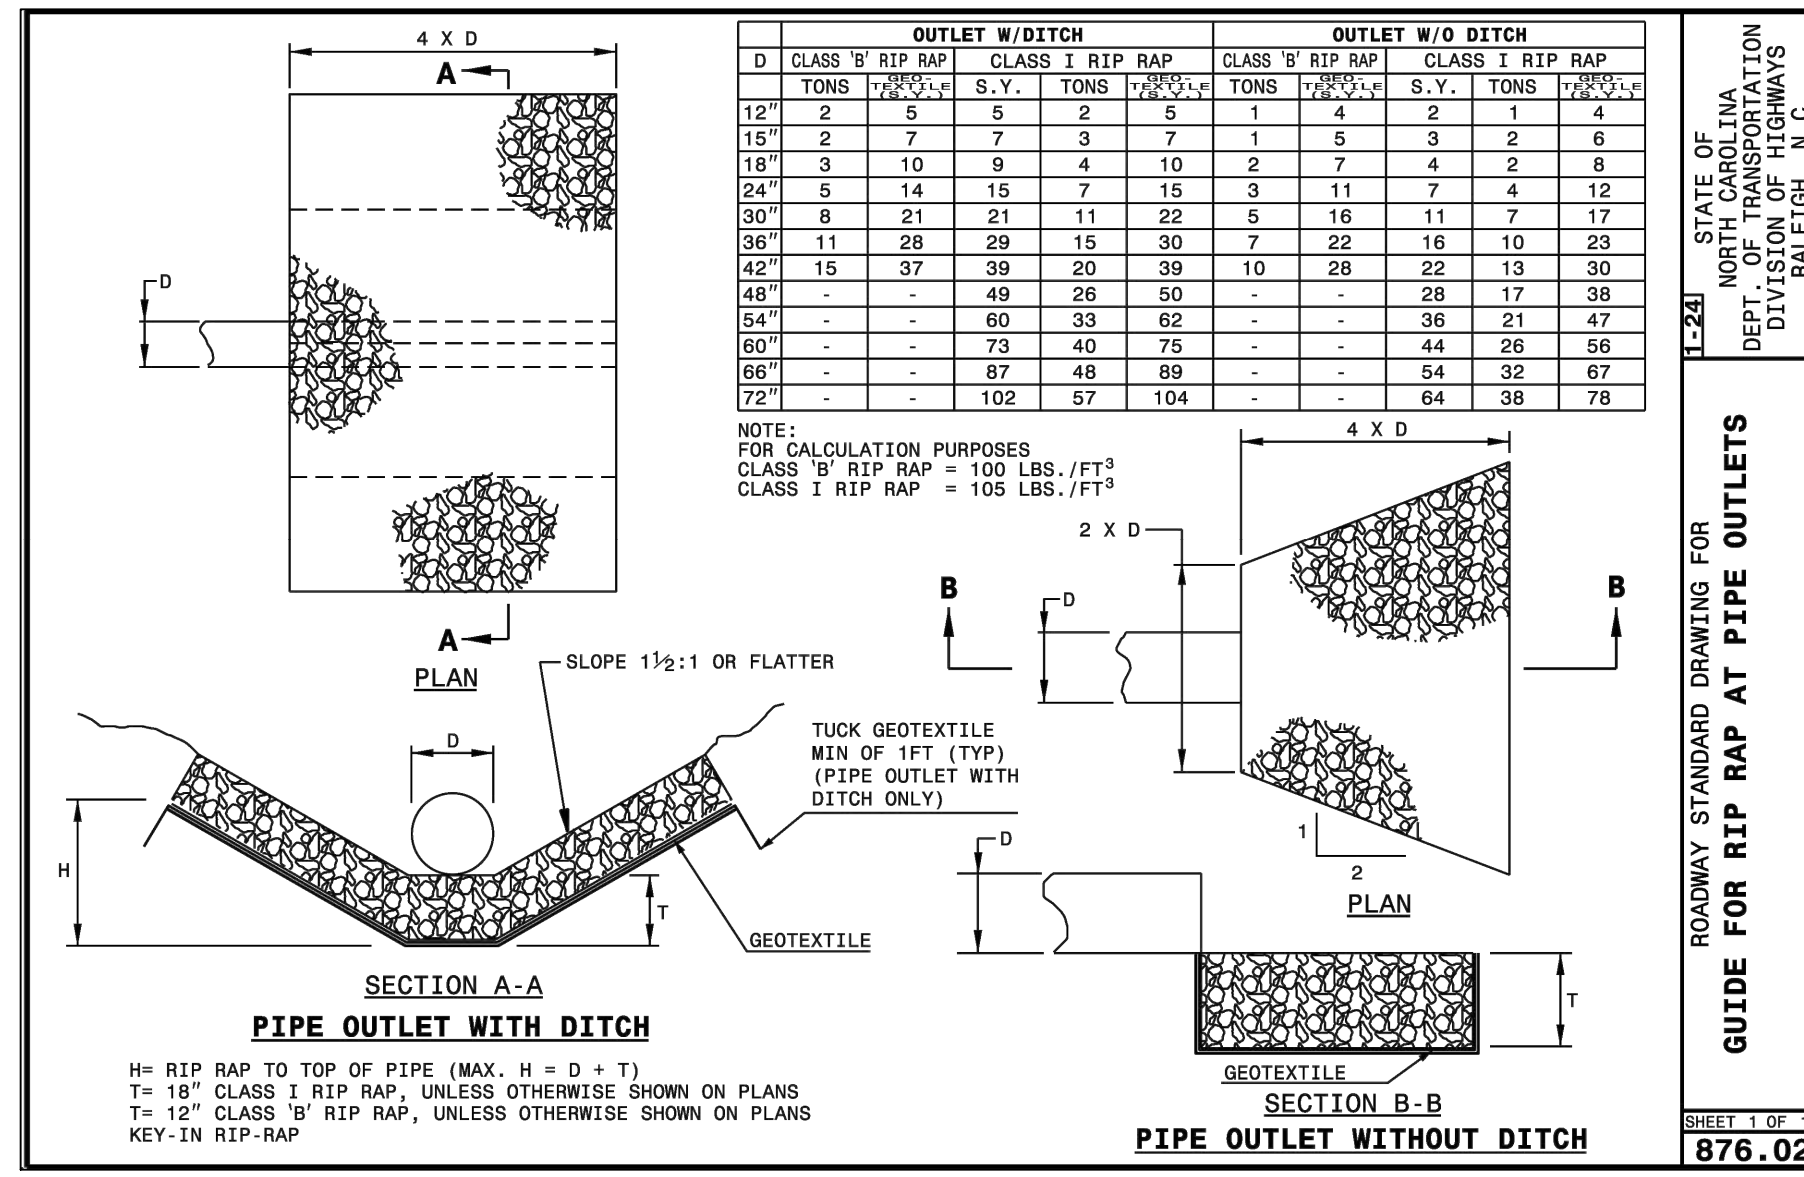


ZEBULON ANIMAL HOSPITAL
DVM SERVICES REALTY, LLC

PROJECT NUMBER:
PROJECT PHASE:
DATE: 03.18.2024

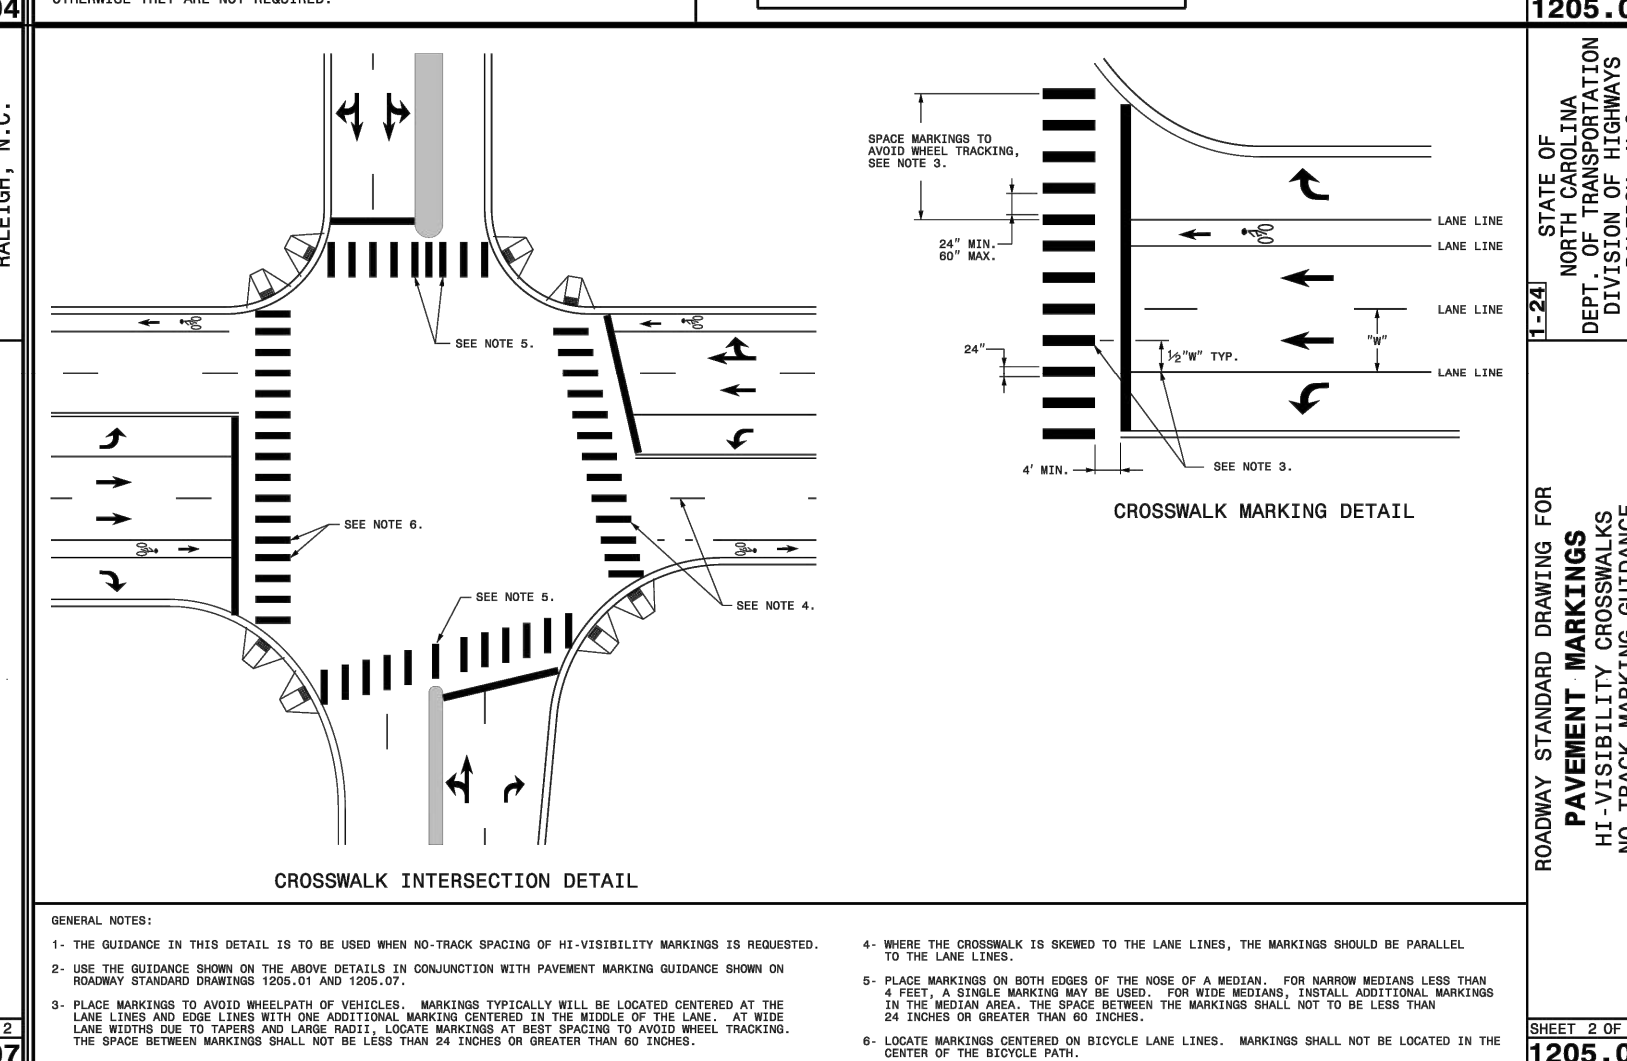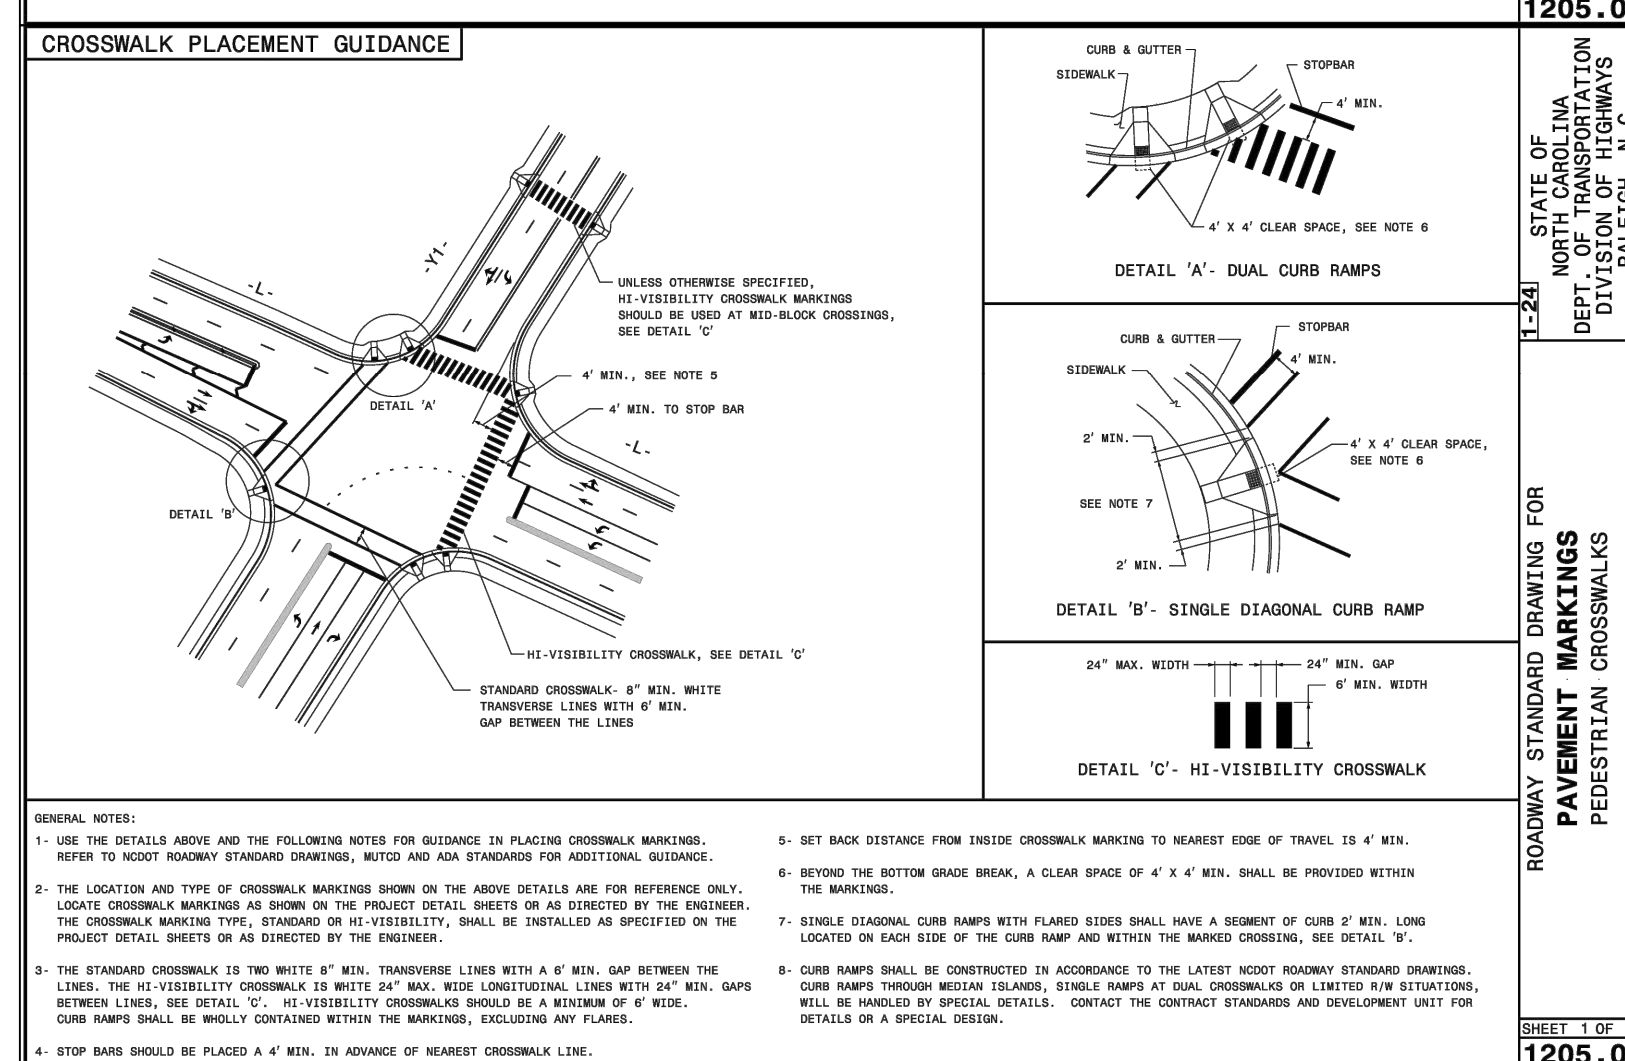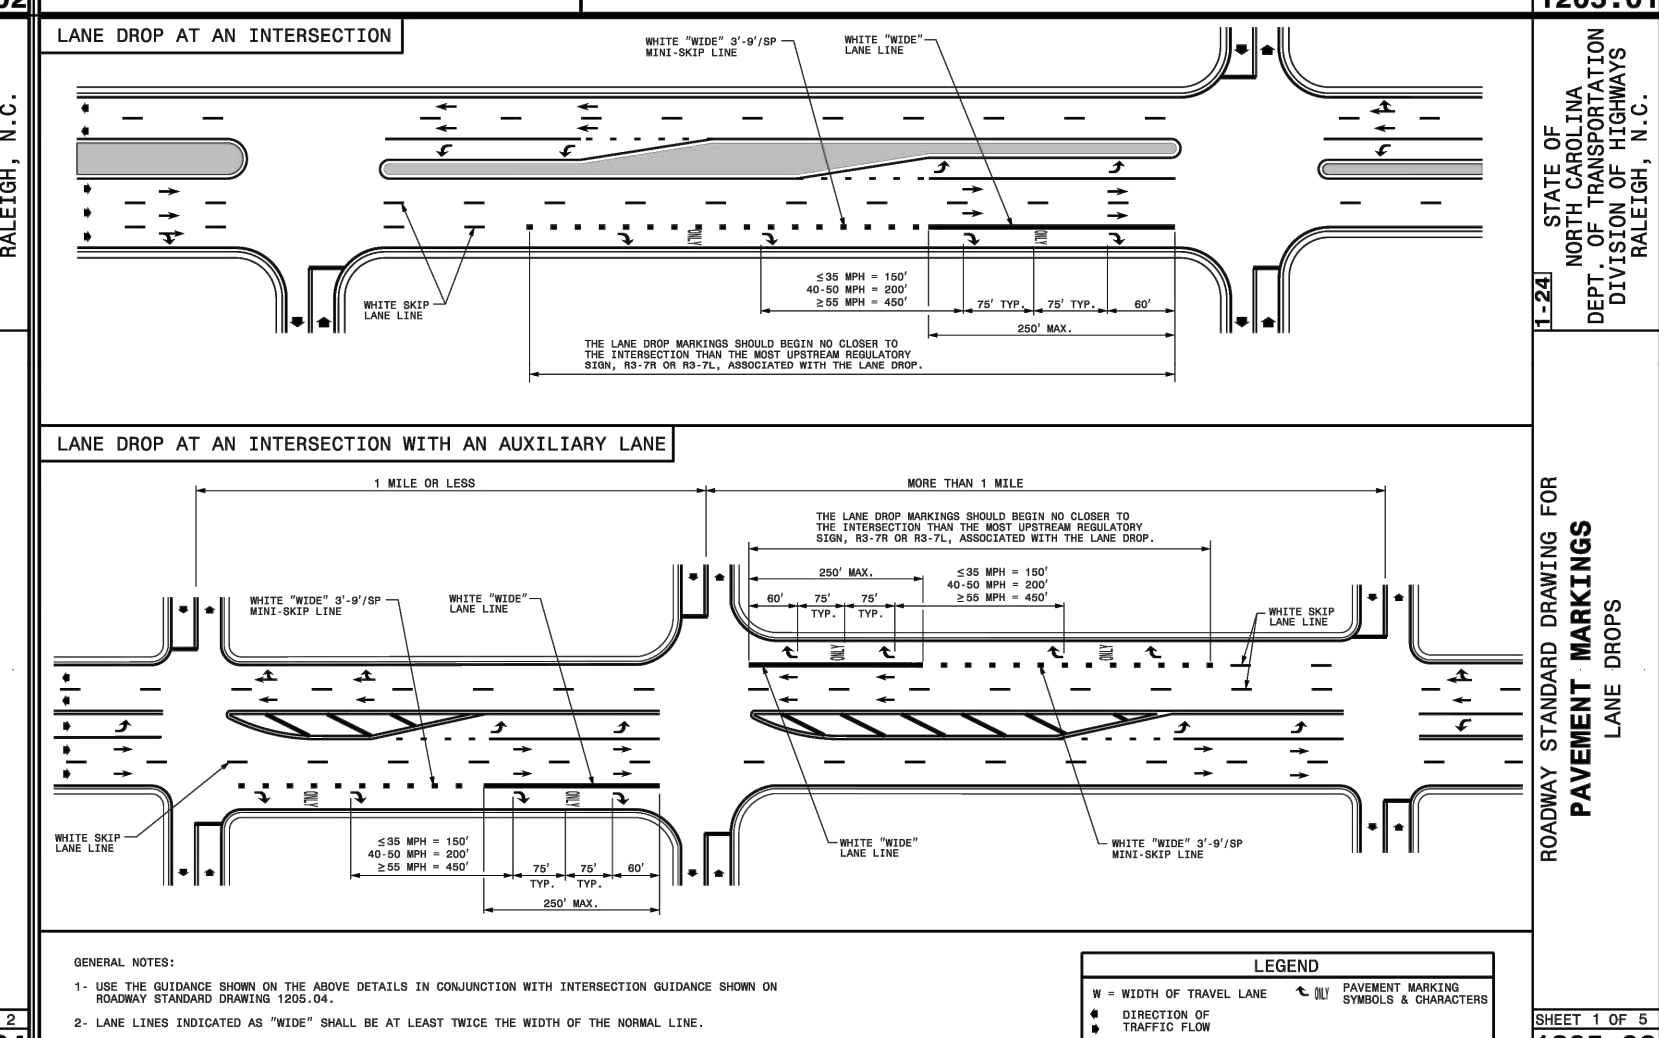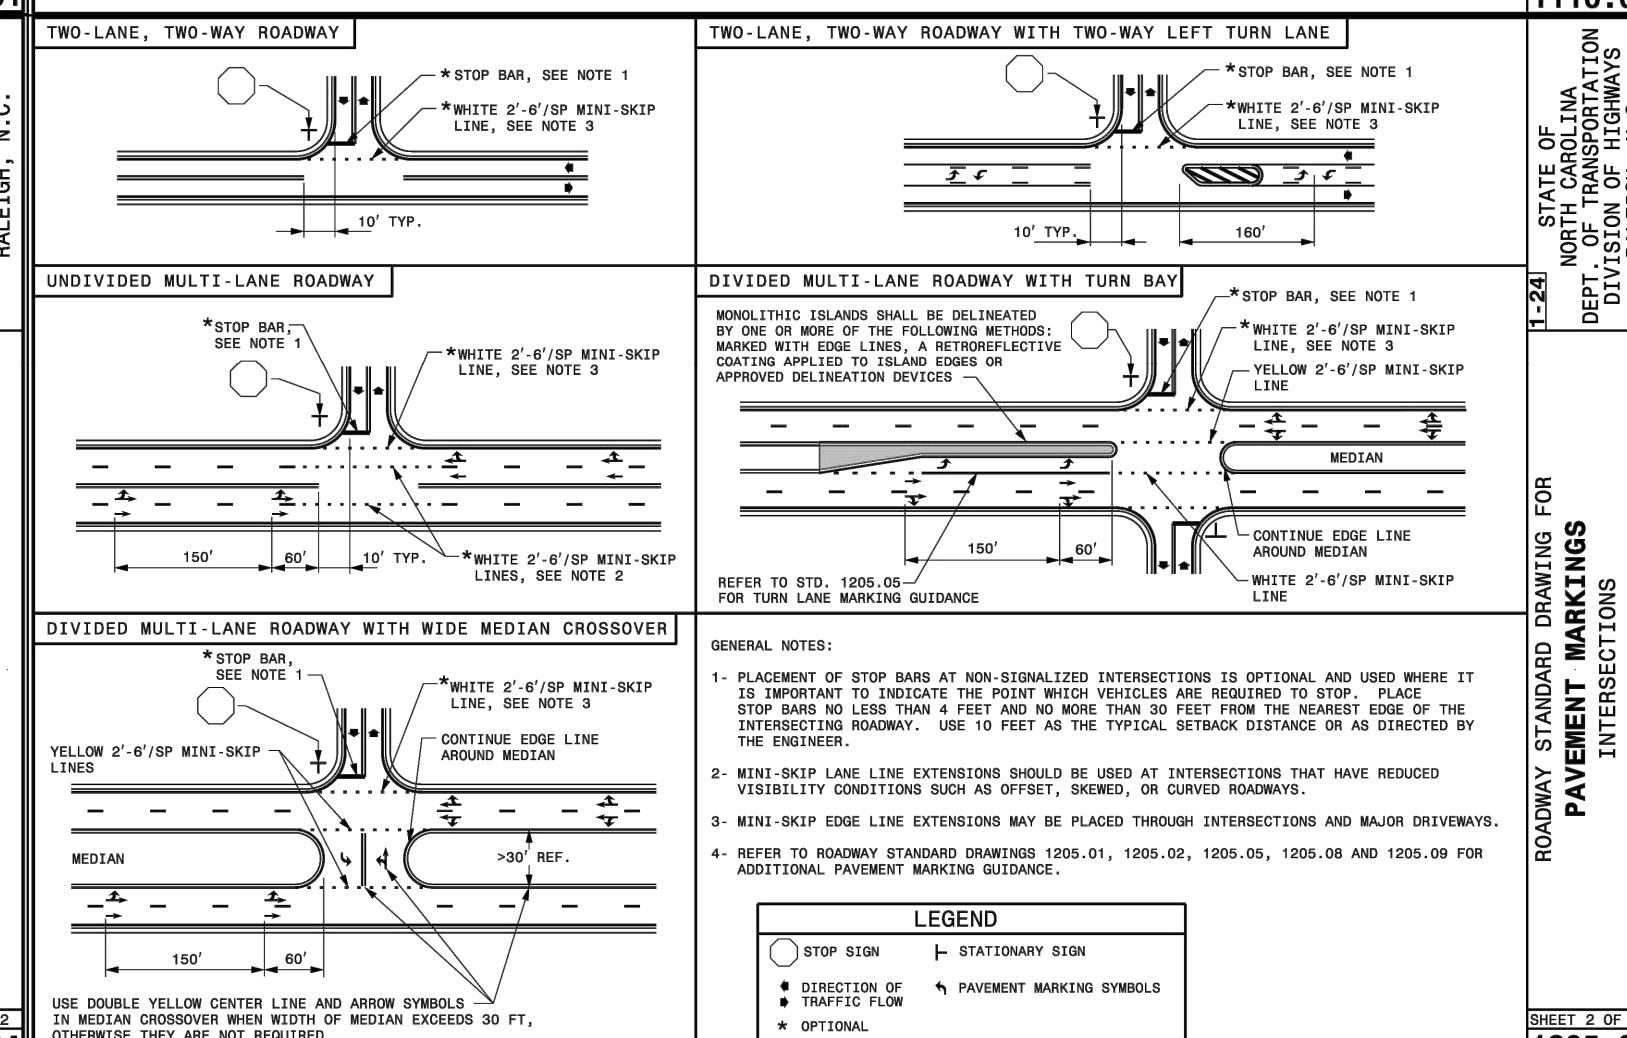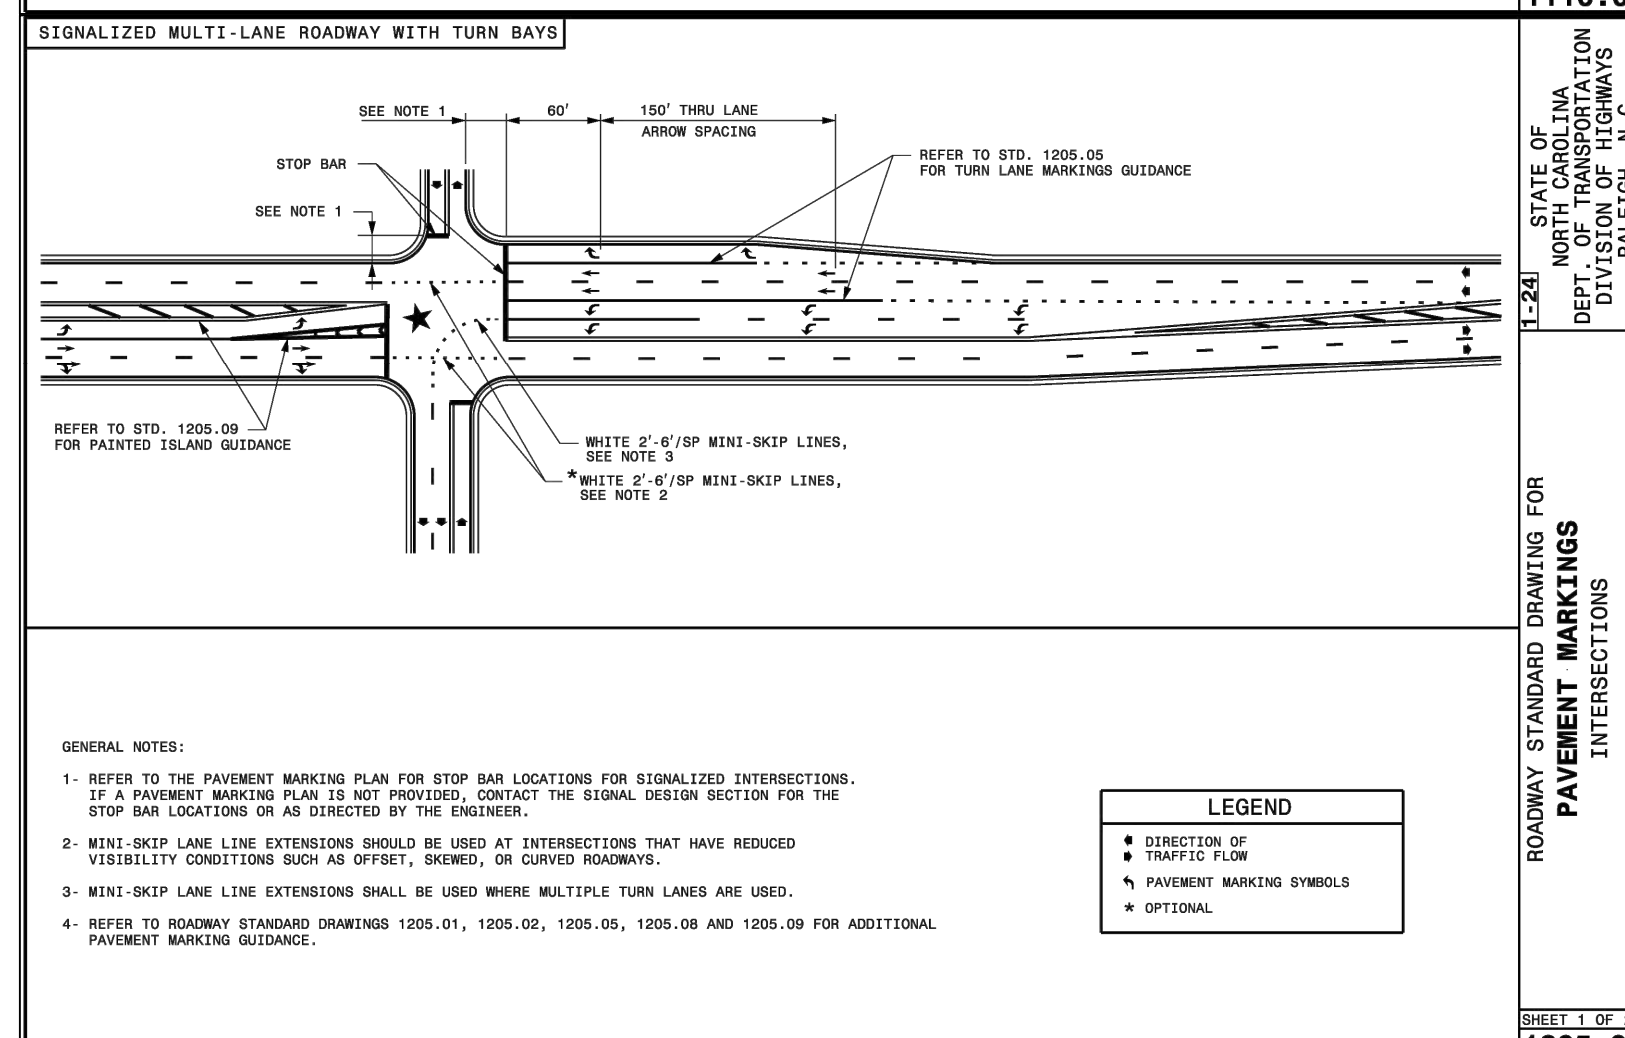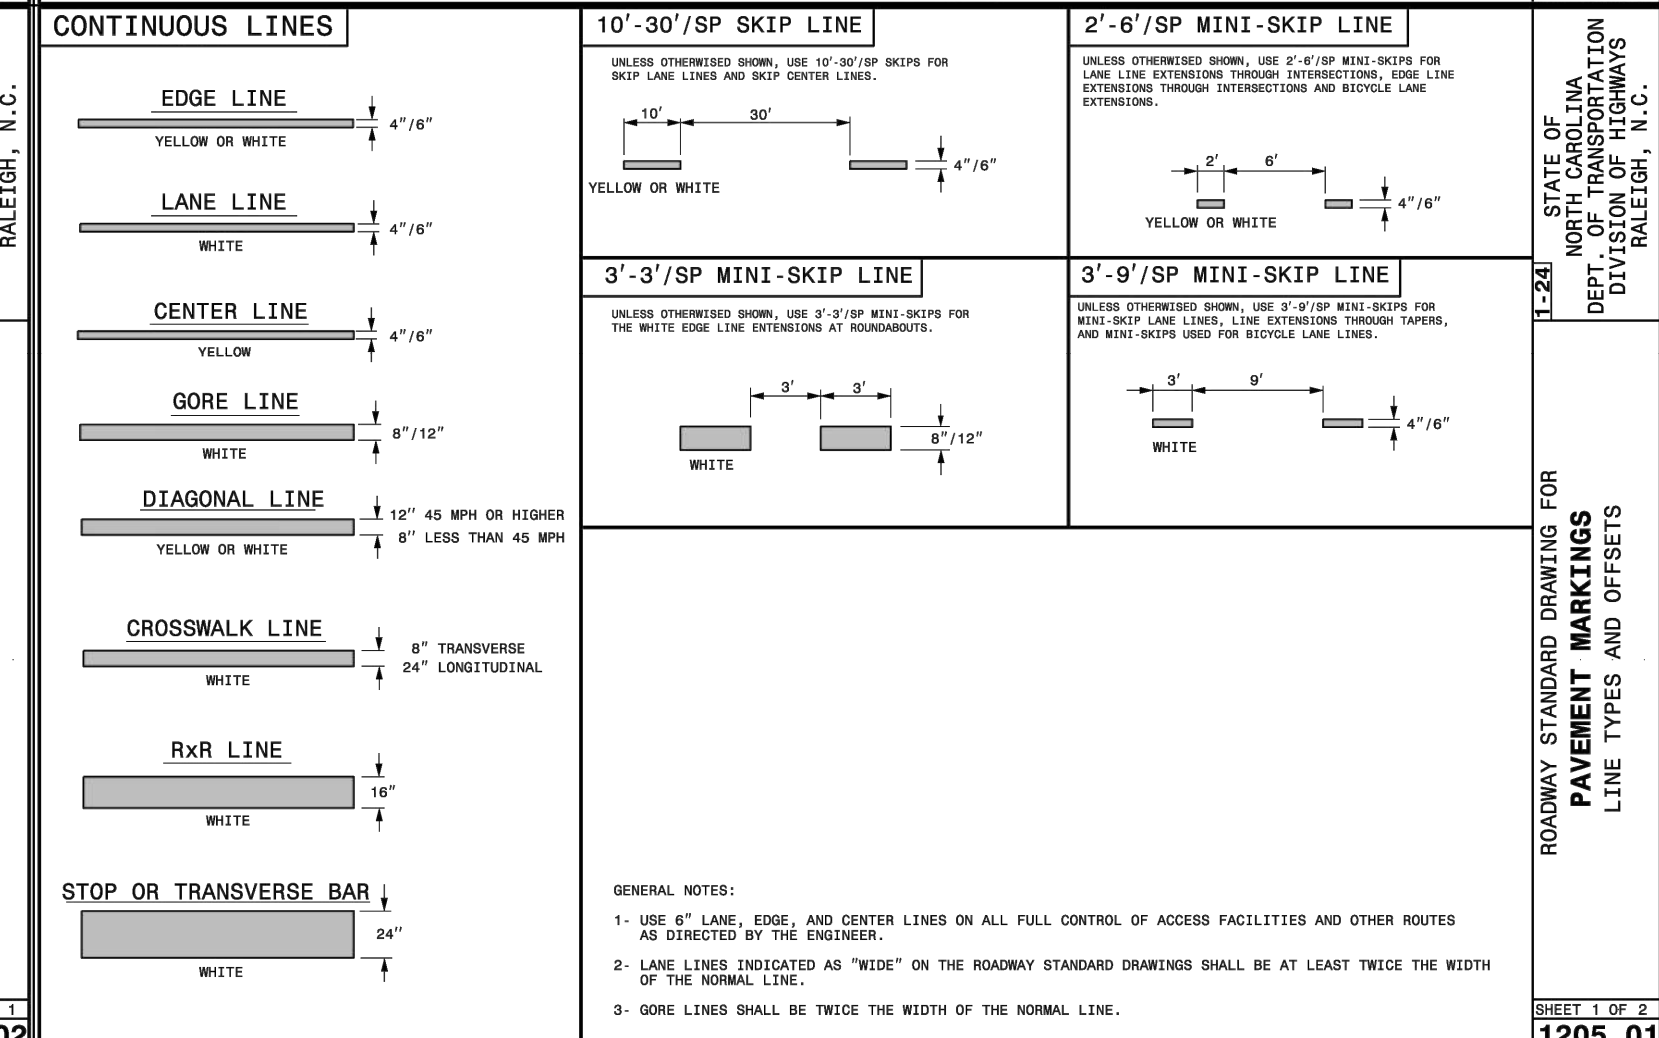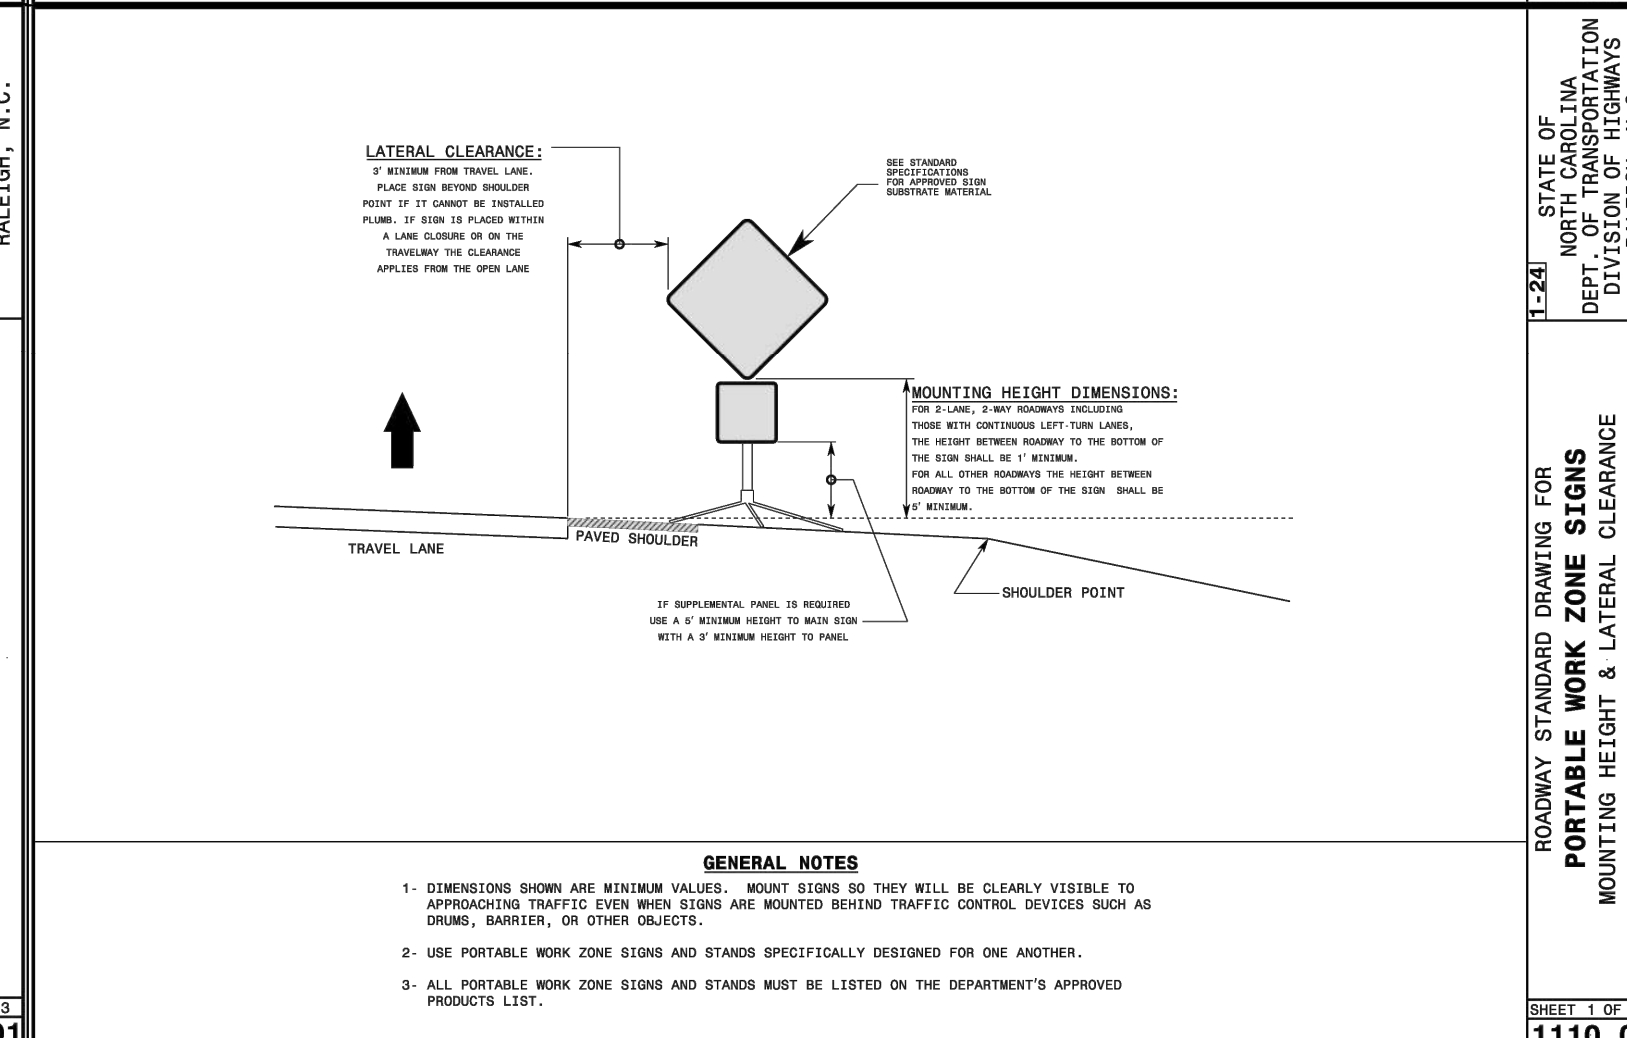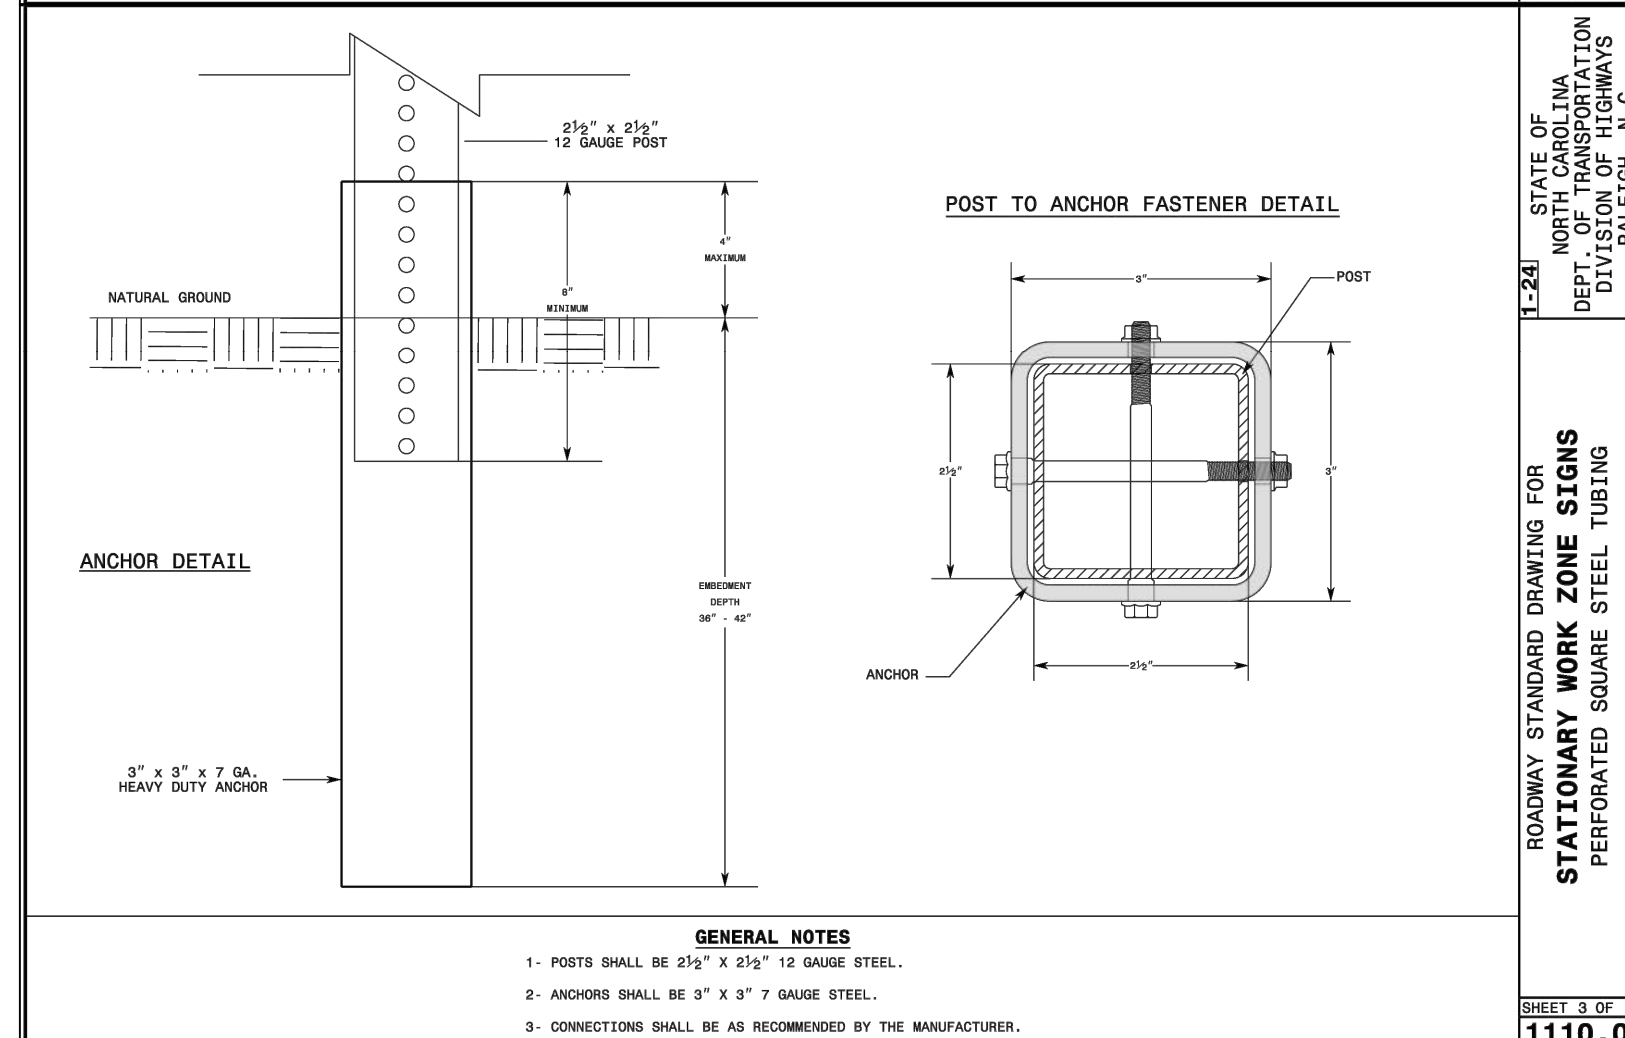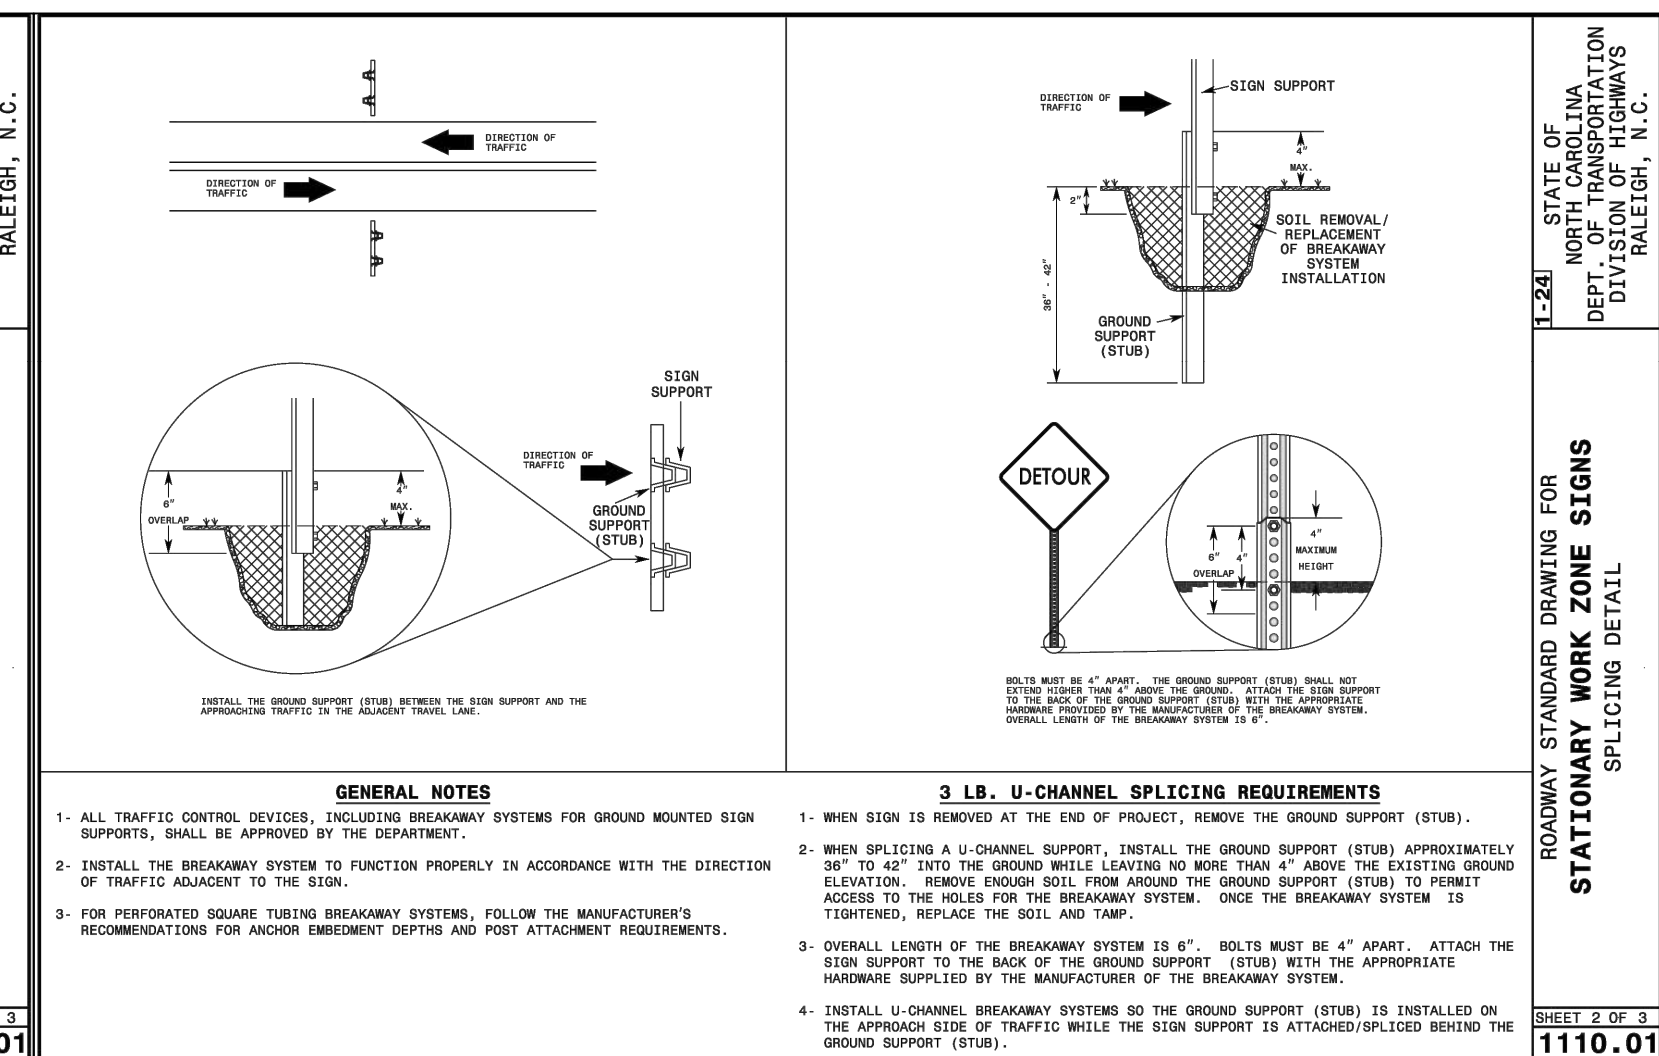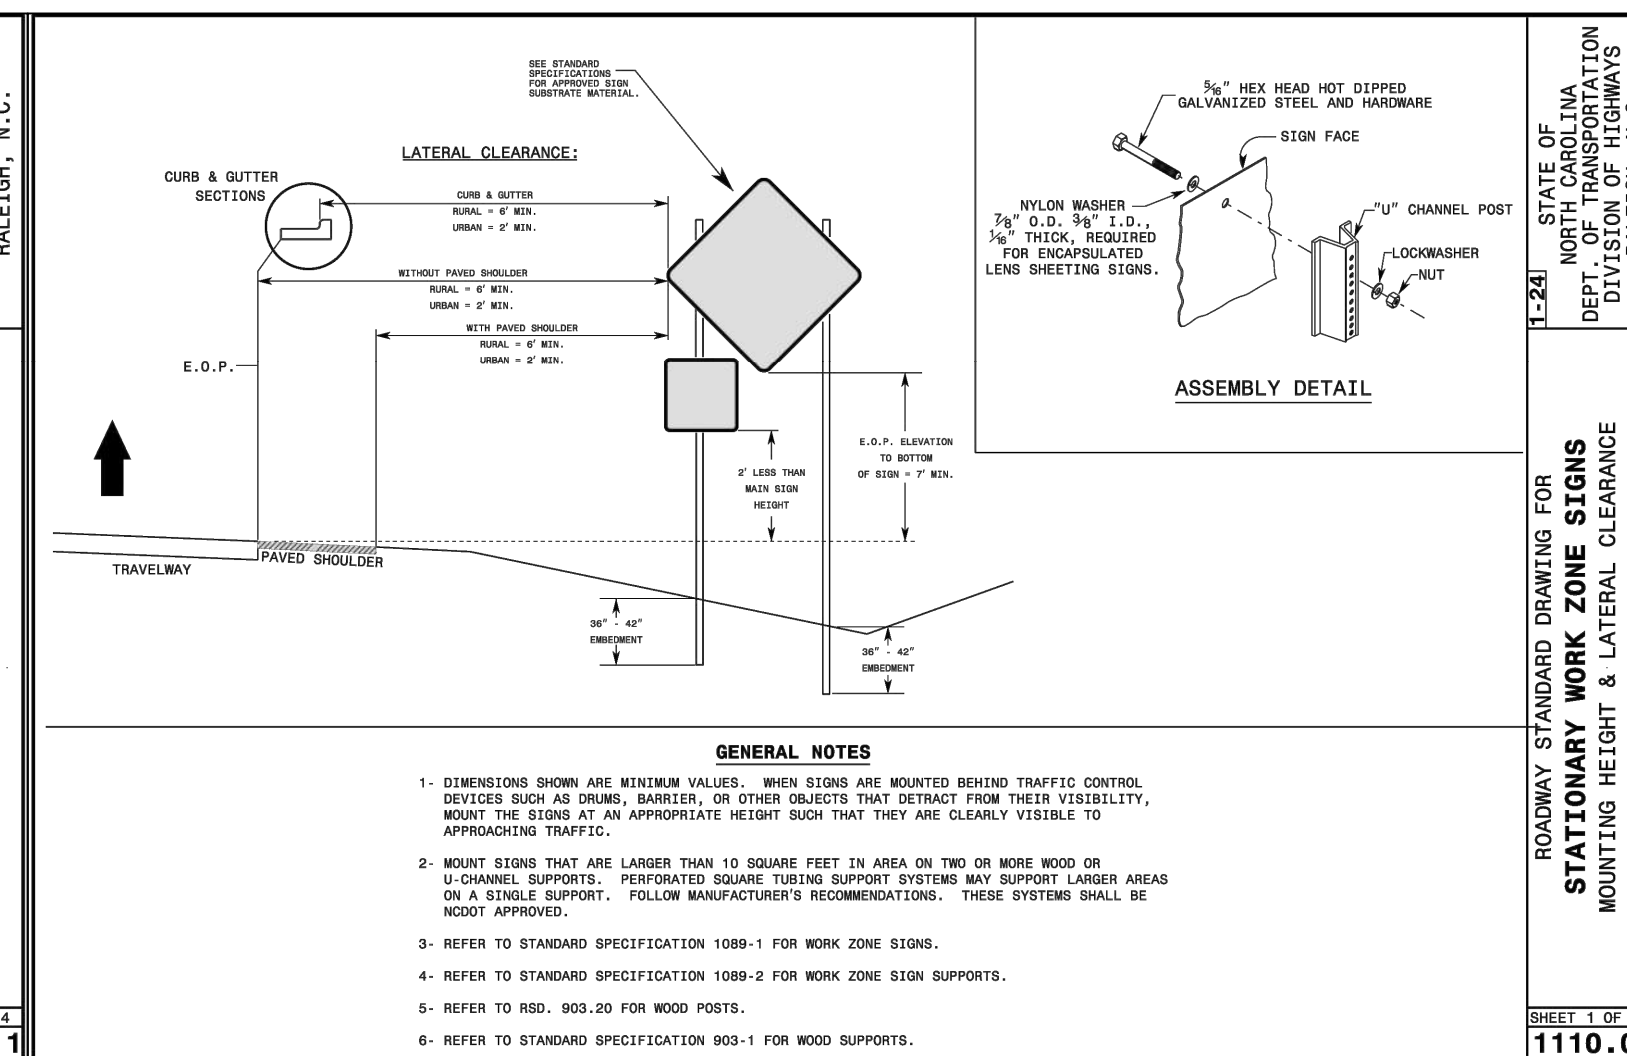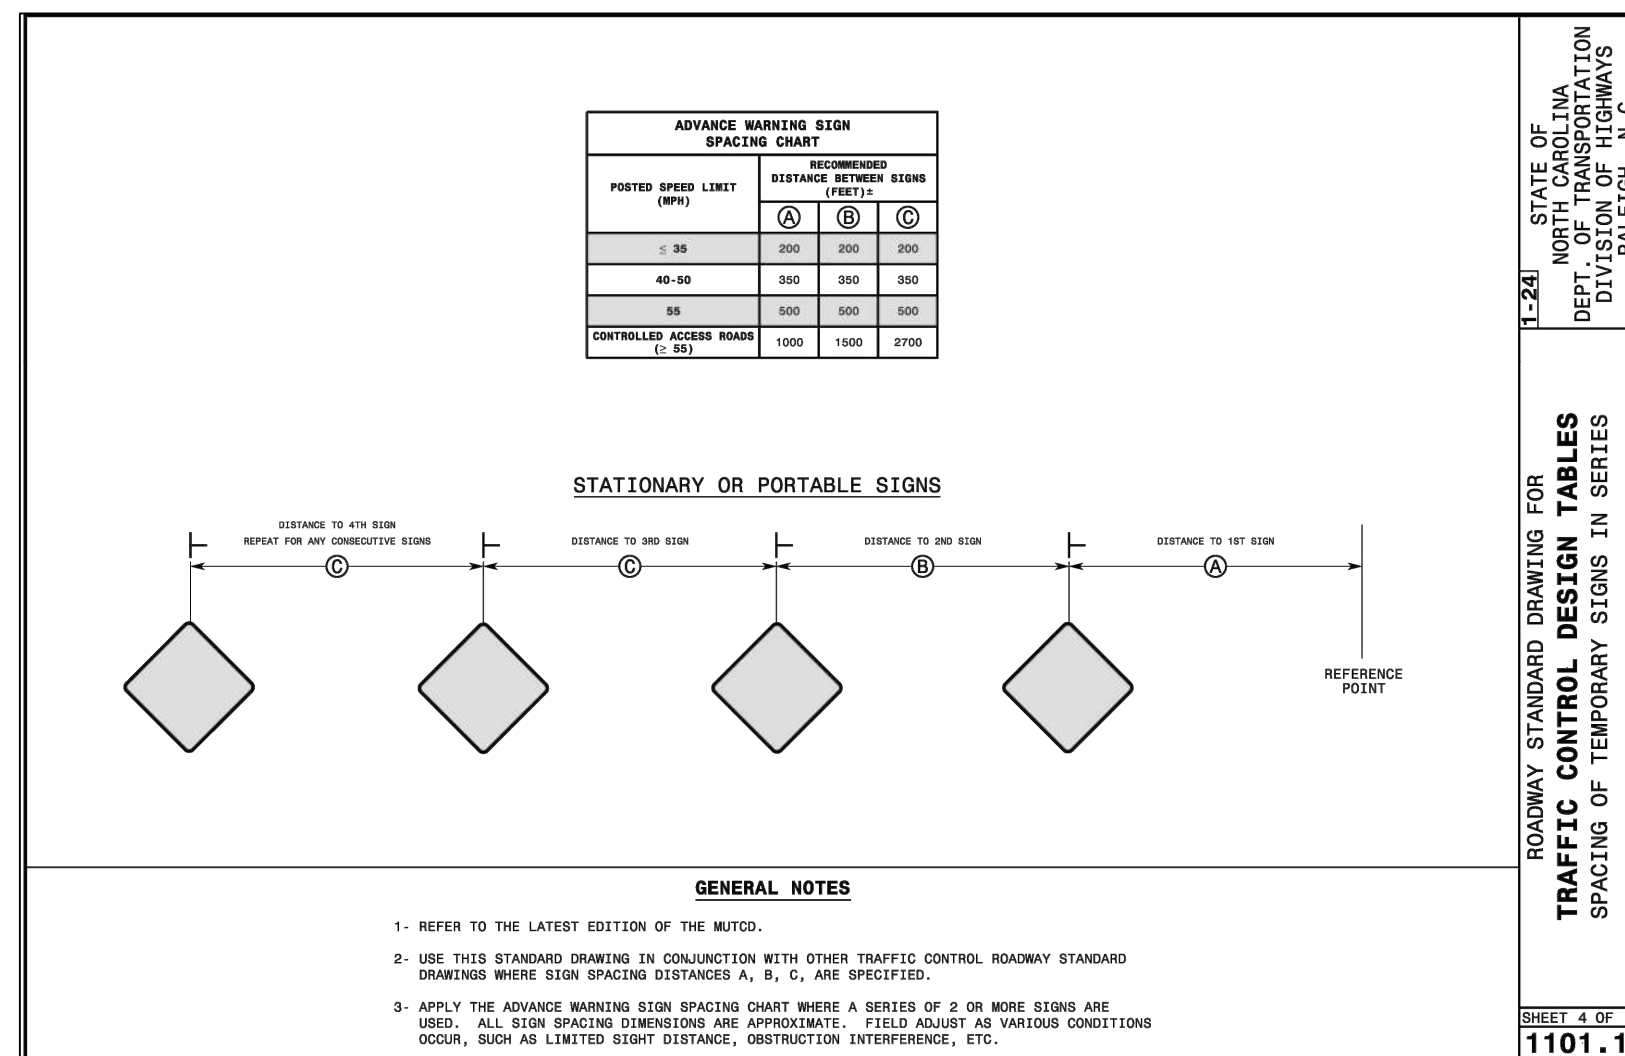


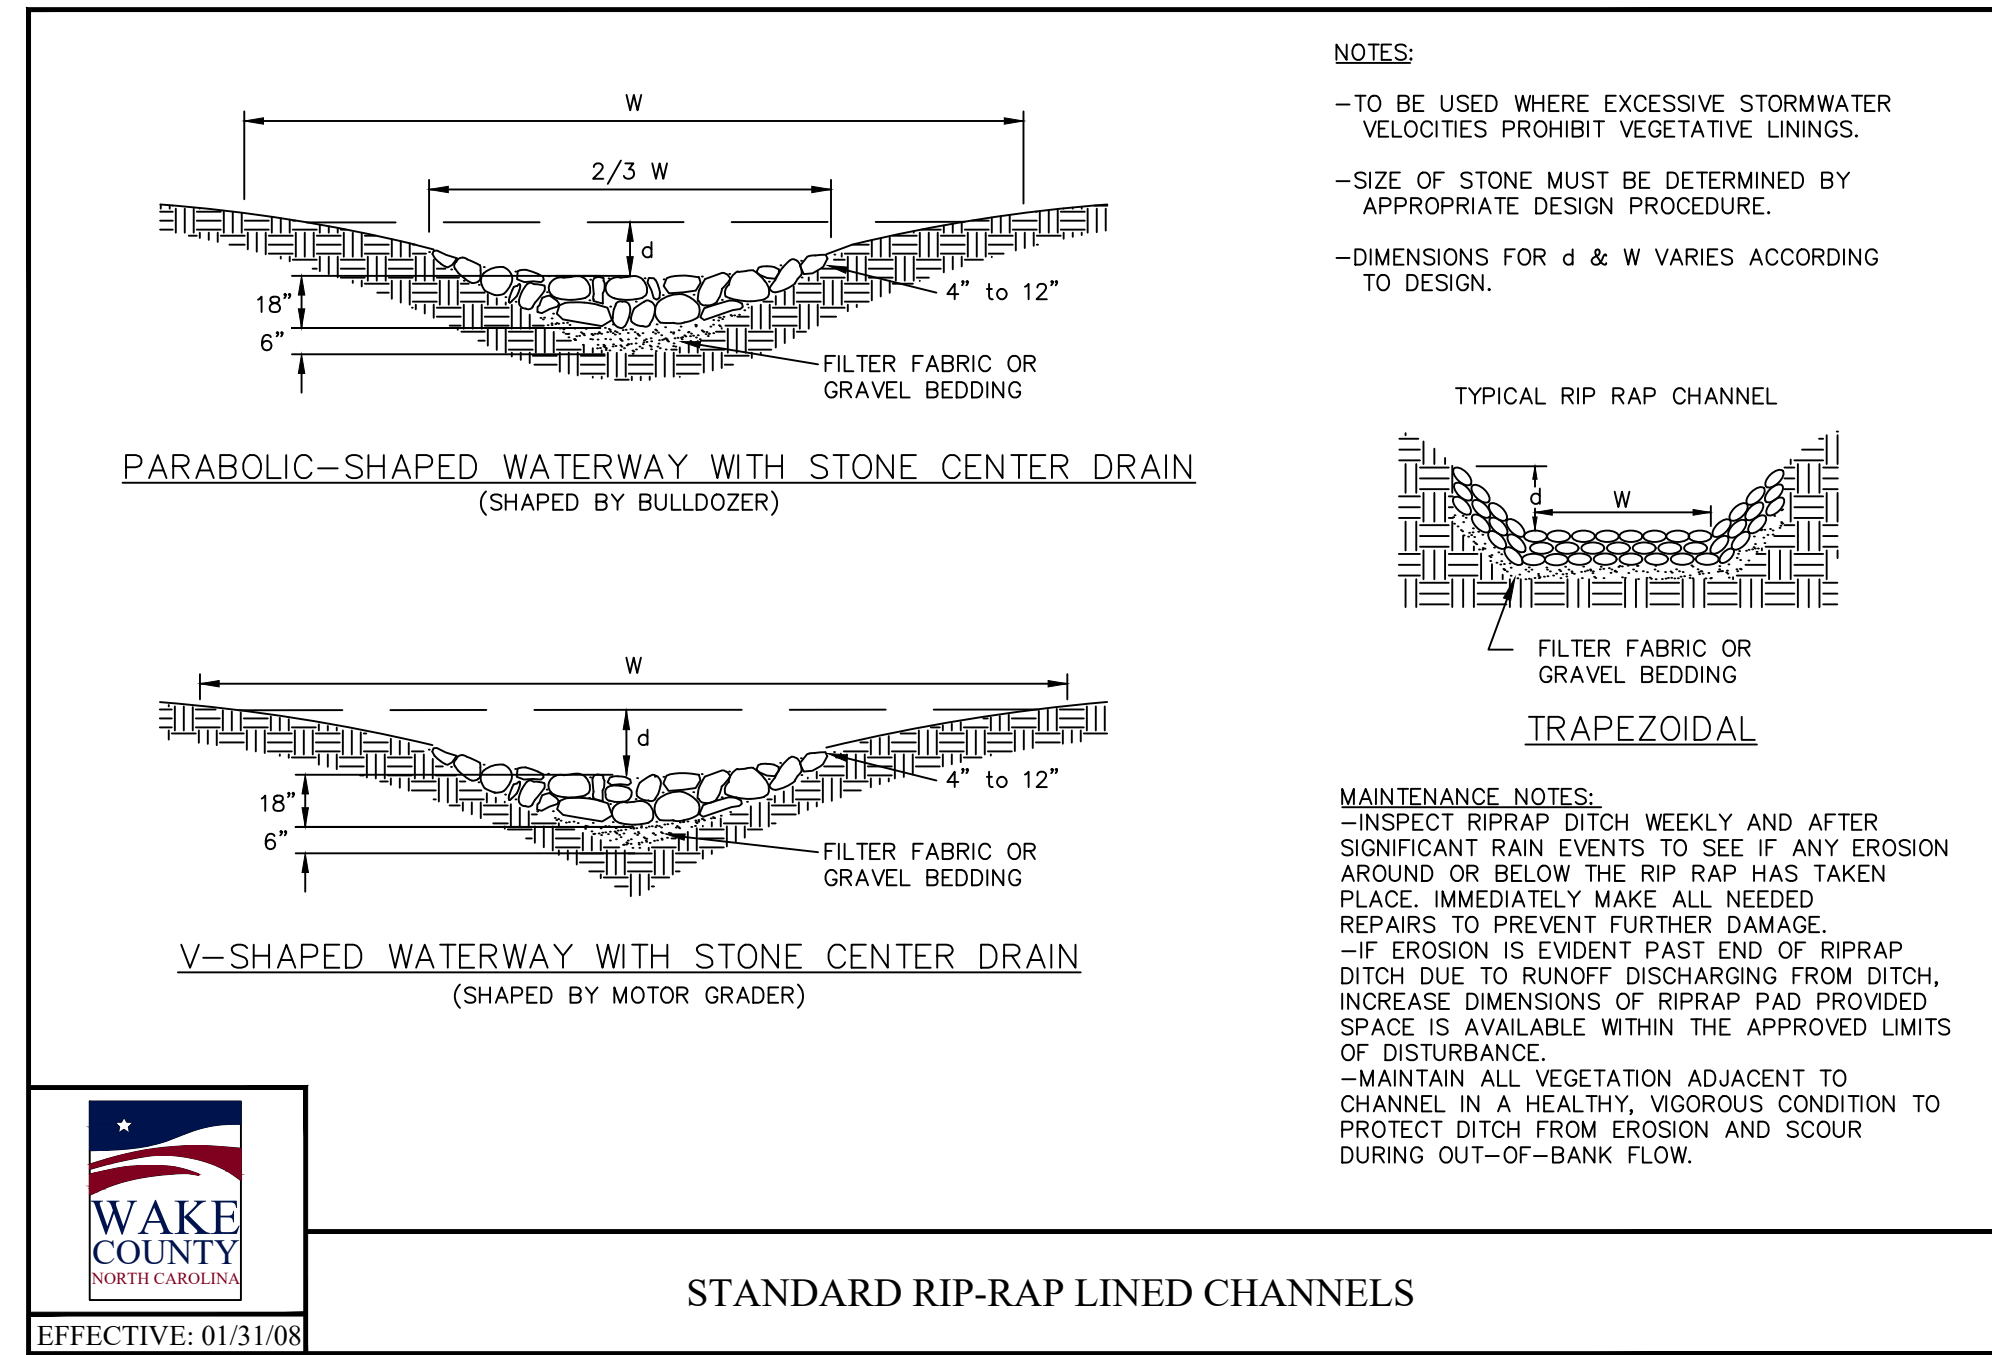


STANDARD RIP-RAP LINED CHANNELS

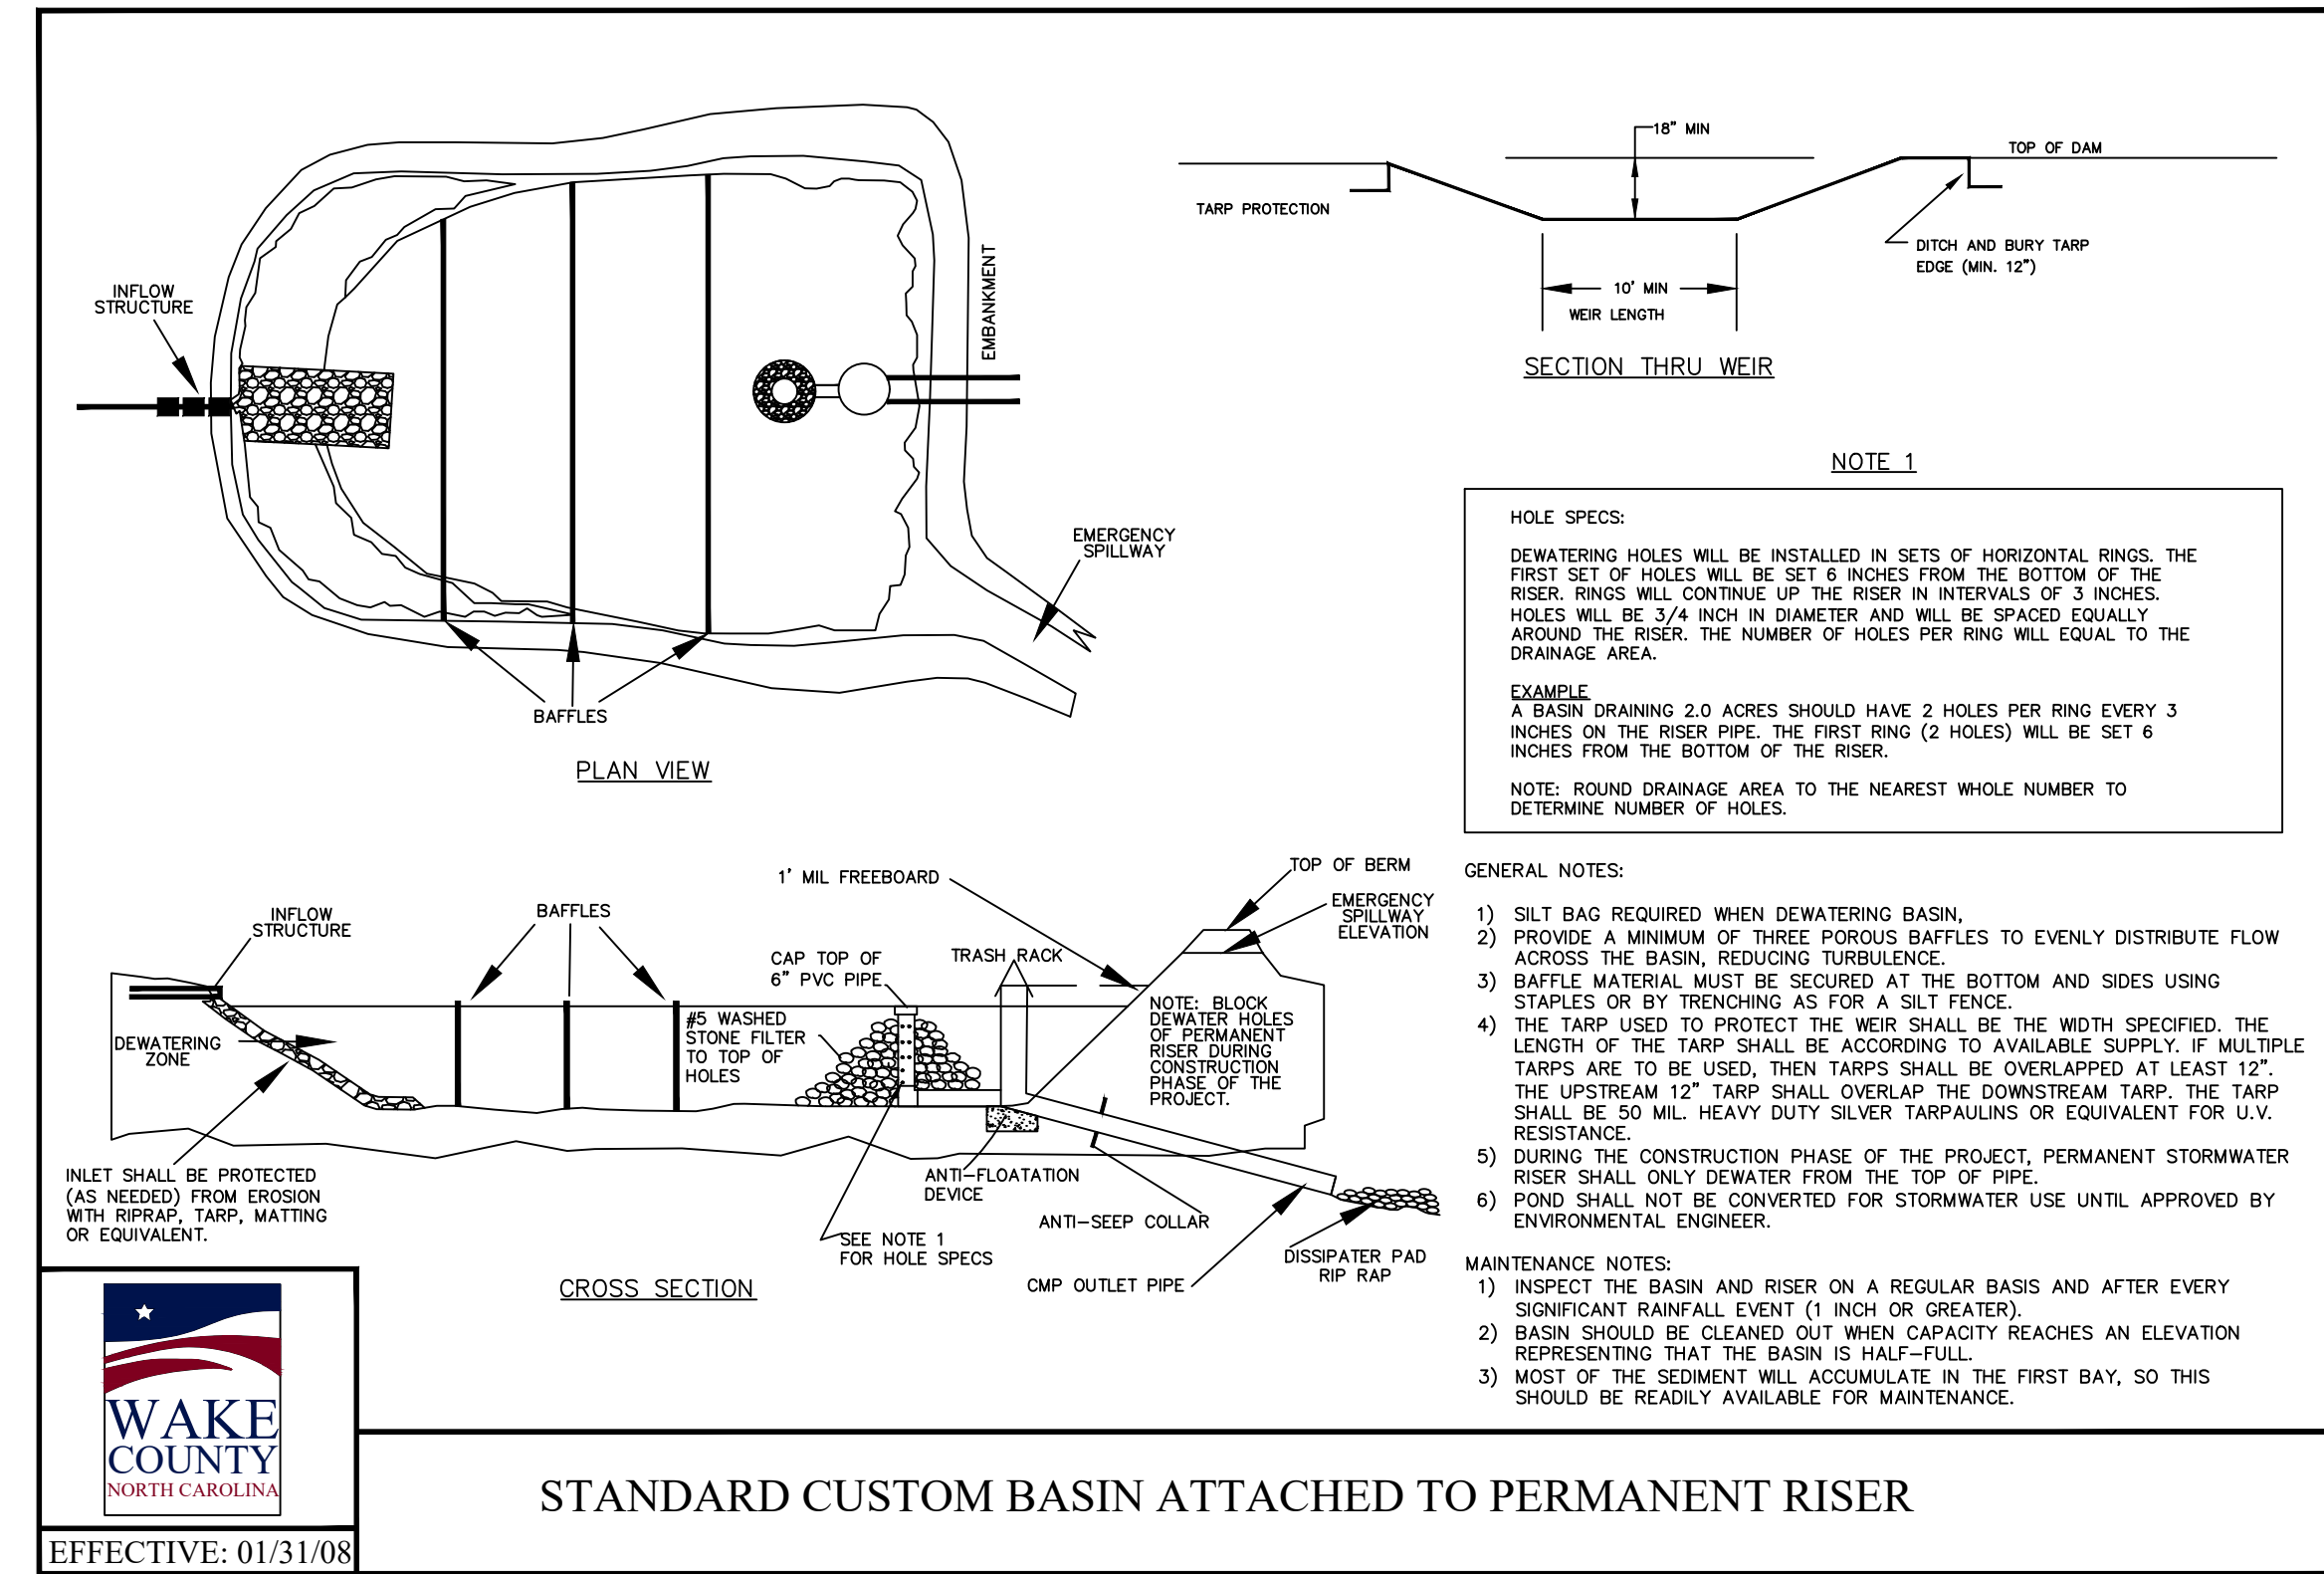

STANDARD CUSTOM BASIN ATTACHED TO PERMANENT RISER

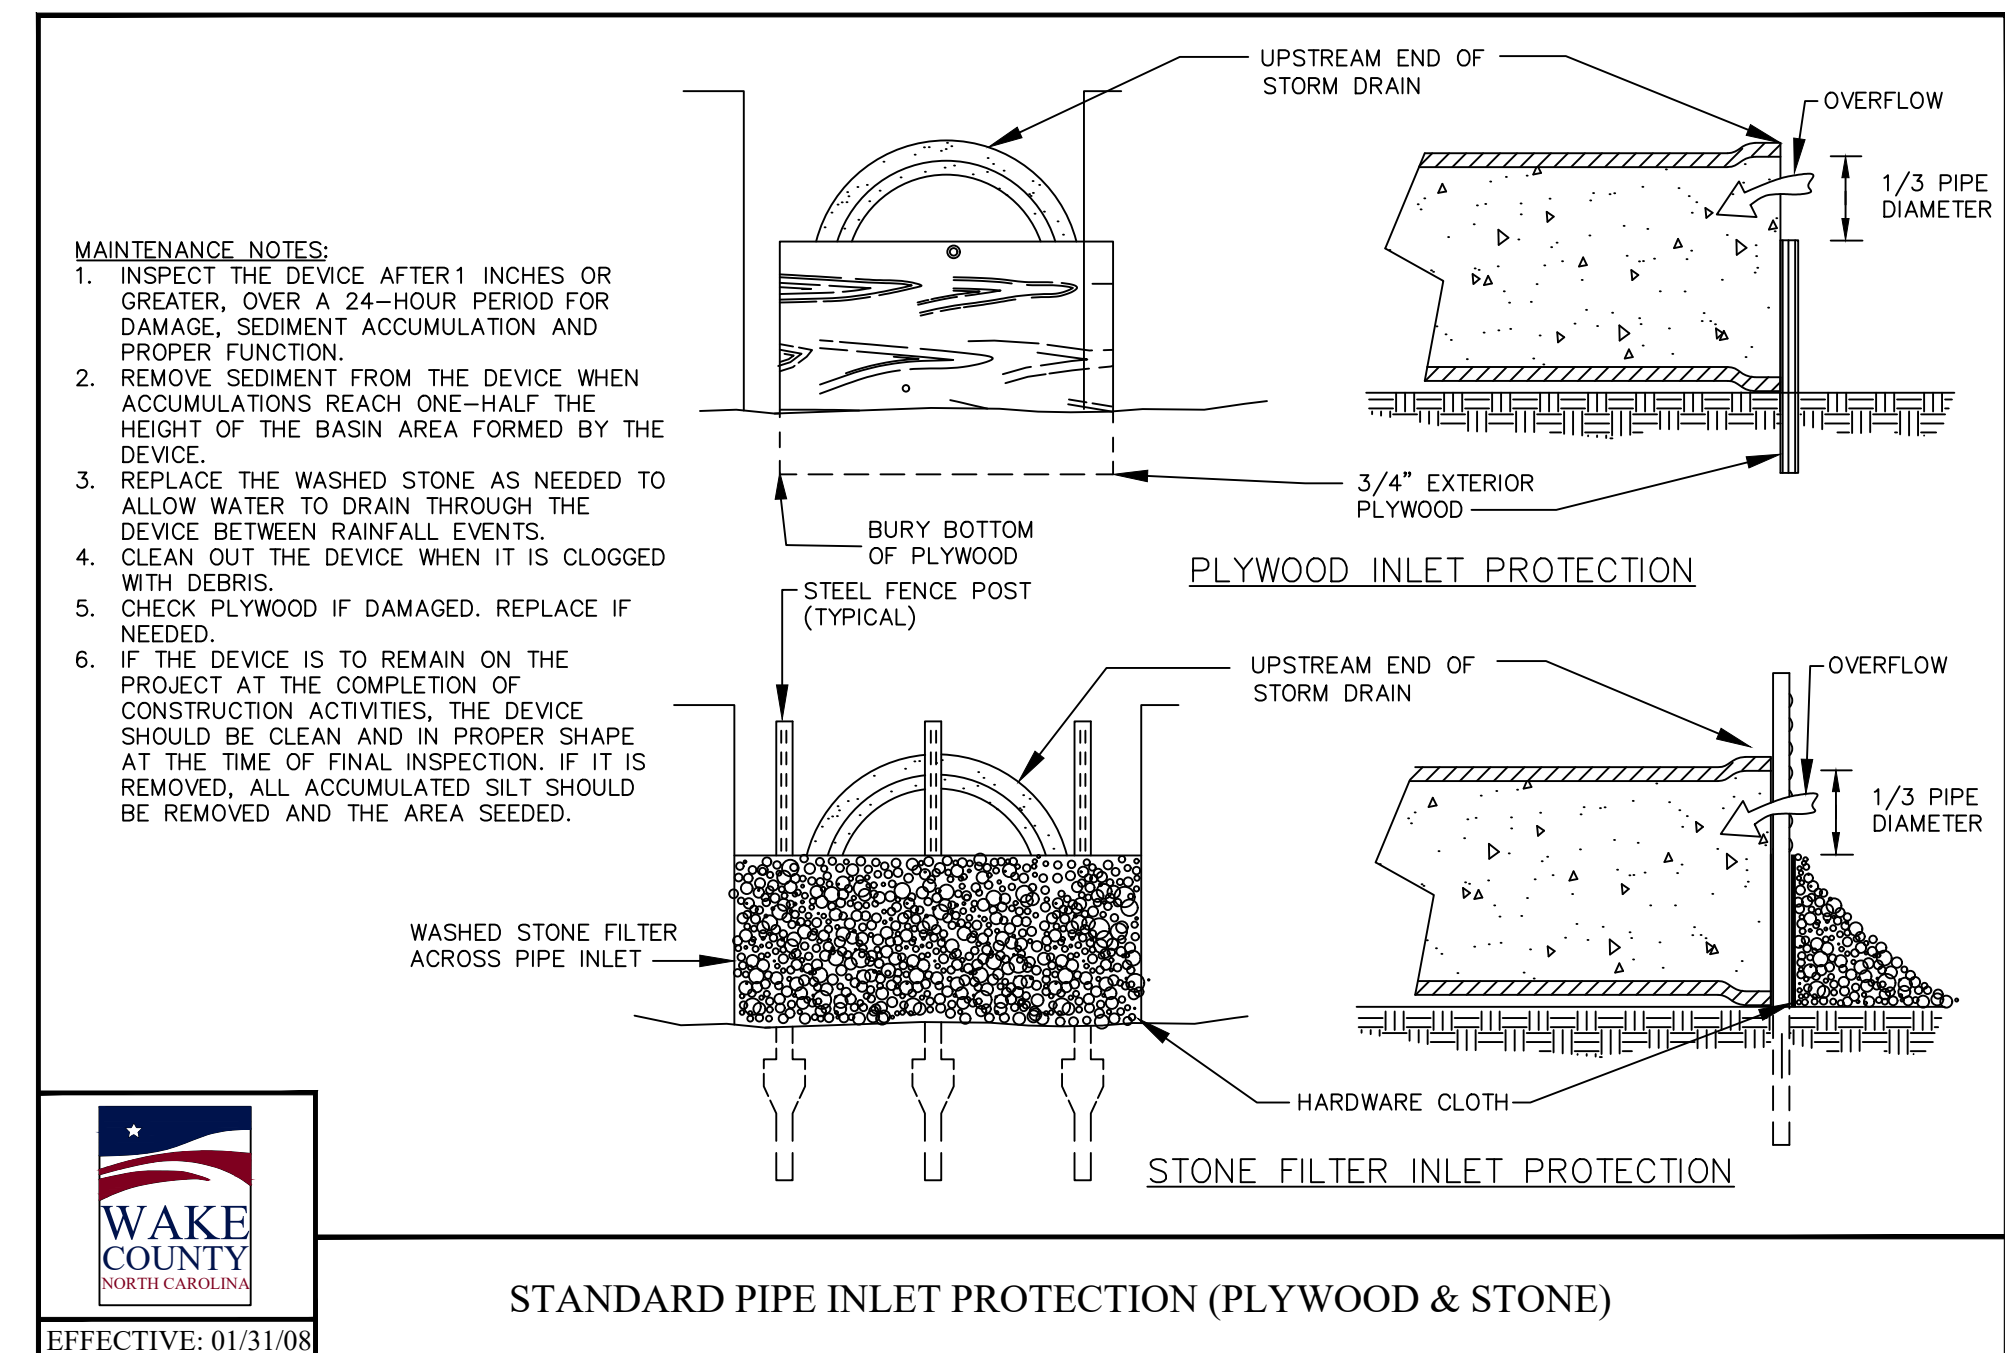

STANDARD PIPE INLET PROTECTION (PLYWOOD & STONE)

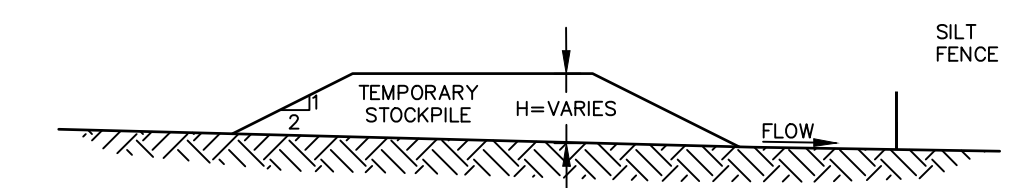

TEMPORARY STOCKPILE WITH SILT FENCE
NO SCALE

STOCKPILE STABILIZATION AND MAINTENANCE:
STOCKPILES OF SOIL AND OTHER BUILDING MATERIALS TO REMAIN IN PLACE MORE THAN THREE (3) DAYS SHALL BE FURNISHED WITH EROSION AND SEDIMENT CONTROL MEASURES (I.E. PERIMETER SILT FENCE). STOCKPILES TO REMAIN IN PLACE FOR 30 DAYS OR MORE SHALL RECEIVE TEMPORARY SEEDING.